


# TopGear GP

INTERNAL GEAR PUMPS

A.0500.451 – IM-TG GP/07.01 EN (10/2014)

ORIGINAL INSTRUCTIONS

READ AND UNDERSTAND THIS MANUAL PRIOR TO OPERATING OR SERVICING THIS PRODUCT.

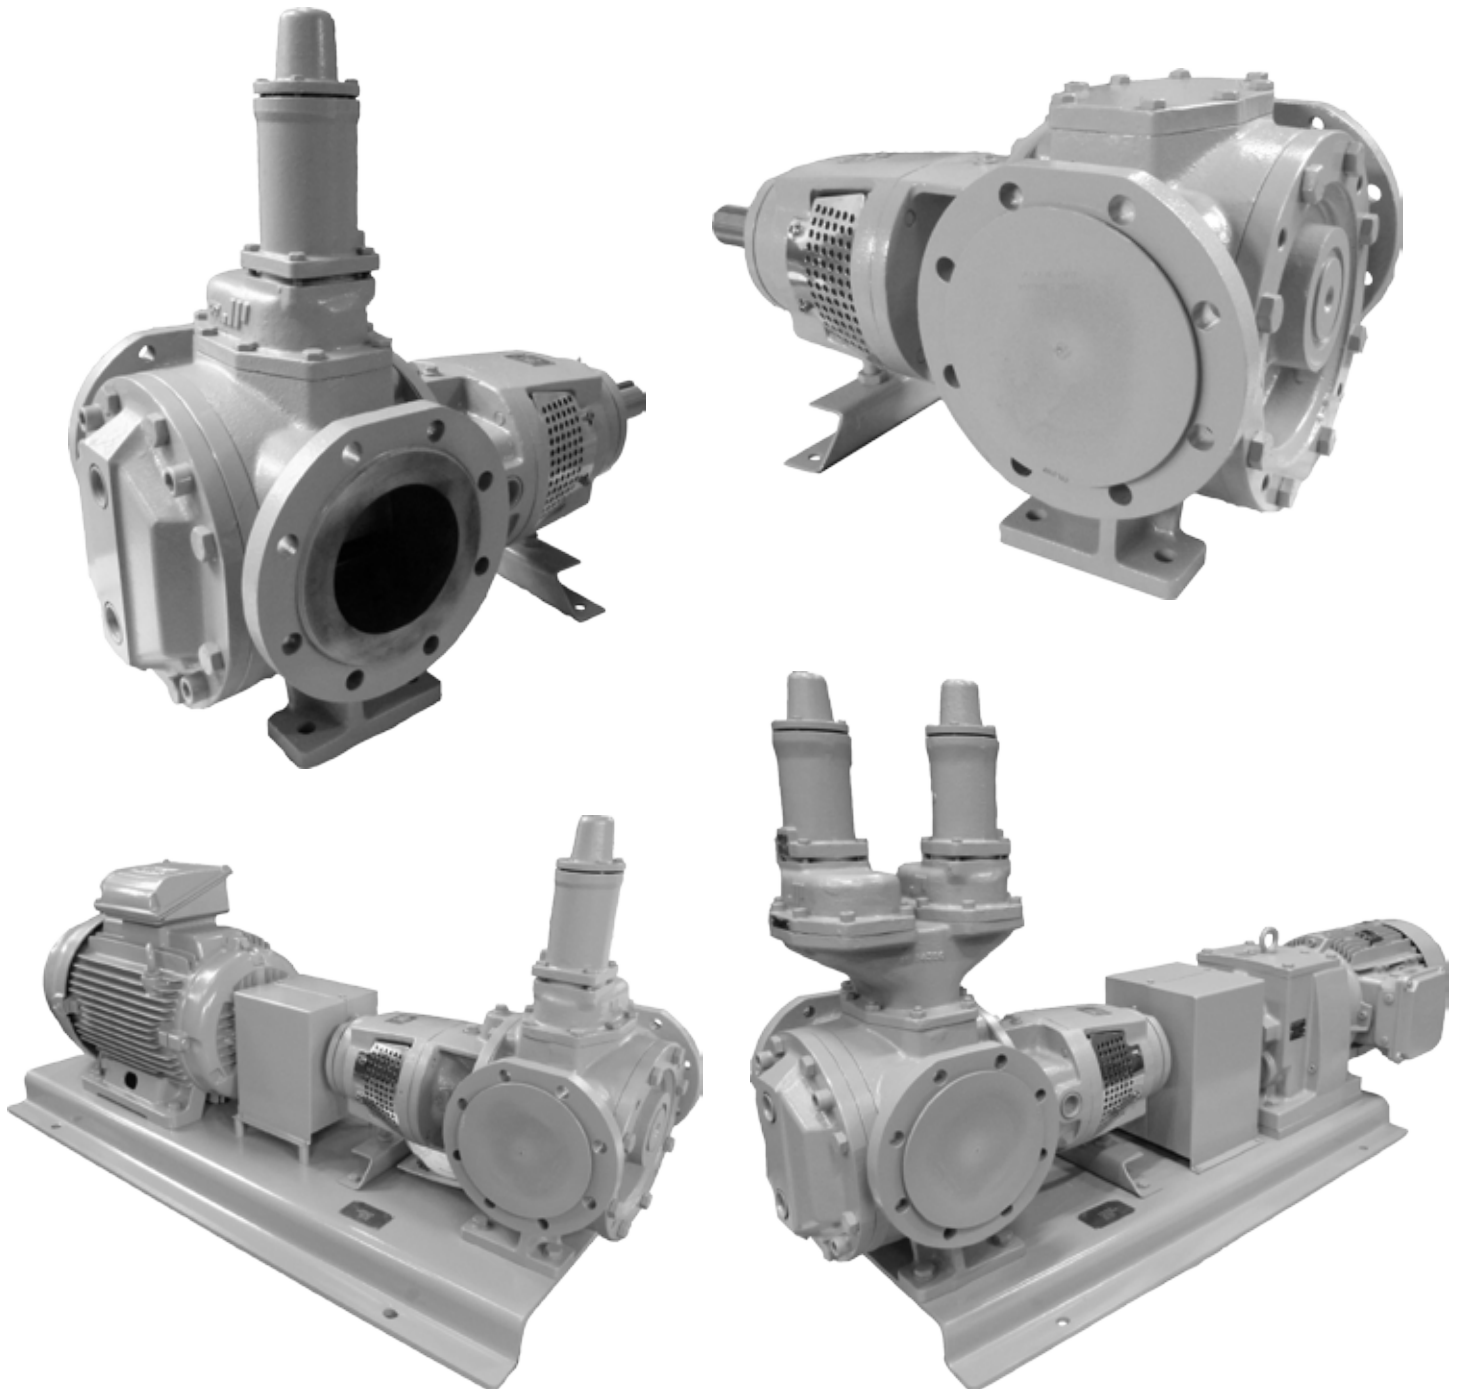

# EC-Declaration of conformity

Machinery Directive 2006/42/EC, Annex IIA

## **Manufacturer**

SPX Flow Technology Belgium NV  
Evenbroekveld 2-6  
BE-9420 Erpe-Mere  
Belgium

Herewith we declare that

## **TopGear GP-range Gear Pumps**

Types: TG GP2-25  
TG GP3-32  
TG GP6-40  
TG GP15-50  
TG GP23-65  
TG GP58-80  
TG GP86-100  
TG GP120-100  
TG GP185-125  
TG GP360-150


whether delivered without drive or delivered as an assembly with drive,  
are in conformity with the relevant provisions of the Machinery Directive  
2006/42/EC, Annex I.

## **Manufacturer Declaration**

Machinery Directive 2006/42/EC, Annex IIB

The partly completed pump (Back-Pull-Out unit), member of the product family TopGear GP-range gear pumps, is meant to be incorporated into the specified pump (unit) and may only be put into use after the complete machine, of which the pump under consideration forms part, has been declared to comply with the provisions of the Directive.

Erpe-Mere, 01 April 2014

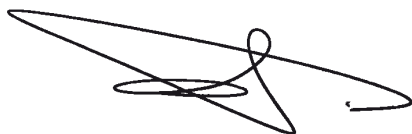

Gerard Santema  
General Manager

# Contents

1.0	Introduction	7
1.1	General	7
1.2	Reception, handling and storage	7
1.2.1	Reception	7
1.2.2	Handling	7
1.2.3	Storage	7
1.3	Safety	8
1.3.1	General	8
1.3.2	Pump units	9
1.3.2.1	Pump unit handling	9
1.3.2.2	Installation	9
1.3.2.3	Before commissioning the pump unit	10
1.3.2.4	Disassembly/assembly of the coupling guard	10
1.3.2.5	Name plate – CE Declaration of Conformity	10
1.4	Technical conventions	11
2.0	Pump description	12
2.1	Type designation	12
3.0	General technical information	15
3.1	Pump standard parts	15
3.2	Operating principle	15
3.2.1	Self-priming operation	16
3.2.2	Safety relief valve – Working principle	16
3.3	Sound	16
3.4	General performance	16
3.5	Main characteristics	17
3.6	Pressure	18
3.7	Sound level	18
3.7.1	Sound level of a pump without drive	18
3.7.2	The sound level of the pump unit	19
3.7.3	Influences	19
3.8	Material options	20
3.9	Jacket options	20
3.10	Electrical heating	20
3.11	Internals	20
3.11.1	Bush materials	20
3.11.2	Maximum temperature of internals	21
3.11.3	Operation under hydrodynamic lubrication conditions	21
3.11.4	Maximum torque of pump shaft and rotor material combination	22
3.12	Mass moment of inertia	22
3.13	Axial and radial clearances	22
3.14	Extra clearances	22
3.15	Play between gear teeth	23
3.16	Maximum size of solid particles	23

3.17 Shaft sealing	24
3.17.1 Packed gland (no lantern ring)	24
3.17.2 Packing ring materials	24
3.18 Safety relief valve	25
3.18.1 Pressure	26
3.18.2 Heating	26
3.18.3 Safety relief valve – Relative adjustment	26
3.18.4 Sectional drawings and part lists	28
3.18.4.1 Single safety relief valve	28
3.18.4.2 Heated spring casing	29
3.18.4.3 Double safety relief valve	29
3.19 Installation	30
3.19.1 General	30
3.19.2 Location	30
3.19.2.1 Short suction line	30
3.19.2.2 Accessibility	30
3.19.2.3 Outdoor installation	30
3.19.2.4 Indoor installation	31
3.19.2.5 Stability	31
3.19.3 Drives	31
3.19.3.1 Starting torque	31
3.19.3.2 Radial load on shaft end	32
3.19.4 Shaft rotation for pump without safety relief valve	32
3.19.5 Shaft rotation for pump with safety relief valve	33
3.19.6 Suction and discharge pipes	34
3.19.6.1 Forces and moments	34
3.19.6.2 Piping	34
3.19.6.3 Isolating valves	35
3.19.6.4 Strainer	35
3.19.7 Secondary piping	35
3.19.7.1 Drain lines	35
3.19.7.2 Heating jackets	36
3.19.8 Guidelines for assembly	37
3.19.8.1 Transport of pump unit	37
3.19.8.2 Foundation pump unit	37
3.19.8.3 Variators, Gear box, Gear motors, Motors	37
3.19.8.4 Electric motor drive	37
3.19.8.5 Combustion engines	38
3.19.8.6 Shaft coupling	38
3.19.8.7 Guarding of moving parts	39
3.19.8.8 Electrical heating	39
3.20 Instructions for start-up	40
3.20.1 General	40
3.20.2 Cleaning the pump	40
3.20.2.1 Cleaning suction line	40
3.20.3 Venting and filling	40
3.20.4 Checklist – Initial start-up	41
3.20.5 Start-up	42
3.20.6 Shut-down	42
3.20.7 Abnormal operation	42

3.21	Trouble shooting	43
3.21.1	Instructions for re-using and disposal	45
3.21.1.1	Re-use	45
3.21.1.2	Disposal	45
3.22	Maintenance instructions	46
3.22.1	General	46
3.22.2	Preparation	46
3.22.2.1	Surroundings (on site)	46
3.22.2.2	Tools	46
3.22.2.3	Shut-down	46
3.22.2.4	Motor safety	46
3.22.2.5	Conservation	46
3.22.2.6	External cleaning	47
3.22.2.7	Electrical installation	47
3.22.2.8	Draining of fluid	47
3.22.2.9	Fluid circuits	47
3.22.2.10	Electrical heating	47
3.22.3	Specific components	48
3.22.3.1	Nuts and bolts	48
3.22.3.2	Plastic or rubber components	48
3.22.3.3	Flat gaskets	48
3.22.3.4	Filter or suction strainer	48
3.22.3.5	Anti-friction bearings	48
3.22.3.6	Sleeve bearings	49
3.22.3.7	Shaft seal	50
3.22.4	Front pull-out	51
3.22.5	Back pull-out	51
3.22.6	Clearance adjustment	51
3.22.7	Designation of threaded connections.	52
3.22.7.1	Threaded connection Rp (example Rp 1/2)	52
3.22.7.2	Threaded connection G (example G 1/2)	52
4.0	Instructions for assembly and disassembly	53
4.1	General	53
4.2	Tools	53
4.3	Preparation	53
4.4	After disassembly	53
4.5	Anti-friction bearings	54
4.5.1	General	54
4.5.2	TG GP2-25, TG GP3-32 and TG GP6-40 disassembly	54
4.5.3	TG GP2-25, TG GP3-32 and TG GP6-40 assembly	54
4.5.4	TG GP15-50 to TG GP360-150 disassembly	55
4.5.5	TG GP15-50 to TG GP360-150 assembly	55
4.6	Relief valve	56
4.6.1	Disassembly	56
4.6.2	Assembly	56

4.7	Electrical heating	57
4.7.1	General	57
4.7.2	Electrical heating on the pump cover (in the idler pin)	57
4.7.2.1	Disassembly	57
4.7.2.2	Assembly	57
4.7.3	Electrical heating around shaft seal (in the intermediate casing)	58
4.7.3.1	Disassembly	58
4.7.3.2	Assembly	58
5.0	Sectional drawings and part lists	59
5.1	TG GP2-25 to TG GP6-40	59
5.1.1	Hydraulic part	60
5.1.2	Bearing bracket	60
5.1.3	Flange connection options	60
5.1.4	Jacket options	61
5.1.4.1	Jacket option on pump cover	61
5.1.4.2	Jacket option around shaft seal	61
5.1.5	Seal option: Packing rings PO	62
5.2	TG GP15-50 to TG GP360-150	63
5.2.1	Hydraulic part	64
5.2.2	Bearing bracket	64
5.2.3	Jacket options and electrical heating	65
5.2.3.1	Jacket on pump cover	65
5.2.3.2	Jacket around the shaft seal	65
5.2.3.3	Electrical heating on the pump cover (in the idler pin)	66
5.2.3.4	Electrical heating around shaft seal (in the intermediate casing)	67
5.2.4	Seal options: Packing rings PO	68
6.0	Dimensional drawings	69
6.1	Standard pump	69
6.1.1	TG GP2-25 to TG GP6-40	69
6.1.2	TG GP15-50 to TG GP360-150	70
6.2	Flange connections	71
6.2.1	TG GP2-25 to TG GP6-40	71
6.2.2	TG GP15-50 to TG GP360-150	71
6.3	Jackets – Electrical heating	72
6.3.1	Jackets TG GP2-25 to TG GP6-40	72
6.3.2	Jackets TG GP15-50 to TG GP360-150	73
6.3.3	Electrical heating	74
6.4	Safety relief valves	75
6.4.1	Single safety relief valve	75
6.4.2	Double safety relief valve	75
6.4.3	Heated safety relief valve	76
6.5	Bracket support	77
6.6	Weights – Mass	77

# 1.0 Introduction

## 1.1 General

This instruction manual contains necessary information on the TopGear pumps and must be read carefully before installation, service and maintenance. The manual must be kept easily accessible to the operator.

### **Important!**

The pump must not be used for other purposes than recommended and quoted for without consulting your local supplier.



Liquids not suitable for the pump can cause damages to the pump unit, with a risk of personal injury.



## 1.2 Reception, handling and storage

### 1.2.1 Reception

Remove all packing materials immediately after delivery. Check the consignment for damage immediately on arrival and make sure that the name plate/type designation is in accordance with the packing slip and your order.


In case of damage and/or missing parts, a report should be drawn up and presented to the carrier at once. Notify your local supplier.

All pumps have the serial number stamped on a name plate. This number should be stated in all correspondence with your local supplier. The first digits of the serial number indicate the year of production.


<b>TopGear</b> 	
Model: TG	_____
Serial No:	_____
 <small>SPX Flow Technology Belgium NV Evenbroekveld 2-6, BE-9420 Erpe-Mere</small> <b>Johnson Pump</b> <small>www.johnson-pump.com / www.spx.com</small>	

### 1.2.2 Handling

Check the mass (weight) of the pump unit. All parts weighing more than 20 kg must be lifted using lifting slings and suitable lifting devices, e.g. overhead crane or industrial truck. See section 6.6 Weights – Mass.



*Always use two or more lifting slings. Make sure they are secured in such a way as to prevent them from slipping. The pump unit should be in a straight fashion.*

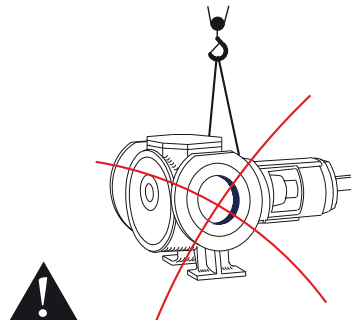

*Never lift the pump unit with only two fastening points. Incorrect lift can cause personal injury and/or damage to the pump unit.*

### 1.2.3 Storage

If the pump is not commissioned immediately, the shaft should be turned a full turn once every week. This ensures a proper distribution of the conserving oil.

## 1.3 Safety

### 1.3.1 General

#### **Important!**

The pump must not be used for other purposes than recommended and quoted for without consulting your local supplier.

A pump must always be installed and used in accordance with existing national and local sanitary and safety regulations and laws.

When ATEX pump/pump unit is supplied, the separate ATEX manual must be considered



- Always wear suitable safety clothing when handling the pump.



- Anchor the pump properly before start-up to avoid personal injury and/or damage to the pump unit.



- Install shut-off valves on both sides of the pump to be able to shut off the inlet and outlet before service and maintenance. Check to see that the pump can be drained without injuring anyone and without contaminating the environment or nearby equipment.



- Make sure that all movable parts are properly covered to avoid personal injury.

- All electrical installation work must be carried out by authorized personnel in accordance with EN60204-1 and/or local regulations. Install a lockable circuit breaker to avoid inadvertent starting. Protect the motor and other electrical equipment from overloads with suitable equipment. The electric motors must be supplied with ample cooling air.

In environments where there is risk of explosion, motors classified as explosion-safe must be used, along with special safety devices. Check with the governmental agency responsible for such precautions.



- Improper installation can cause fatal injuries.

- Dust, liquids and gases that can cause overheating, short circuits, corrosion damage and fire must be kept away from motors and other exposed equipment.



- If the pump handles liquids hazardous for person or environment, some sort of container must be installed into which leakage can be led. All (possible) leakage should be collected to avoid contamination of the environment.

- Keep arrows and other signs visible on the pump.



- If the surface temperature of the system or parts of the system exceeds 60°C, these areas must be marked with warning text reading "Hot surface" to avoid burns.



- The pump unit must not be exposed to rapid temperature changes of the liquid without prior pre-heating/pre-cooling. Big temperature changes can cause crack formation or explosion, which in turn can entail severe personal injuries.

- The pump must not operate above stated performance. See section 3.5 Main characteristics.

- Before intervening in the pump/system, the power must be shut off and the starting device be locked. When intervening in the pump unit, follow the instructions for disassembly/assembly, chapter 4.0. If the instructions are not followed, the pump or parts of the pump can be damaged. It will also invalidate the warranty.

- Gear pumps may never run completely dry. Dry running produces heat and can cause damage to internal parts such as bush bearings and shaft seal. When dry running is required, the pump has e.g. to be run a short time with liquid supply.

**Note!** A small quantity of liquid should remain in the pump to ensure lubrication of internal parts. If there is a risk for dry running for a longer period, install a suitable dry running protection. Consult your local supplier.


- If the pump does not function satisfactorily, contact your local supplier.




## 1.3.2 Pump units

### 1.3.2.1 Pump unit handling


Use an overhead crane, forklift or other suitable lifting device.

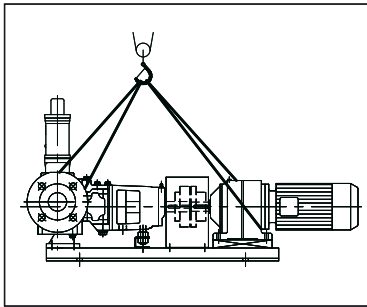

Secure lifting slings around the front part of the pump and the back part of the motor. Make sure that the load is balanced before attempting the lift.  
**NB!** Always use two lifting slings.

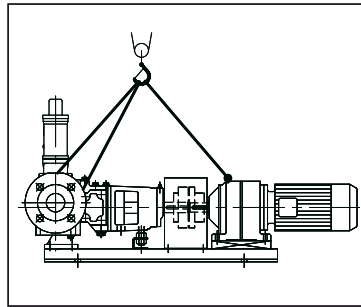

If there are lifting rings on both the pump and the motor the slings may be fastened to these.  
**NB!** Always use two lifting slings.

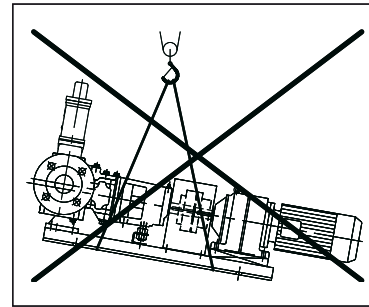

**Warning**  
Never lift the pump unit with only one fastening point. Incorrect lifts can result in personal injury and/or damage to the unit.

### 1.3.2.2 Installation

All pump units should be equipped with a locking safety switch to prevent accidental start during installation, maintenance or other work on the unit.



#### **Warning**

The safety switch must be turned to off and locked before any work is carried out on the pump unit. Accidental start can cause serious personal injury.

The pump unit must be mounted on a level surface and either be bolted to the foundation or be fitted with rubber-clad feet.

The pipe connections to the pump must be stress-free mounted, securely fastened to the pump and well supported. Incorrectly fitted pipe can damage the pump and the system.



#### **Warning**

Electric motors must be installed by authorized personnel in accordance with EN60204-1. Faulty electrical installation can cause the pump unit and system to be electrified, which can lead to fatal injuries.

Electric motors must be supplied with adequate cooling ventilation. Electric motors must not be enclosed in airtight cabinets, hoods etc.

Dust, liquids and gases which can cause overheating and fire must be diverted away from the motor.



#### **Warning**

Pump units to be installed in potentially explosive environments must be fitted with an Ex-class (explosion safe) motor. Sparks caused by static electricity can give shocks and ignite explosions. Make sure that the pump and system are properly grounded. Check with the proper authorities for the existing regulations. A faulty installation can lead to fatal injuries.

### 1.3.2.3 Before commissioning the pump unit

Read the pump's operating and safety manual. Make sure that the installation has been correctly carried out according to the relevant pump's manual.

Check the alignment of the pump and motor shafts. The alignment may have been altered during transport, lifting and mounting of the pump unit. For safe disassembly of the coupling guard see below: Disassembly/assembly of the coupling guard.



#### **Warning**

The pump unit must not be used with other liquids than those for which it was recommended and sold. If there are any uncertainties contact your sales representative. Liquids, for which the pump is not appropriate, can damage the pump and other parts of the unit as well as cause personal injury.

### 1.3.2.4 Disassembly/assembly of the coupling guard

The coupling guard is a fixed guard to protect the users and operator from fastening and injuring themselves on the rotating shaft/shaft coupling. The pump unit is supplied with factory mounted guards with certified maximum gaps in accordance with standard DIN EN ISO 13857.



#### **Warning**

The coupling guard must never be removed during operation. The locking safety switch must be turned to off and locked. The coupling guard must always be reassembled after it has been removed. Make sure to also reassemble any extra protective covers. There is a risk of personal injury if the coupling guard is incorrectly mounted.

- a) Turn off and lock the power switch.
- b) Disassemble the coupling guard.
- c) Complete the work.
- d) Reassemble the coupling guard and any other protective covers. Make sure that the screws are properly tightened.

### 1.3.2.5 Name plate – CE Declaration of Conformity

Always quote the serial number on the name plate together with questions concerning the pump unit, installation, maintenance etc.

When changing the operating conditions of the pump please contact your supplier to ensure a safe and reliable working pump.

This also applies to modifications on a larger scale, such as a change of motor or pump on an existing pump unit.

	SPX Flow Technology Belgium NV Evenbroekveld 2-6 BE-9420 Erpe-Mere <a href="http://www.johnson-pump.com">www.johnson-pump.com</a> / <a href="http://www.spx.com">www.spx.com</a>	
	<hr/>	
<b>Pump type:</b>		
<b>Article No.:</b>		
<b>Unit serial No.:</b>		
<b>Date:</b>		

## 1.4 Technical conventions

Quantity	Symbol	Unit
Dynamic viscosity	$\mu$	mPa.s = cP (Centipoise)
Kinematic viscosity	$v = \frac{\mu}{\rho}$	$\rho = \text{density} \left[ \frac{\text{kg}}{\text{dm}^3} \right]$ $v = \text{kinematic viscosity} \left[ \frac{\text{mm}^2}{\text{s}} \right] = \text{cSt (Centistokes)}$
<b>Note!</b> In this manual only dynamic viscosity is used.		
Pressure	$p$	[bar]
	$\Delta p$	Differential pressure = [bar]
	$p_m$	Maximum pressure at discharge flange (design pressure) = [bar]
<b>Note!</b> In this manual, unless otherwise specified - pressure is relative pressure [bar].		
Net Positive Suction Head	NPSHa	Net Positive Suction Head is the total absolute inlet pressure at the pump suction connection, minus the vapour pressure of the pumped liquid. NPSHa is expressed in meter liquid column. It is the responsibility of the user to determine the NPSHa value.
	NPSHr	Net Positive Suction Head Required is the NPSH determined, after testing and calculation, by the pump manufacturer to avoid performance impairment due to cavitation within the pump at rate capacity. The NPSHr is measured at the suction flange, at the point where the capacity drop results in a pressure loss of at least 4%.
<b>Note!</b> In this manual, unless otherwise specified, $NPSH = NPSHr$		
<b>When selecting a pump, ensure that NPSHa is at least 1 m higher than the NPSHr.</b>		

## 2.0 Pump description

TopGear/GP pumps are rotary positive displacement pumps with internal gear. They are made of cast iron. TG GP pumps: heating/cooling jackets (steam), several sleeve bearings, gear and shaft materials and mounted relief valve and electrical heating.

### 2.1 Type designation

The pump properties are encoded in the following type indication, which is to be found on the name plate.

#### Examples:

TG	GP	58-80		G	2	S	S	SG	2	B	G2	TC
1	2	3	4	5	6	7	8	9	10	11	12	13

TG	GP	15-50	FD	G	3	O	S	UG	6	U	G6	AW
1	2	3	4	5	6	7	8	9	10	11	12	13

#### 1. Pump family name

TG = TopGear

#### 2. Pump range name

G = General purpose

P = Simplest soft packing version

#### 3. Hydraulics indicated with displacement volume per 100 revolution (in dm<sup>3</sup>) and nominal port diameter (in mm)

TG GP2-25

TG GP3-32

TG GP6-40

TG GP15-50

TG GP23-65

TG GP58-80

TG GP86-100

TG GP120-100

TG GP185-125

TG GP360-150

#### 4. Application

Non-food

FD Food

#### 5. Pump material

G Pump in cast iron

#### 6. Port connection type

1 Thread connections

2 PN16 flanges to DIN2533

3 PN20 flanges to ANSI 150 lbs

## Examples:

TG GP 58-80 G 2 S S SG 2 B G2 TC  
1 2 3 4 5 6 7 8 9 10 11 12 13

TG GP 15-50 FD G 3 O S UG 6 U G6 AW  
1 2 3 4 5 6 7 8 9 10 11 12 13

### 7. Jacket options for pump cover

- O Pump cover without jackets
- S Pump cover with jacket and thread connection
- E1 Electrical heating idler pin – loss factor 15 W/°C/m<sup>2</sup> (indoor installation) – 110V
- E2 Electrical heating idler pin – loss factor 15 W/°C/m<sup>2</sup> (indoor installation) – 230V
- E3 Electrical heating idler pin – loss factor 20 W/°C/m<sup>2</sup> (outside but protected) – 110V
- E4 Electrical heating idler pin – loss factor 20 W/°C/m<sup>2</sup> (outside but protected) – 230V
- E5 Electrical heating idler pin – loss factor 25 W/°C/m<sup>2</sup> (outside unprotected) – 110V
- E6 Electrical heating idler pin – loss factor 25 W/°C/m<sup>2</sup> (outside unprotected) – 230V

### 8. Jacket options around shaft seal

- O Shaft seal without jackets
- S Shaft seal with jacket and thread connection
- E1 Electrical heating interm. casing – loss factor 15 W/°C/m<sup>2</sup> (indoor installation) – 110V
- E2 Electrical heating interm. casing – loss factor 15 W/°C/m<sup>2</sup> (indoor installation) – 230V
- E3 Electrical heating interm. casing – loss factor 20 W/°C/m<sup>2</sup> (outside but protected) – 110V
- E4 Electrical heating interm. casing – loss factor 20 W/°C/m<sup>2</sup> (outside but protected) – 230V
- E5 Electrical heating interm. casing – loss factor 25 W/°C/m<sup>2</sup> (outside unprotected) – 110V
- E6 Electrical heating interm. casing – loss factor 25 W/°C/m<sup>2</sup> (outside unprotected) – 230V

### 9. Idler bush and idler materials

- SG Idler bush in hardened steel with idler in iron
- CG Idler bush in carbon with idler in iron
- BG Idler bush in bronze with idler in iron
- HG Idler bush in ceramic with idler in iron
  
- SS Idler bush in hardened steel with idler in steel
- CS Idler bush in carbon with idler in steel
- BS Idler bush in bronze with idler in steel
- HS Idler bush in ceramic with idler in steel
- US Idler bush in hard metal with idler in steel
  
- BR Idler bush in bronze with idler in stainless steel
- CR Idler bush in carbon with idler in stainless steel
- HR Idler bush in ceramic with idler in stainless steel
- UR Idler bush in hard metal with idler in stainless steel

### 10. Idler pin materials

- 2 Idler pin in hardened steel
- 5 Idler pin in nitrided stainless steel
- 6 Idler pin in hard coated stainless steel

**Examples:**

TG GP 58-80 G 2 S S SG 2 B G2 TC  
1 2 3 4 5 6 7 8 9 10 11 12 13

TG GP 15-50 FD G 3 O S UG 6 U G6 AW  
1 2 3 4 5 6 7 8 9 10 11 12 13

**11. Bush on shaft materials**

S Bush in hardened steel  
C Bush in carbon  
H Bush in ceramic  
U Bush in hard metal  
B Bush in bronze

**12. Rotor and shaft materials**


G2 Rotor in iron and shaft in hardened steel  
G5 Rotor in iron and shaft in nitrited stainless steel  
G6 Rotor in iron and shaft in hard coated stainless steel  
  
N2 Rotor in nitrited nodular iron and shaft in hardened steel  
N5 Rotor in nitrited nodular iron and shaft in nitrited stainless steel  
N6 Rotor in nitrited nodular iron and shaft in hard coated stainless steel  
  
R2 Rotor in stainless steel and shaft in hardened steel  
R5 Rotor in stainless steel and shaft in nitrited stainless steel  
R6 Rotor in stainless steel and shaft in hard coated stainless steel

**13. Shaft seal arrangement**


TC Packing rings PTFE graphite  
AW Packing rings Aramide – white  
CC Packing rings graphite fibre  
XX Packing rings without packing rings – on request

## 3.0 General technical information

### 3.1 Pump standard parts

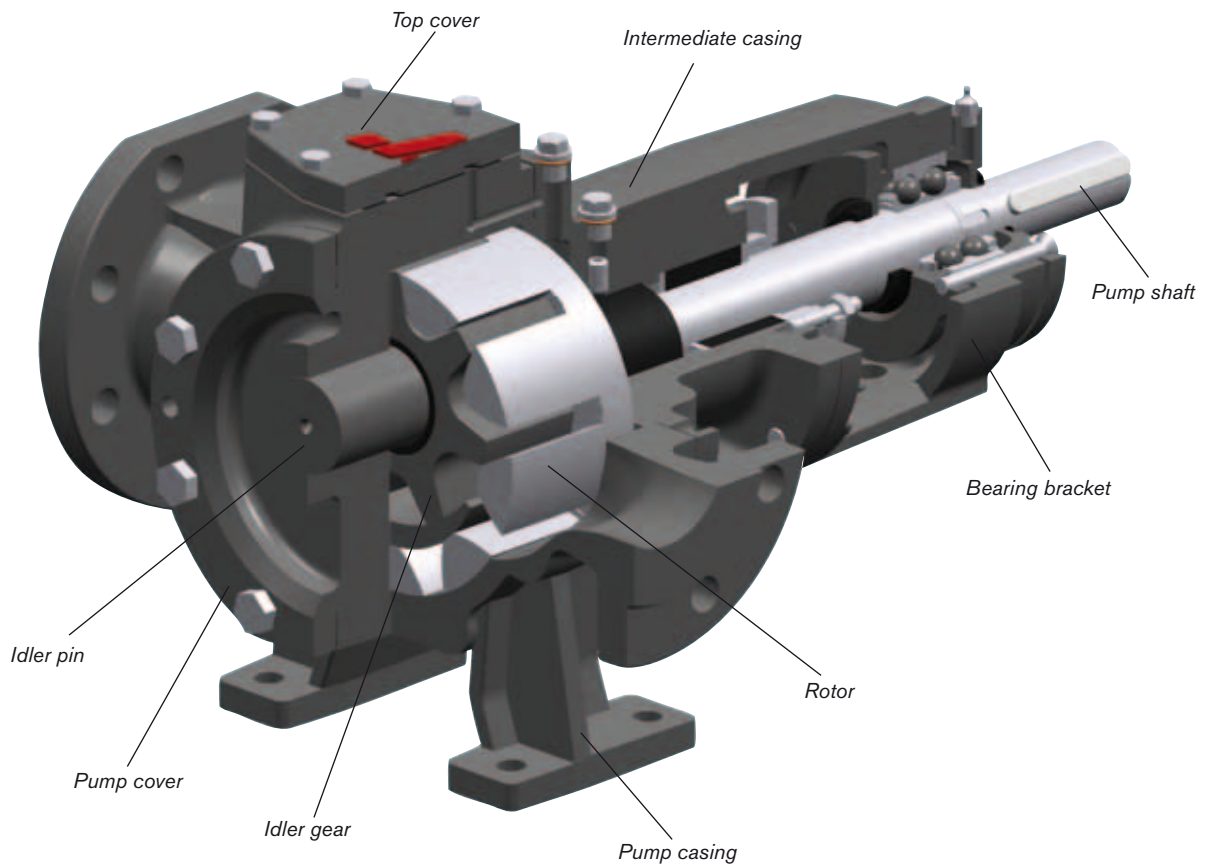


### 3.2 Operating principle



As the rotor and idler gear unmesh, an underpressure is created and the liquid enters the new created cavities.



Liquid is transported in sealed pockets to the discharge side. The walls of the pump casing and the crescent are creating a seal and separate suction from discharge side.



The rotor and idler gear mesh and liquid is being pushed into the discharge line.

Reversing the shaft rotation will reverse the flow through the pump as well.

### 3.2.1 Self-priming operation


TopGear pumps are self-priming when sufficient liquid is present in the pump to fill up the clearances and the dead spaces between the teeth. (For self-priming operation see also section 3.19.6.2 Piping).

### 3.2.2 Safety relief valve – Working principle

The positive displacement principle requires the installation of a safety relief valve protecting the pump against overpressure. It can be installed on the pump or in the installation.

This safety relief valve limits the differential pressure ( $\Delta p$ ) between suction and discharge, not the maximum pressure within the installation.

For example, as media cannot escape when the discharge side of the pump is obstructed, an over-pressure may cause severe damage to the pump. The safety relief valve provides an escape path, rerouting the media back to the suction side when reaching a specified pressure level.

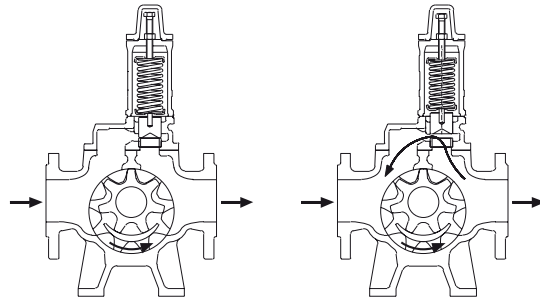

- The safety relief valve protects the pump against over-pressure only in one flow direction. The safety relief valve will **not** provide protection against over-pressure when the pump rotates in the opposite direction. When the pump is used in both directions, a double safety relief valve is required.
- An open safety relief valve indicates that the installation is not functioning properly. The pump must be shut down at once. Find and solve the problem before restarting the pump.
- When the safety relief valve is not installed on the pump, other protections against over-pressure have to be provided.
- **Note!** Do not use the safety relief valve as a flow regulator. The liquid will circulate only through the pump and will heat up quickly.

*Contact your local supplier if a flow regulator is required.*

## 3.3 Sound

TopGear pumps are rotary displacement pumps. Because of the contact between internal parts (rotor/idler), pressure variations etc. they produce more noise than for example centrifugal pumps. Also the sound coming from drive and installation must be taken into consideration. As the sound level at the operating area may exceed 85 dB(A), ear protection must be worn. See also section 3.7 Sound level.

## 3.4 General performance

### **Important!**

The pump is calculated for the liquid transport as described in the quotation. Contact your local supplier if one or several application parameters change.

Liquids not suitable for the pump can cause damages to the pump unit and imply risk of personal injury.

Correct application requires that consideration be given to all of the following:

Product name, concentration and density. Product viscosity, product particles (size, hardness, concentration, shape), product purity, product temperature, inlet and outlet pressure, RPM, etc.



## 3.5 Main characteristics

The pump size is designated by the displacement volume of 100 revolutions expressed in litres (or dm<sup>3</sup>) but rounded followed by the nominal port diameter expressed in millimetres.

TG GP pump size	d (mm)	B (mm)	D (mm)	Vs-100 (dm <sup>3</sup> )	n.max (min <sup>-1</sup> )	n.mot (min <sup>-1</sup> )	Q.th (l/s)	Q.th (m <sup>3</sup> /h)	v.u (m/s)	v.i (m/s)	Δp (bar)	p.test (bar)
2-25	25	13.5	65	1.83	1800		0.5	2.0	6.1	0.7	16	24
						1450	0.4	1.6	4.9	0.5		
3-32	32	22	65	2.99	1800		0.9	3.2	6.1	1.1	16	24
						1450	0.7	2.6	4.9	0.9		
6-40	40	28	80	5.8	1800		1.7	6.3	7.5	1.4	16	24
						1450	1.4	5.0	6.1	1.1		
15-50	50	40	100	14.5	1500		3.6	13.1	7.9	1.8	16	24
						1450	3.5	12.6	7.6	1.8		
23-65	65	47	115	22.7	1500		5.7	20.4	9.0	1.7	16	24
						1450	5.5	19.7	8.7	1.7		
58-80	80	60	160	57.6	1050		10.1	36.3	8.8	2.0	16	24
						960	9.2	33.2	8.0	1.8		
86-100	100	75	175	85.8	960	960	13.7	49.4	8.8	1.7	16	24
120-100	100	90	190	120	750		15.0	54.0	7.5	1.9	16	24
					900		18.0	65.0	9.0	2.3		
						725	14.5	52.2	7.2	1.8		
185-125	125	100	224	185	750		23	83	8.8	1.9	16	24
						725	22	80	8.5	1.8		
360-150	150	125	280	360	600		36	130	8.8	2.0	16	24

### Legend

- d : port diameter (inlet and outlet port)
- B : width of idler gear and length of rotor teeth
- D : peripheral diameter of rotor (outside diameter)
- Vs-100 : displaced volume pro 100 revolutions
- n.max : maximum allowable shaft speed in rpm
- n.mot : normal speed of direct drive electric motor (at 50Hz frequency)
- Q.th : theoretical capacity without slip at differential pressure = 0 bar
- v.u : peripheral velocity of rotor
- v.i : velocity of liquid in the ports at Qth (inlet and outlet port)
- Δp : maximum working pressure = differential pressure
- p.test : hydrostatic test pressure

### Maximum viscosity


Shaft sealing type	Maximum viscosity (mPa.s)
Packed gland PO	80 000

## 3.6 Pressure

**Differential pressure or working pressure** ( $p$ ) is the pressure on which the pump normally operates. TopGear GP-line has the maximum differential pressure at 16 bar.

The **hydrostatic test pressure** is 1.5 times the differential pressure i.e.:  
TopGear GP-line has the hydrostatic test pressure at 24 bar.

Following figure gives a graphical presentation of the several kind of pressures.

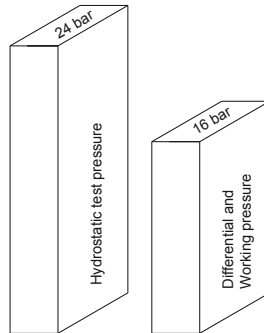

## 3.7 Sound level

### 3.7.1 Sound level of a pump without drive

#### **Sound pressure level ( $L_{pA}$ )**

The following table gives an overview of the A-weighted sound pressure level,  $L_{pA}$ , emitted by a pump without drive, measured according to ISO3744 and expressed in decibels dB(A). The reference sound pressure is  $20\mu\text{Pa}$ .

The values depend on the position from where one measures and were therefore measured at the front of the pump, at distance of 1 meter from the pump cover and were corrected for background noise and reflections.

The values listed are the highest measured values under following operating conditions.

- Working pressure: up to 10 bar.
- Pumped medium: water, viscosity = 1 mPa.s
- $-\% n_{\max} = - \% \text{ maximum shaft speed}$

TG GP pump size	$n_{\max}$ (min-1)	Lpa (dB(A))				Ls (dB(A))
		25% $n_{\max}$	50% $n_{\max}$	75% $n_{\max}$	100% $n_{\max}$	
2-25	1800	51	62	68	72	9
3-32	1800	53	65	72	76	9
6-40	1800	57	68	76	80	9
15-50	1500	61	72	79	83	9
23-65	1500	63	75	81	85	10
58-80	1050	67	79	85	89	10
86-100	960	69	80	86	90	11
120-100	750	70	81	87	91	11
185-125	750	71	82	87	91	11
360-150	600	72	83	89	92	11

### Sound power level ( $L_{WA}$ )

The sound power  $L_W$  is the power emitted by the pump as sound waves and is used to compare sound levels of machines. It is the sound pressure  $L_p$  that acts on a surrounding surface at distance of 1 meter.

$$L_{WA} = L_{pA} + L_s$$

The A-weighted sound power level  $L_{WA}$  is also expressed in decibels dB(A).

The reference sound power is 1 pW (=  $10^{-12}$  W).  $L_s$  is the logarithm of the surrounding surface at distance of 1 metre from the pump, expressed in dB(A) and is listed in the last column of above table.

### 3.7.2 The sound level of the pump unit

The sound level of the drive (motor, transmission, . . .) must be added to the sound level of the pump itself to determine the total sound level of the pump unit. The sum of several sound levels must be calculated logarithmically.

For a quick determination of the total sound level the following table can be used:

$L_1 - L_2$	0	1	2	3	4	5	6
$L[f(L_1 - L_2)]$	3.0	2.5	2.0	1.7	1.4	1.2	1.0

$$L_{total} = L_1 + L_{corrected}$$

where  $L_{total}$  : the total sound level of the pump unit

$L_1$  : the highest sound level

$L_2$  : the lowest sound level

$L_{corrected}$  : term, depending on the difference between both sound levels

For more than two values this method can be repeated.

**Example:**

Drive unit	: $L_1 = 79$ dB(A)
Pump	: $L_2 = 75$ dB(A)
Correction	: $L_1 - L_2 = 4$ dB(A)
According to the table	: <b><math>L_{corrected} = 1.4</math> dB(A)</b>
	$L_{total} = 79 + 1.4 = 80.4$ dB(A)

### 3.7.3 Influences

The real sound level of the pump unit can for several reasons deviate from the values listed in the tables above.

- Noise production decreases when pumping high viscosity liquids due to better lubricating and damping properties. Moreover the resistance torque of the idler is increasing due to higher liquid friction which results in lower vibration amplitude.
- Noise production increases when pumping low viscosity liquids combined with low working pressure because the idler can move freely (lower charge, lower liquid friction) and the liquid does not damp much.
- Vibrations in piping, vibrating of the baseplate etc. will make the installation produce more noise.

## 3.8 Material options

### Maximum temperature

Overall temperature of **TopGear GP pumps** is 300°C but:

- Maximum temperature of size GP2-25, GP3-32 and GP6-40 is limited to 200°C due to ball bearing type 2RS.  
Minimum temperature is -20°C.
- Temperature limits must be considered depending on the used materials for bearing bushes and shaft sealing.

## 3.9 Jacket options

**S-jackets** are designed for use with saturated steam or with non-dangerous media. They are provided with cylindrical threaded connections according to ISO 228-1.

Maximum temperature: 200°C

Maximum pressure: 10 bar

Notice that the maximum pressure of 10 bar will be the limiting factor for use with saturated steam.

Saturated steam at 10 bar gives a temperature of 180°C.

Material: Cast iron GG25

## 3.10 Electrical heating

Electrical heating is especially designed for pumping bitumen, heating the pump up from ambient air temperature to approximately 250°C. It can be used with an electric supply of 110V or 230V.

In case of other applications and/or lower or higher temperatures, please contact your local supplier.

Electrical heating is available on the pumpcover (in the idler pin) and/or in the intermediate casing for the following sizes and environments, see table.

Availability of electrical heating in the TopGear GP-line (- : not available / + : available)						
TG GP pump size	Loss factor 25 W/°C/m <sup>2</sup> Outside unprotected		Loss factor 20 W/°C/m <sup>2</sup> Outside but protected from bad weather <sup>1)</sup>		Loss factor 15 W/°C/m <sup>2</sup> Indoor installation	
	Idler pin	Intermediate casing	Idler pin	Intermediate casing	Idler pin	Intermediate casing
15-50	-	-	-	-	+	-
23-65	-	-	-	-	+	-
58-80	+	+	+	+	+	+
86-100	+	+	+	+	+	+
120-100	+	+	+	+	+	+
185-125	+	+	+	+	+	+

<sup>1)</sup> meaning raining and wind can't have free play to the pump because of roof or shadowed by other equipment

## 3.11 Internals

### 3.11.1 Bush materials

#### Overview of bush materials and application field

Material Code	S	C	B	H	U
Material	Steel	Carbon	Bronze	Ceramic	Hard metal
Hydrodynamical lubrication	if yes to maximum working pressure = 16 bar				
	if no 6 bar (*) 10 bar (*) 6 bar (*) 6 bar (*) 10 bar (*)				
Corrosive resistance	Fair	Good	Fair	Excellent	Good
Abrasive resistance	Slight	None	None	Good	Good
Dry running allowed	No	Yes	Moderate	No	No
Sensitive to thermal choc	No	No	No	Yes dT < 90°C	No
Sensitive to blistering in oil	No	> 180°C	No	No	No
Oil aging	No	No	> 150°C	No	No
Food processing allowed	Yes	No (antimony)	No (lead)	No (traceability)	Yes

(\*) These are not absolute figures. Higher or lower values possible in function of the application, expected life time etc.

### 3.11.2 Maximum temperature of internals

For some material combinations the general temperature performances must be limited. The maximum allowable working temperature of internals depends on the combination of used materials and their thermal expansions and the interference fit to hold the bearing bush fixed.

- Some bushbearings have an extra locking screw. In this case the maximum allowable temperature is based on the most probable interference fit.
- In case the bearing bush has no locking screw because material and construction do not allow concentrated stress the maximum allowable temperature is based on the minimum interference fit.

#### Maximum temperature (°C) of idler bush bearing material and idler material combinations

TG GP pump size	Bush and Idler materials (°C)												
	Cast iron idler G				Steel idler S					Stainless steel idler R			
	SG*)	CG	BG	HG	SS*)	CS	BS	HS	US	BR	CR	HR	UR
2-25	200	200	200	200	-	-	-	-	-	200	200	200	200
3-32	200	200	200	200	-	-	-	-	-	200	200	200	200
6-40	300	280	240	240	300	250	300	200	240	300	250	200	240
15-50	300	280	240	240	300	250	300	200	240	300	250	200	240
23-65	300	300	250	240	300	280	300	200	240	300	280	200	240
58-80	300	300	250	240	300	280	300	200	240	300	280	200	240
86-100	300	300	250	280	300	280	300	240	240	300	280	240	240
120-100	300	300	250	280	300	280	300	240	240	300	280	240	240
185-125	300	300	250	300	300	280	300	260	240	300	280	260	240
360-150	300	300	250	300	300	280	300	260	240	300	280	260	240

\*) Remark: Hardness relief of steel bush (S) and hardened steel pin (2) above 260°C

#### Maximum temperature (°C) of rotor bush bearing

TG GP pump size	Bush on shaft materials (°C)				
	Casing G – Cast iron				
	S*)	C	H	U	B
2-25	200	200	200	-	200
3-32	200	200	200	-	200
6-40	300	300	300	-	300
15-50	300	300	300	-	300
23-65	300	300	300	-	300
58-80	300	300	300	240	300
86-100	300	300	300	240	300
120-100	300	300	300	240	300
185-125	300	300	300	240	300
360-150	300	300	300	240	300

\*) Remark: Hardness relief of steel bush (S) and hardened steel shaft (2) above 260°C

### 3.11.3 Operation under hydrodynamic lubrication conditions

Hydrodynamic lubrication could be important criteria for bush material selection.

If the bush bearings are running under the condition of hydrodynamic lubrication there is no more material contact between bush and pin or shaft and the lifetime cycle is increased importantly.

If there is no condition for hydrodynamic lubrication, the bush bearings make material contact with pin or shaft and the wear of these parts is to be considered.

The condition of hydrodynamic lubrication is fulfilled with the following equation:

$$\text{Viscosity} * \text{shaft speed/diff.pressure} \geq \text{K.hyd}$$

with: viscosity [mPa.s]

shaft speed [rpm]

diff.pressure [bar]

K.hyd = design constant for each pump size.

TG GP pump size	K.hyd
2-25	6000
3-32	7500
6-40	5500
15-50	6250
23-65	4000
58-80	3750
86-100	3600
120-100	2930
185-125	2500
360-150	2000

### 3.11.4 Maximum torque of pump shaft and rotor material combination

The maximum allowable torque is a constant independent from speed and may not be exceeded to avoid damaging the pump i.e. pump shaft, rotor/shaft fitting and rotor teeth.

TG GP pump size	Mn (nominal torque) in Nm			Md (starting torque in Nm)		
	G Rotor Iron	N Rotor Nitrided nodular iron	R Rotor Stainless steel	G Rotor Iron	N Rotor Nitrided nodular iron	R Rotor Stainless steel
2-25	21	–	31	29	–	43
3-32	21	–	31	29	–	43
6-40	67	67	67	94	94	94
15-50	255	255	255	360	360	360
23-65	255	255	255	360	360	360
58-80	390	390	390	550	550	550
86-100	600	600	600	840	840	840
120-100	600	600	600	840	840	840
185-125	1300	1300	1300	1820	1820	1820
360-150	2000	2000	2000	2800	2800	2800

The nominal torque (Mn) has to be checked for the normal working conditions and the installed nominal motor torque (Mn.motor) but converted to the pump shaft speed.

The starting torque (Md), may not be exceeded during start up. Use this value for the maximum torque set of a torque limiter if installed on the pump shaft

### 3.12 Mass moment of inertia

TG GP	2-25	3-32	6-40	15-50	23-65	58-80	86-100	120-100	185-125	360-150
J (10 <sup>-3</sup> x kgm <sup>2</sup> )	0.25	0.30	0.75	3.5	6.8	32	54	88	200	570

### 3.13 Axial and radial clearances


TG GP	2-25	3-32	6-40	15-50	23-65	58-80	86-100	120-100	185-125	360-150
Minimum (µm)	80	80	90	120	125	150	165	180	190	225
Maximum (µm)	134	134	160	200	215	250	275	300	320	375

### 3.14 Extra clearances

To indicate required clearances a code of 4 digits, xxxx, is given on the order. These digits refer to the following clearance classes:

- C0 = Axial clearance between rotor and pump cover set at minimum
- C1 = Standard clearance (not indicated because standard)
- C2 = ~2 x standard clearance
- C3 = 3 x standard clearance

The 4 digits indicate which clearance class is set for which part of the pump, e.g.: code 2 3 3 2

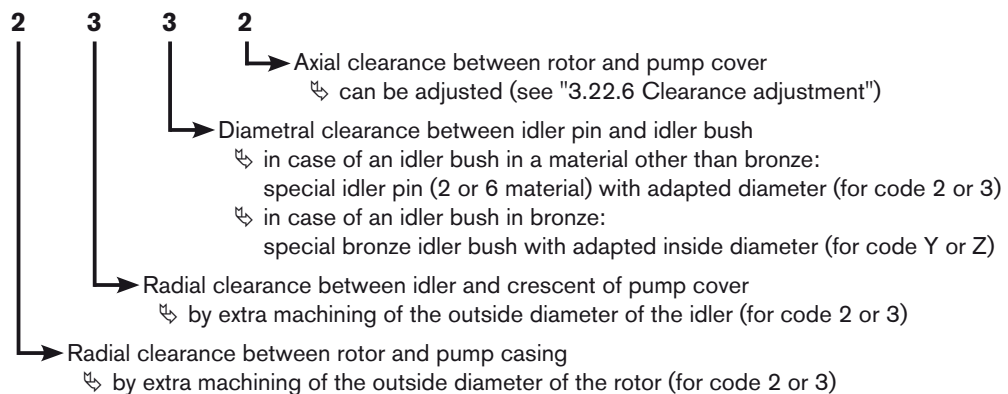

The code "1" always stands for "normal" and no special action is considered.

The indicated numbers in the tables below are average values in microns ( $\mu\text{m}$ ).

**Radial clearance on rotor, idler outside diameter – Axial clearance on pump cover**

Pump size	C0 ( $\mu\text{m}$ ) axial clearance pumpcover set minimum	C1 ( $\mu\text{m}$ ) normal	C2 ( $\mu\text{m}$ ) = 2.2 x C1	C3 ( $\mu\text{m}$ ) = 3 x C1
Code rotor	1xx	1xx	2xxx	3xxx
Code idler	x1xx	x1xx	x2xx	x3xx
Code pump cover assembly	xxx0	xxx1	xxx2	xxx3
TG GP2-25	35	107	235	320
TG GP3-32	35	107	235	320
TG GP6-40	40	125	275	375
TG GP15-50	52	160	350	480
TG GP23-65	56	170	375	510
TG GP58-80	66	200	440	600
TG GP86-100	72	220	480	660
TG GP120-100	79	240	530	720
TG GP185-125	85	255	560	765
TG GP360-150	100	300	660	900

**Diametral clearance on pin/idler bearing**

Pump size	C1 ( $\mu\text{m}$ ) normal	C2 ( $\mu\text{m}$ ) = 2 x C1	C3 ( $\mu\text{m}$ ) = 3 x C1
Code for adapted 2 or 6 material pin (2 or 3)	xx1x	xx2x	xx3x
Code for adapted bronze idler bush (Y or Z)	xx1x	xxYx	xxZx
TG GP2-25	90	180	270
TG GP3-32	90	180	270
TG GP6-40	110	220	330
TG GP15-50	150	300	450
TG GP23-65	160	320	480
TG GP58-80	240	480	720
TG GP86-100	275	550	825
TG GP120-100	300	600	900
TG GP185-125	325	650	975
TG GP360-150	400	800	1200




**Note!** the clearance between the idler pin and idler bush (3<sup>rd</sup> digit) should always be less or equal to the clearance on the idler (2<sup>nd</sup> digit). Otherwise there is a risk of contact between the idler and the crescent of the pump cover.

### 3.15 Play between gear teeth

TG GP	2-25	3-32	6-40	15-50	23-65	58-80	86-100	120-100	185-125	360-150
Minimum ( $\mu\text{m}$ )	320	320	320	360	400	400	400	420	440	440
Maximum ( $\mu\text{m}$ )	640	640	640	720	800	800	800	840	880	880

Play between gear teeth

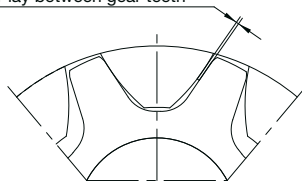

### 3.16 Maximum size of solid particles

TG GP	2-25	3-32	6-40	15-50	23-65	58-80	86-100	120-100	185-125	360-150
Size ( $\mu\text{m}$ )	80	80	90	120	125	150	165	180	190	225

## 3.17 Shaft sealing

### 3.17.1 Packed gland (no lantern ring)

TG GP pump size	2-25 3-32	6-40	15-50 23-65	58-80	86-100 120-100	185-125	360-150
Shaft diameter	17	20	30	40	45	55	65
Section width	6	8	8	10	10	10	10
Number of rings	5	4	5	5	5	5	5

*Dimensions in mm*

### 3.17.2 Packing ring materials

#### **TC**

Most universal solution.

Woven shaft packing consisting of PTFE yarns with incorporated graphite and sliding matters (yarns GORE-GFO). Extreme low coefficient of friction, good thermal conductivity, high suppleness and volume stability. Suitable for general applications.

Application temperature: -200°C to +280°C

Chemical resistance: pH 0 – 14

#### **AW**

Strong fibres.

Woven shaft packing consisting of white elastic synthetic aramide yarns with silicon free lubricating matter. Wear resistant without damaging the shaft, high section density and structure strength, good sliding properties. Used where a strong yarn is necessary e.g. sugar solutions, polymers, resins, bitumen, paper industry etc. Chosen as standard for food applications.

Application temperature: -50°C to +250°C

Chemical resistance: pH 1 – 13

#### **CC**

Graphite fibres; dry running; high temperature.

Woven shaft packing consisting of pure graphite fibres without impregnation. Low coefficient of friction and good dry running properties. Used as wear resistant packing at high temperature.

Application temperature: -60°C to +500°C

Chemical resistance: pH 0 – 14



## 3.18 Safety relief valve

### Example

V 35 - G 10 H  
1 2 3 4 5

#### 1. Safety relief valve = V

#### 2. Type indicating = inlet diameter (in mm)

- 18 Safety relief valve size for  
TG GP2-25, TG GP3-32, TG GP6-40
- 27 Safety relief valve size for  
TG GP15-50, TG GP23-65
- 35 Safety relief valve size for  
TG GP58-80
- 50 Safety relief valve size for  
TG GP86-100, TG GP120-100, TG GP185-125
- 60 Safety relief valve for  
TG GP360-150

#### 3. Materials

- G Safety relief valve in cast iron\*


*\* for food applications: a stainless steel safety relief valve should be used*

#### 4. Working pressure class

- 4 Working pressure 1-4 bar
- 6 Working pressure 3-6 bar
- 10 Working pressure 5-10 bar
- 16 Working pressure 9-16 bar

#### 5. Heated spring casing

- H Safety relief valve heated spring casing

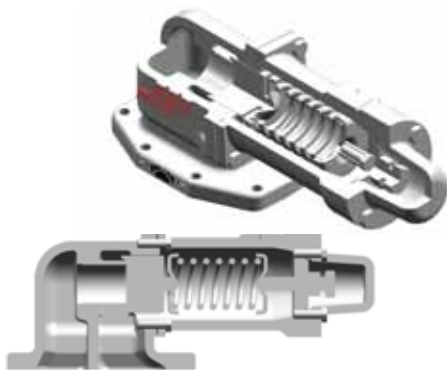

*Safety relief valve – horizontal*



*Safety relief valve – vertical*

### 3.18.1 Pressure

Safety relief valves are divided into 4 working pressure classes i.e. 4, 6, 10 and 16 indicating the maximum working pressure for that valve. Each class has a standard set pressure at 1 bar above the indicated maximum working pressure. The set pressure can be set lower on request never higher.

Working pressure class	4	6	10	16
Standard set pressure (bar)	5	7	11	17
Working pressure range (bar)	1 – 4	3 – 6	5 – 10	9 – 16
Set pressure range (bar)	2 – 5	4 – 7	6 – 11	10 – 17

### 3.18.2 Heating

The weld on spring casing is provided with 2 thread connections. Flange connections are not available.

Maximum temperature: 200°C  
Maximum pressure: 10 bar


### 3.18.3 Safety relief valve – Relative adjustment

Adjustment of the standard setting pressure is performed at the factory.


**Note!** When testing the safety relief valve mounted on the pump, make sure the pressure never exceeds the set pressure of the valve + 2 bar.

To adjust the standard opening pressure, proceed as follows:

1. Loosen the tap bolts (7310).
2. Remove cover (7050).
3. Take the measurement of dimensions of H.
4. Read spring ratio in the below table and determine the distance over which the adjusting bolt (7320) must be loosened or tightened.

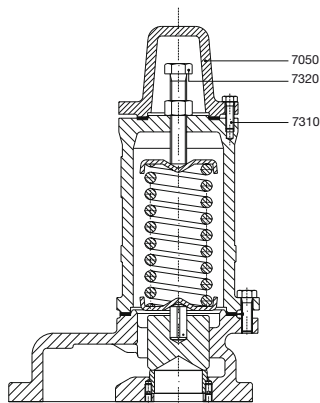


Vertical safety relief valve

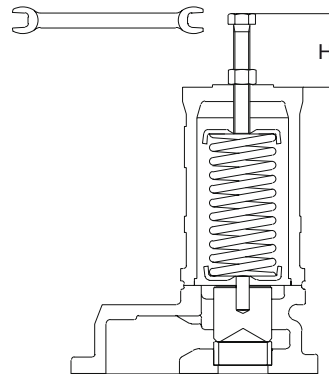

Set pressure modification

### Spring ratio – Safety relief valve

TG GP pump size		Spring dimensions					
		Pressure class	Du mm	d mm	Lo mm	p/f bar/mm	$\Delta H$ [mm] in order to adjust by 1 bar
2-25 3-32 6-40	Horizontal	4	25.5	3.0	64	0.26	3.85
		6	25.5	3.5	66	0.43	2.33
		10	25.5	4.5	60	1.72	0.58
		16	25.5	4.5	60	1.72	0.58
15-50 23-65	Horizontal	4	37.0	4.5	93	0.21	4.76
		6	37.0	4.5	93	0.21	4.76
		10	36.5	6.0	90	0.81	1.23
		16	36.5	6.0	90	0.81	1.23
58-80	Horizontal	4	49.0	7.0	124	0.32	3.13
		6	49.0	7.0	124	0.32	3.13
		10	48.6	8.0	124	0.66	1.52
		16	48.6	8.0	124	0.66	1.52
86-100 120-100 185-125	Vertical	4	49.0	7.0	124	0.16	6.25
		6	48.6	8.0	124	0.33	3.03
		10	49.0	9.0	120	0.55	1.82
		16	62	11	109	0.86	1.16
360-150	Vertical	4	82	11	200	0.12	8.33
		6	82	11	200	0.12	8.33
		10	84	12	200	0.19	5.26
		16	88	14	200	0.32	3.13



Example: adjust the standard set pressure of a V35-G10 valve (for pump size 58-80) to 8 bar.  
 ⇒ Standard set pressure of V35-G10 = 11 bar (see table under 3.18.1)  
 ⇒ Difference between actual set pressure and desired set pressure = 11 - 8 = 3 bar  
 ⇒  $\Delta H$  to loosen the adjusting bolt = 3 x 1.52 mm (see table above) = 4.56 mm



#### Note!

The spring ratio  $p/f$  depends upon the dimensions of the spring. Check these dimensions if necessary (see table above).

When the safety relief valve is not functioning properly, the pump must immediately be taken out of service. The safety relief valve must be checked by your local distributor.


### 3.18.4 Sectional drawings and part lists

#### 3.18.4.1 Single safety relief valve

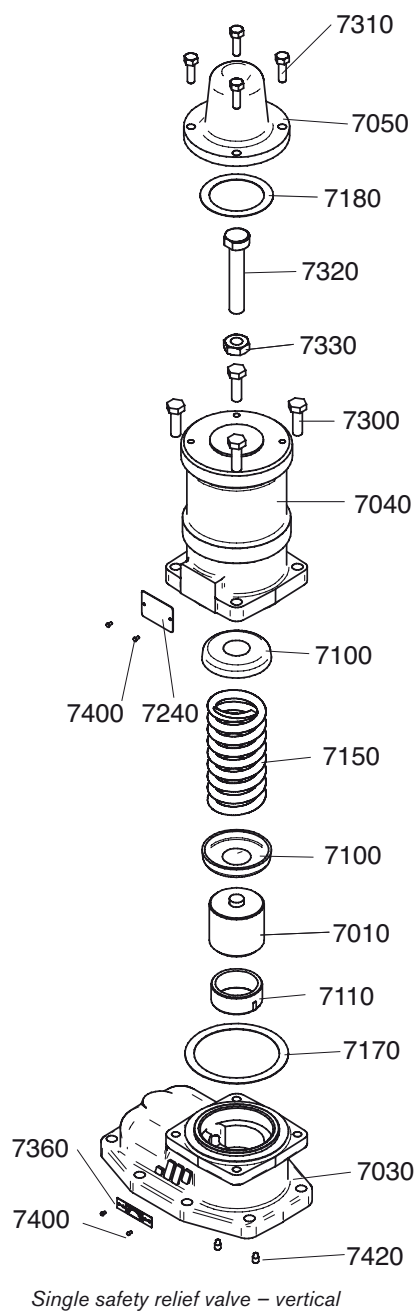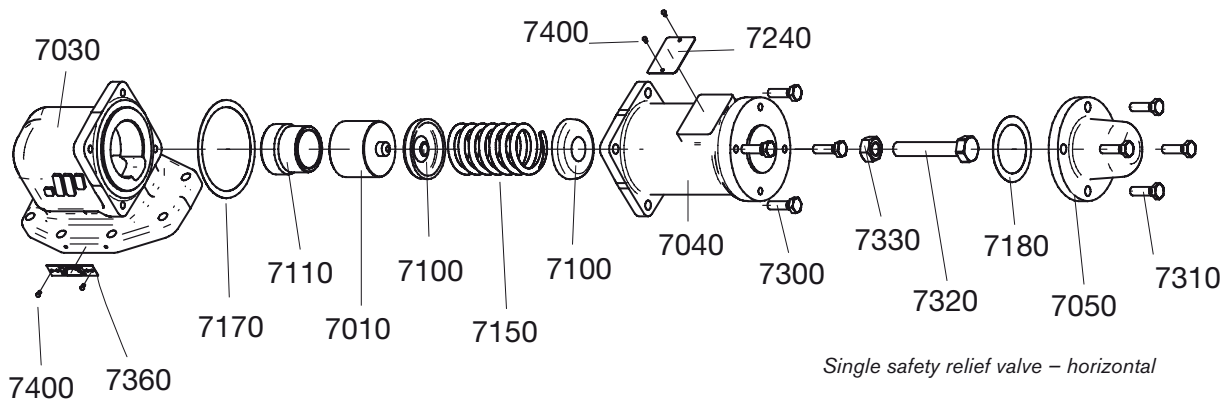


Pos.	Description	V18	V27	V35	V50	V60	Preventive	Overhaul
7010	Valve	1	1	1	1	1		
7030	Valve casing	1	1	1	1	1		
7040	Spring casing	1	1	1	1	1		
7050	Cover	1	1	1	1	1		
7100	Spring plate	2	2	2	2	2		
7110	Valve seat	1	1	1	1	1		
7150	Spring	1	1	1	1	1		
7170	Flat gasket	1	1	1	1	1	x	x
7180	Flat gasket	1	1	1	1	1	x	x
7240	Name plate	1	1	1	1	1		
7300	Tap bolt	3	4	4	4	4		
7310	Tap bolt	3	4	4	4	4		
7320	Adjusting screw	1	1	1	1	1		
7330	Hexagonal nut	1	1	1	1	1		
7360	Arrow plate	1	1	1	1	1		
7400	Rivet	4	4	4	4	4		
7420	Set screw	-	-	2	2	2		

### 3.18.4.2 Heated spring casing

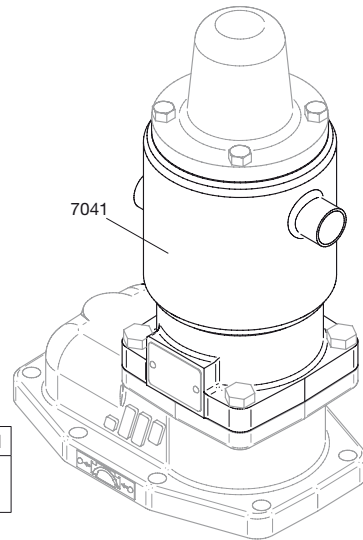


Pos.	Description	V18	V27	V35	V50	V60	Preventive	Overhaul
7041	Heated spring casing	N/A	1	1	1	1		

### 3.18.4.3 Double safety relief valve

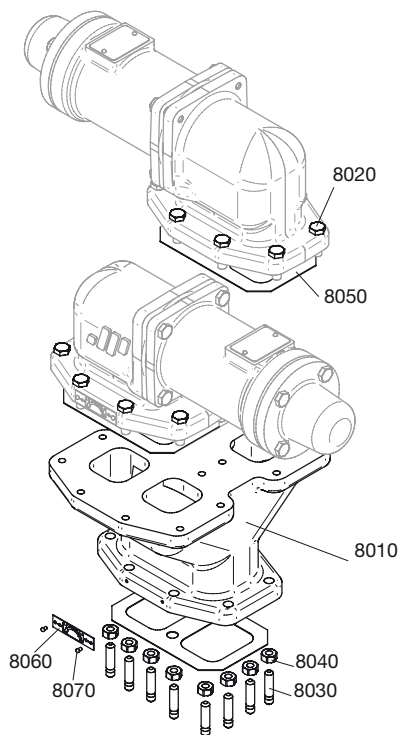

Double safety relief valve – horizontal

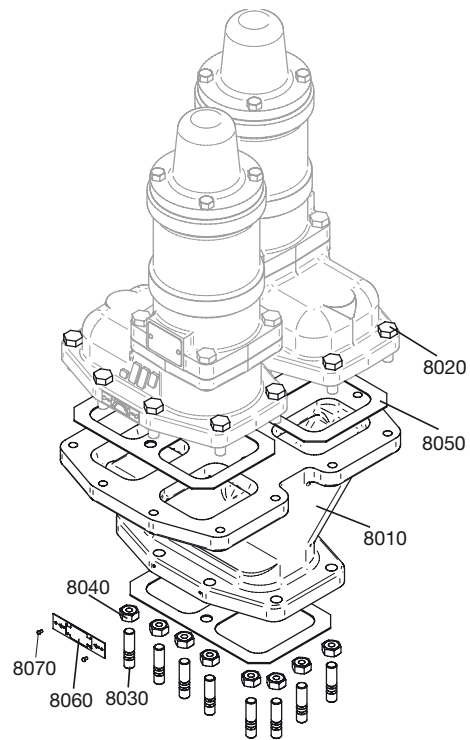

Double safety relief valve – vertical

Pos.	Description	V18	V27	V35	V50	Preventive	Overhaul
8010	Y-casing	N/A	1	1	1		
8020	Cylindrical head screw		16	16	16		
8030	Stud		8	8	8		
8040	Hexagonal nut		8	8	8		
8050	Flat gasket		3	3	3	x	x
8060	Arrow plate		1	1	1		
8070	Rivet		2	2	2		

## 3.19 Installation

### 3.19.1 General

This manual gives basic instructions which are to be observed during installation of the pump. It is therefore important that this manual is read by the responsible personnel prior to assembly and afterward to be kept available at the installation site.

The instructions contain useful and important information allowing the pump/pump unit to be properly installed. They also contain important information to prevent possible accidents and serious damage prior to commissioning and during operation of the installation.



Non-compliance with the safety instructions may produce a risk to the personnel as well as to the environment and the machine, and results in a loss of any right to claim damages.

It is imperative that signs affixed to the machine, e.g. arrow indicating the direction of rotation or symbols indicating fluid connections be observed and kept legible.

### 3.19.2 Location

#### 3.19.2.1 Short suction line

Locate the pump/pump unit as close as possible to the liquid source and if possible below the liquid supply level. The better the suction conditions, the better the performance of the pump. See also section 3.19.6.2 Piping.


#### 3.19.2.2 Accessibility

Sufficient room should be left around the pump/pump unit to allow proper inspection, pump isolation and maintenance.

Sufficient space should be left in front of the pump to enable disassembly of the pump cover, idler and idler pin.

- For loosening pump cover refer to **ma**
- For disassembling rotating parts (pump shaft and sealing) refer to **mb**
- To adjust pressure of safety relief valve refer to **mc**

For dimensions of ma, mb, mc see chapter 6.0.

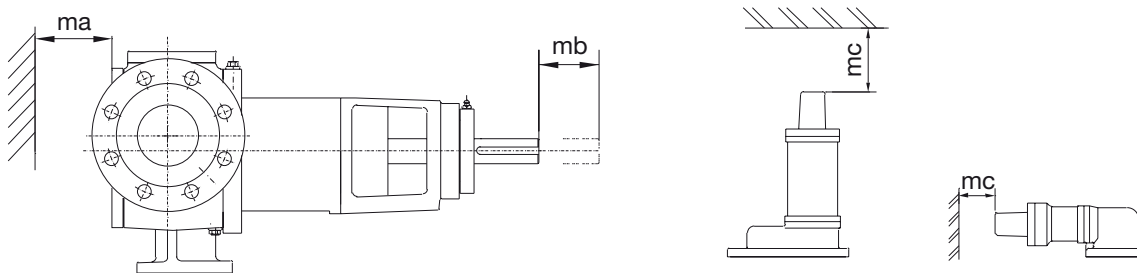

It is imperative that the operating device of pump and/or pump unit is always accessible (also during operation).

#### 3.19.2.3 Outdoor installation

The TopGear pump may be installed in the open, the ball-bearings are sealed by rubber V-joints protecting the pump against dripping water. In very wet conditions we advice to install a roof.

### 3.19.2.4 Indoor installation

Locate the pump so that the motor can be vented properly. Prepare the motor for operation according to instructions provided by the motor manufacturer.

When flammable or explosive products are pumped, a proper earthing should be provided. The components of the unit should be connected with earthing bridges to reduce the danger arising from static electricity.



Use explosion free or explosion proof motors according to local regulations. Provide suitable coupling guards and suitable couplings.

#### Excessive temperatures

Depending on the fluid being pumped, high temperatures may be reached inside and around the pump. From 60°C onwards the responsible person must provide the necessary protective means and place "Hot surfaces" notices .



When insulating the pump unit, ensure that adequate cooling is allowed from the bearing housing. This is required for cooling of the bearings and grease of the bearing bracket (see 3.19.8.7 Guarding of moving parts).



Protect the user against leakages and possible liquid streams.

### 3.19.2.5 Stability

#### Foundation


The pump unit must be installed on a baseplate or on a frame placed exactly level on the foundation. The foundation must be hard, level, flat, vibration-free to guarantee correct alignment of the pump/drive while operating. See also section 3.19.8 Guidelines for assembly and section 3.19.8.6 Shaft coupling.

#### Horizontal mounting

Pumps are to be mounted horizontally on the integral feet. Other kinds of installation have an influence on draining, filling and functioning of the mechanical seal, etc. If the pump/pump unit is installed differently, contact your local supplier.

#### Support

Nevertheless the feet underneath the pump casing make the pump very stable, an extra support is placed under the bearing bracket. Especially when driven by V-belt and/or a combustion engine this extra support close to the coupling is needed. It is designed to absorb the belt forces and vibrations whilst letting the pump shaft expand freely along its axis.

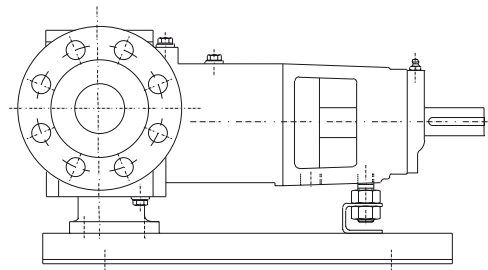

### 3.19.3 Drives

If a bare shaft pump is supplied, the user is responsible for the drive and the assembling with the pump. The user also must provide guarding of moving parts. See also section 3.19.8 Guidelines for assembly.

#### 3.19.3.1 Starting torque


- The starting torque of internal gear pumps is almost identical to the nominal torque.
- Take care that the motor has a sufficiently large starting torque. Therefore choose a motor with a capacity 25% higher than the pump power consumption.

**Note!** A mechanical variable speed drive requires checking of the available torque at low and high speed.

- Frequency invertors may have limited the starting torques.
- Also verify that the maximum allowable torque at the pump shaft is not exceeded (see section 3.11.4). In critical cases a torque limiting device such as a slip or break coupling can be provided.

### 3.19.3.2 Radial load on shaft end

The shaft end of the pump shaft may be loaded in radial sense with the maximum radial force ( $F_r$ ). See table.

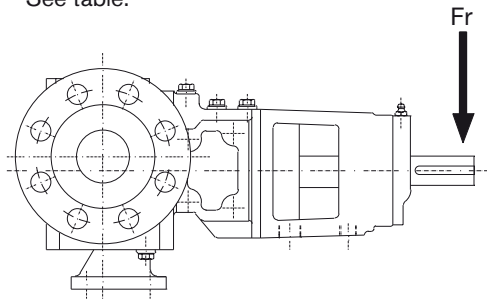

TG GP pump size	Fr (N) - max
2-25/3-32	400
6-40	700
15-50/23-65	1000
58-80/86-100/120-100	2000
185-125	3000
360-150	6000


- This force is calculated on the maximum allowable torque and the maximum allowable working pressure of the pump.
- In case a direct drive with a flexible coupling is used, the indicated force will not be exceeded when pump and drive are well aligned.
- Starting with the TG GP15-50, V-belt drive can be used.

#### **In case of V-belt drive**

The maximum allowable radial force  $F_r$  as indicated in the table may be chosen higher but must be calculated case by case in function of pressure, torque and size of the pulley. Consult your local supplier for advice.

### 3.19.4 Shaft rotation for pump without safety relief valve

The shaft rotation determines which port of the pump is suction and which is discharge. The relation between the shaft rotation and the suction/discharge side is indicated by the rotation arrow plate attached at the top cover of a pump without safety relief valve.

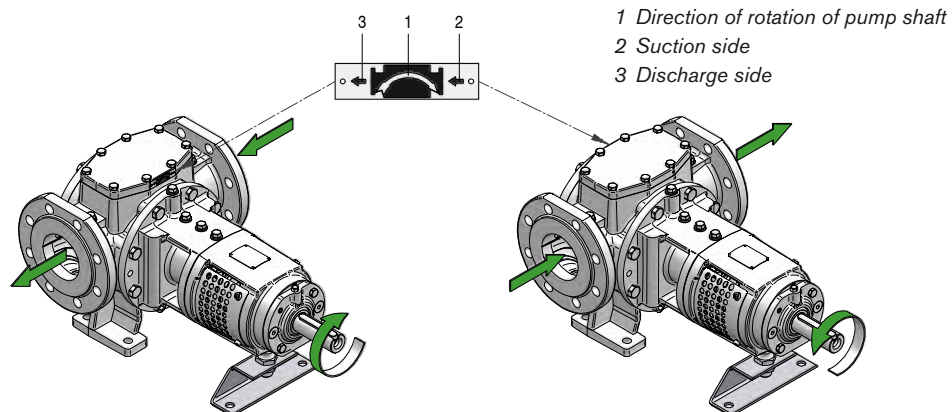


**Note!** Shaft rotation is always viewed from the shaft end towards the pump. Unless otherwise specified on the order, TopGear pumps are built at the factory for clockwise rotation (left figure above), which we define as the standard direction of rotation.



The small arrows 2 and 3 indicate the flow direction of the pumped liquid. Always make sure that shaft rotation corresponds with the position of the discharge and suction ports and the direction indicated by the rotation arrow plate.

If the shaft rotation is correct in relation to the port position but different from the direction indicated by rotation arrow plate, the top cover must be disassembled and turned around by 180°. The two suck-back grooves will help to evacuate air or gases during start-up or whilst running. As they only function in one direction of rotation, the top cover should be positioned in such a way that the suck-back grooves are placed towards the suction side. In case of doubt, contact your local distributor.


If the pump rotates in both directions, the top cover should be positioned in such a way that the suck-back grooves are placed towards the most used suction side.

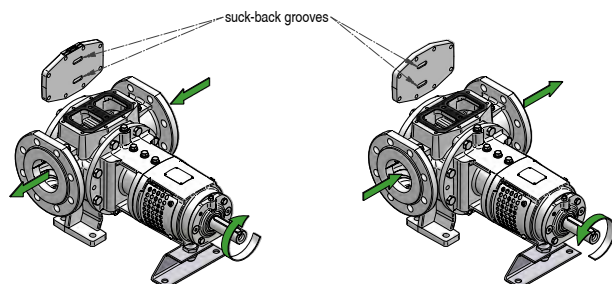



### 3.19.5 Shaft rotation for pump with safety relief valve

The shaft rotation determines which port of the pump is suction and which is discharge. The relation between the shaft rotation and the suction/discharge side is indicated by the rotation arrow plate attached at the valve casing of the safety relief valve.

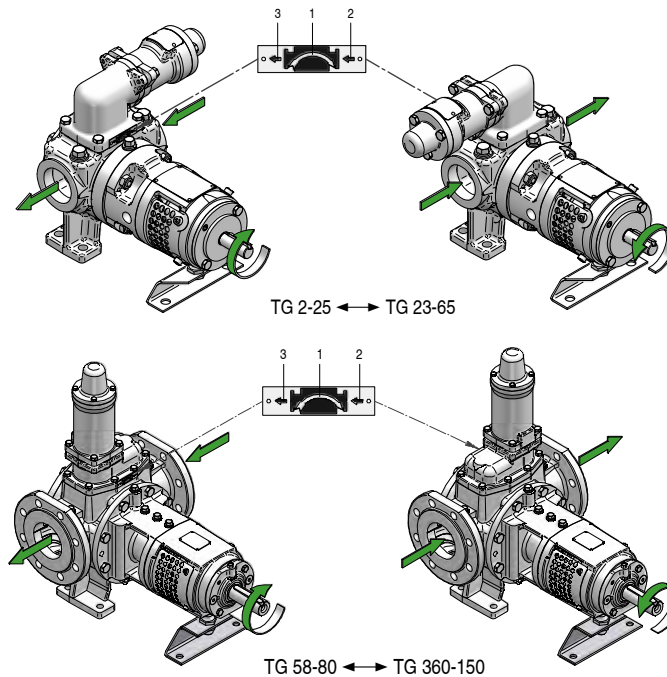


**Note!** Shaft rotation is always viewed from the shaft end towards the pump. Unless otherwise specified on the order, TopGear pumps are built at the factory for clockwise rotation (left figures above), which we define as the standard direction of rotation.



The small arrows 2 and 3 indicate the flow direction of the pumped liquid. Always make sure that shaft rotation corresponds with the position of the discharge and suction ports and the direction indicated by the rotation arrow plate.

If the shaft rotation is correct in relation to the port position but different from the direction indicated by rotation arrow plate, the safety relief valve must be disassembled and turned around by 180°.

If the pump rotates in both directions, a double safety relief valve is required.

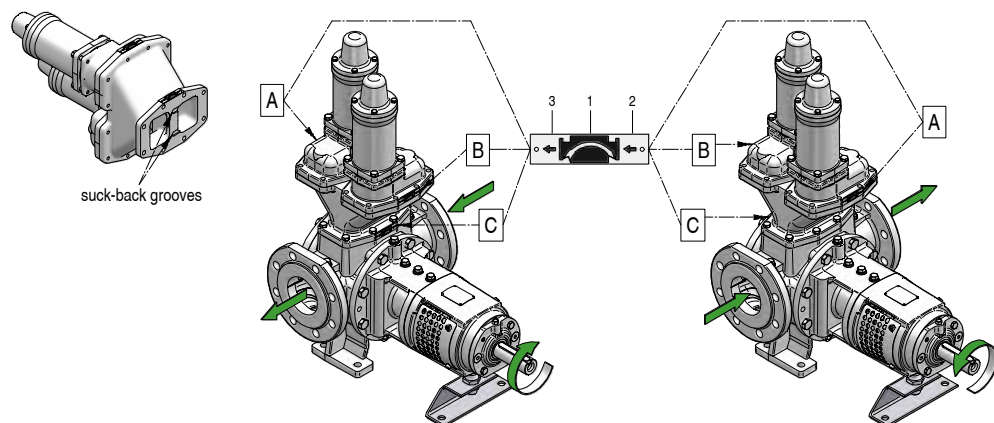

When a double safety relief valve is installed three arrow plates are attached – one on each valve (A and B) indicating the liquid flow direction of each valve (small arrows 2 and 3) and one on the Y-casing (C) indicating the most favourable direction of rotation of the pump (arrow 1).

The two suck-back grooves will help to evacuate air or gases during start-up or whilst running. As they only function in one direction of rotation, the Y-casing should be positioned in such a way that the suck-back grooves are placed towards the most used suction side.

In case of doubt, contact your local distributor.


Be sure that the safety relief valves are mounted opposite each other so that the arrow plates on the safety relief valves (A and B) are indicating opposite liquid flow directions.

### 3.19.6 Suction and discharge pipes

#### 3.19.6.1 Forces and moments

**Note!** Excessive forces and moments on the nozzle flanges derived from piping can cause mechanical damage to pump or pump unit.

Pipes should therefore be connected in line, limiting the forces on the pump connections. Support the pipes and make sure they remain stress-free during operation of the pump.

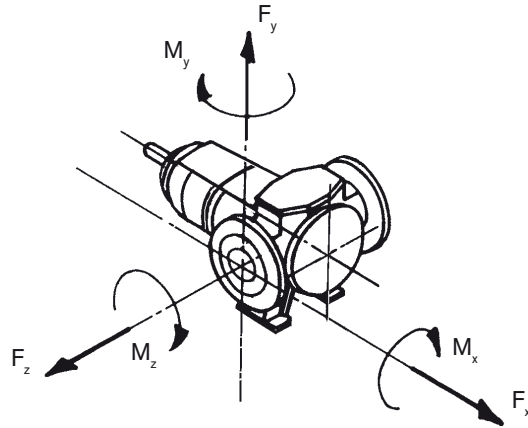

TG GP pump size	$F_{x,y,z}$ (N)	$M_{x,y,z}$ (Nm)
2-25	2000	315
3-32	2050	325
6-40	2200	385
15-50	2600	675
23-65	2900	800
58-80	3550	1375
86-100	4100	1750
120-100	4100	1750
185-125	5900	3750
360-150	10600	7150

See table for maximum allowable forces ( $F_{x,y,z}$ ) and moments ( $M_{x,y,z}$ ) on the nozzle flanges *with pump on a solid foundation (e.g. grouted base plate or solid frame)*.

When pumping hot liquids attention should be given to forces and moments caused by thermal expansion in which case expansion joints should be installed.

Check after connecting whether the shaft can move freely.

#### 3.19.6.2 Piping

- Use piping with an equal diameter than the connection ports of the pump and shortest possible.
- The pipe diameter has to be calculated in function of the liquid parameters and the installation parameters. If necessary use larger diameters to limit pressure losses.
- If the fluid to be pumped is viscous, pressure losses in the suction and discharge lines may increase considerably. Other piping components like valves, elbows, strainers, filters and foot valve also cause pressure losses.
- Diameters, length of piping and other components should be selected in such a way that the pump will operate without causing mechanical damage to the pump/pump unit, taking into account the minimum required inlet pressure, the maximum allowable working pressure and the installed motor power and torque.
- Check the tightness of the pipes after connection.

#### Suction piping

- Liquids should preferably enter the pump from a level higher than the pump level. In case the liquid should be sucked from a level lower than the pump level, the inclining suction pipe should rise upwards towards the pump without any air pockets.
- A too small diameter or a too long suction pipe, a too small or blocked strainer will increase pressure losses so that the NPSHa (NPSH available) becomes smaller than the NPSH (NPSH required).

Cavitation will occur, causing noise and vibrations. Mechanical damage to pump and pump unit is not excluded.

- When a suction strainer or filter is installed pressure losses in the suction line must be checked constantly. Also check if the inlet pressure at the suction flange of the pump is still sufficiently high.
- When the pump works in both directions, pressure losses must be calculated for both directions.

### Self-priming operation

At the start sufficient liquid must be available in the pump filling up the internal clearance volume and the dead spaces, allowing the pump to build up a pressure difference.

Therefore, for pumping low viscosity fluids, a foot valve with the same or larger diameter than the suction pipe must be installed or the pump can be installed without foot-valve but in U-line.


**Note!** A foot valve is not recommended when pumping high viscous liquids.

- To remove air and gases from suction line and pump, counter pressure at the discharge side must be reduced. In case of self-priming operation, start-up of the pump should be performed with open and empty discharge line allowing air or gases to escape at low back pressure.
- Another possibility in case of long lines or when a non-return valve is installed in the discharge line, is to install a by-pass with isolating valve close to the discharge side of the pump. This valve will be opened in case of priming and allows air or gas evacuation at low back pressure. The bypass should be lead back to the supply tank – not to the suction port.

### 3.19.6.3 Isolating valves

To allow proper maintenance it is necessary to be able to isolate the pump. Isolation can be done by installing valves in suction and discharge lines.

- These valves must have a cylindrical passage of the same diameter of the piping (full bore). (Gate or ball valves are preferable).
- When operating the pump, the valves must be opened completely. The output must never be regulated by means of closing valves in suction or discharge pipes. It must be regulated by changing shaft speed or by re-routing the media over a by-pass back to the supply tank.

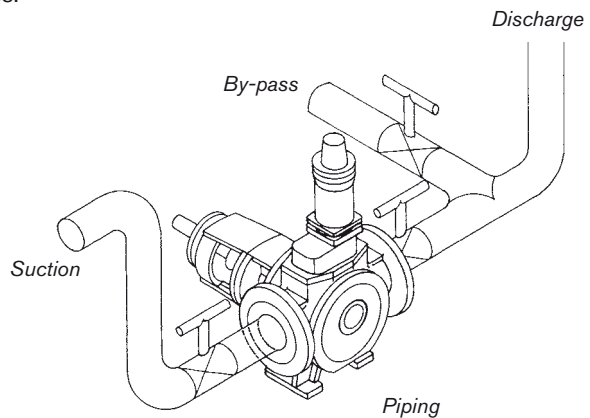

### 3.19.6.4 Strainer

Foreign particles can seriously damage the pump. Avoid the entry of these particles by installing a strainer.

- When selecting the strainer attention should be given to the size of the openings so that pressure losses are minimised. The cross-sectional area of the strainer must be three times that of the suction pipe.
- Install the strainer in such a way that maintenance and cleaning are possible.
- Make sure that the pressure drop in the strainer is calculated with the right viscosity. Heat the strainer if necessary to reduce viscosity and pressure drop.


For the maximum allowable particle size see section 3.16.

### 3.19.7 Secondary piping

For dimensions of connections and plugs see chapter 6.0.

#### 3.19.7.1 Drain lines

The pump is provided with drain plugs.

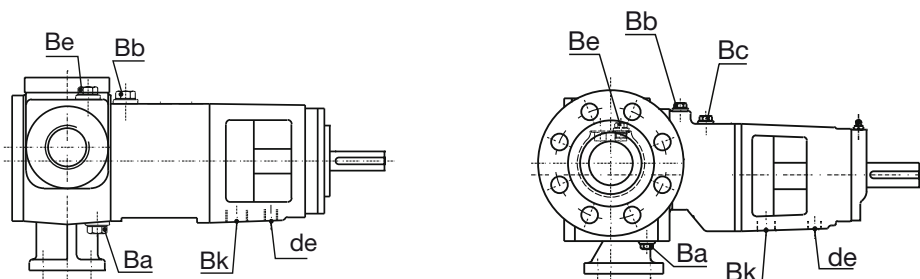


### 3.19.7.2 Heating jackets

#### 1. S-type jackets


The S-jackets are designed for use with saturated steam (max 10 bar  $\Rightarrow$  180°C) or with non-dangerous media (max 10 bar - max 200°C). They are provided with threaded connections BI (see chapter 6.0 for the dimensions).

The connection can be done by threaded pipes or pipe connections with sealing in the thread (conical thread applying ISO 7/1) or sealed outside the thread by means of flat gaskets (cylindrical thread applying ISO 228/1). Thread type see section 3.22.7.

**S-jacket on pump cover**

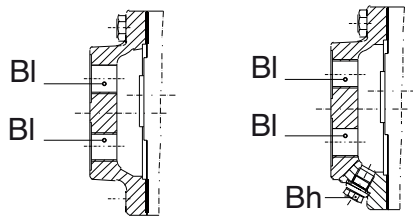

**S-jacket around shaft area**

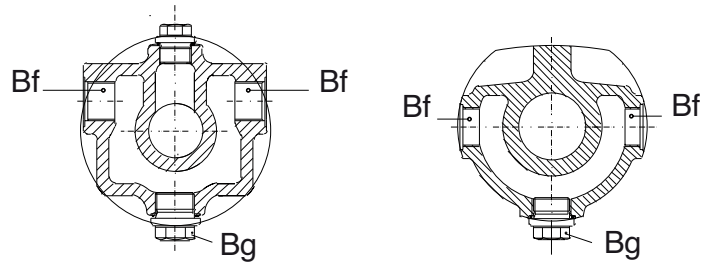

#### 2. Jacket on pump cover

In case of steam supply, connect the supply line at the highest position and the return line to the lowest position so that condensed water will be drained via the lowest line. In case of liquid supply, the positions are not important. A drain plug Bh is provided and can be considered as a drain line (TG GP58-80 to TG GP360-150).


#### 3. Jacket around the shaft seal

Connect the supply and the return line to both connections on the intermediate casing. A drain plug is provided in the intermediate casing at the bottom side (Bg). In case of steam supply this drain can be connected to a drain line to evacuate condensed water.

**Note!** After connection check the tightness of the heating circuit and vent it properly.

#### 4. Jackets on safety relief valve – around spring casing

The jackets on the safety relief valve are designed for use with saturated steam (max 10 bar  $\Rightarrow$  180°C) or with non dangerous media (max 10 bar - max 200°C). They are provided with threaded connections Bo (see chapter 6.0 for dimensions). The connection can be done by threaded pipes or pipe connections with sealing in the thread (conical thread applying ISO 7/1). Thread type see section 3.22.7.

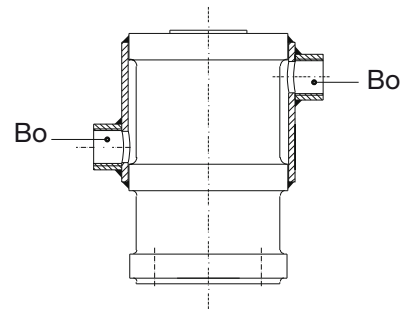

In case of steam supply, connect the supply line at the highest position and the return line to the lowest position so that condensed water will be drained via the lowest line. In case of liquid supply, the positions are not important.

### 3.19.8 Guidelines for assembly


When a bare shaft pump is delivered, the assembly with drive is the responsibility of the user. The user also must provide all necessary devices and equipment allowing a safe installation and commissioning of the pump.

#### 3.19.8.1 Transport of pump unit

- Prior to lifting and transporting a pump unit, make sure that the packaging is of sturdy enough construction is and will not be damaged during transport.
- Use crane hooks in the baseplate or the frame. (See chapter 1.0.)

#### 3.19.8.2 Foundation pump unit

The pump unit must be installed on a base plate or on a frame placed exactly level on the foundation. The foundation must be hard, level, flat and vibration free in order to guarantee the alignment of pump/drive while operating. (See section 3.19.2.5)

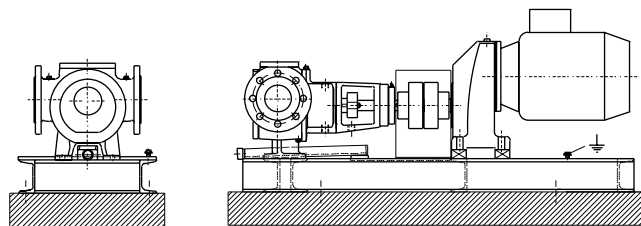

#### 3.19.8.3 Variators, Gear box, Gear motors, Motors

Consult the supplier's instruction manual, included with the delivery. Contact the pump supplier if the manual is not included.

#### 3.19.8.4 Electric motor drive

- Before connecting an electric motor to the mains check the current local regulations of your electricity provider as well as the EN 60204-1 standard.
- Leave the connecting of electric motors to qualified personnel. Take the necessary measures to prevent damage to electrical connections and wiring.

##### **Circuit breaker**

For safety work on a pump unit, install a circuit breaker as close as possible to the machine. It also is advisable to place an earth leakage switch. The switching equipment must comply with current regulations, as stipulated by EN 60204-1.

##### **Motor overload protection**

To protect the motor against overloads and short-circuits a thermal or thermo-magnetic circuit breaker must be incorporated. Adjust the switch for the nominal current absorbed by the motor.


##### **Connection**

- Do not use a star-delta circuit with electric motors due to the required high starting torque.
- For single-phase alternating current, use motors with a "reinforced" starting torque.
- Ensure a sufficiently high starting torque for frequency-controlled motors and adequate cooling of the motor at low speeds. If necessary, install a motor with forced ventilation.



Electrical equipment, terminals and components of control systems may still carry live current when at rest. Contact with these may be fatal, resulting in serious injury or cause irreparable material damage.

Line	Motor	
U (volt)	230/400 V	400 V
3 x 230 V	delta	–
3 x 400 V	star	delta

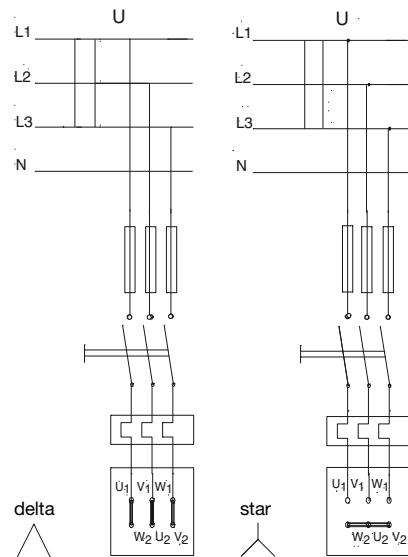

### 3.19.8.5 Combustion engines

When using a combustion engine in the pump unit, see the engine instruction manual included in the delivery. Contact the pump supplier if the manual is not included.

Irrespective of this manual the following must be respected for all combustion engines:



- Compliance with local safety regulations
- The exhaust of combustion gases must be screened to avoid contact
- The starter must be uncoupled automatically once the engine has started
- The pre-set maximum number of engine revolutions may not be modified
- Before starting the engine, the oil level must be checked

#### Note!

- Never run the engine in a closed area
- Never refuel the engine while it is still running

### 3.19.8.6 Shaft coupling

Internal gear pumps demand a relatively high starting torque. During the operation shock loads are occurring due to pulsations inherent to the gear pump principle. Therefore, choose a coupling which is 1.5 times the torque recommended for normal constant load.

Fit – **without impact tool** – both halves of the coupling to the pump shaft and the motor shaft respectively.


#### Alignment

The pump and motor shafts of complete units are accurately pre-aligned in the factory.


After installation of the pump unit, the pump and motor shaft alignment must be checked and re-aligned if necessary.

#### Alignment of the coupling halves may only take place by moving the electric motor!

- 1 Place a ruler (A) on the coupling. Remove or add as many shims as is necessary to bring the electric motor to the correct height so that the straight edge touches both coupling halves over the entire length, see figure.
- 2 Repeat the same check on both sides of the coupling at the height of the shaft. Move the electric motor so that the straight edge touches both coupling halves over the entire length.
- 3 To be certain the check is also undertaken using external callipers (B) at 2 corresponding points on the sides of the coupling halves, see figure.



- 4 Repeat this check at operating temperature and spend time achieving minimum alignment deviation.
- 5 Fit the protecting guard. See the figure below and the corresponding table for the maximum allowed tolerances for aligning the coupling halves.

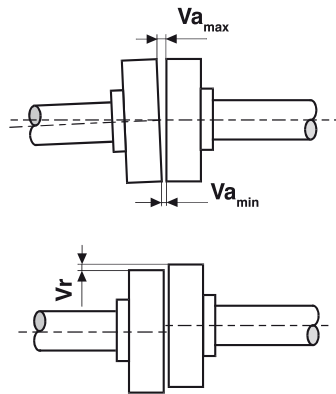

Alignment tolerances						
External diameter of coupling [mm]	Va				Va <sub>max</sub> - Va <sub>min</sub> [mm]	Vr <sub>max</sub> [mm]
	min [mm]		max [mm]			
81-95	2	5*	4	6*	0.15	0.15
96-110	2	5*	4	6*	0.18	0.18
111-130	2	5*	4	6*	0.21	0.21
131-140	2	5*	4	6*	0.24	0.24
141-160	2	6*	6	7*	0.27	0.27
161-180	2	6*	6	7*	0.30	0.30
181-200	2	6*	6	7*	0.34	0.34
201-225	2	6*	6	7*	0.38	0.38

\* = coupling with spacer

### Belt drive

Belt drives also increase the loading on the shaft end and the bearings. Therefore, certain limitations must be imposed on the maximum load of the shaft, viscosity, pumping pressure and speed.

#### 3.19.8.7 Guarding of moving parts



Before commissioning the pump, place a protective guard over the coupling or belt drive. This guard must comply with the EN 953 design and construction standard.



For pumps operating at temperatures above 100°C, ensure that bearing bracket and bearings are cooled sufficiently by the surrounding air. Openings in the bearing bracket must not be guarded if the rotating parts do not have any projections (keys or keyways) which could cause injury (see prEN809). This simplifies the inspection and maintenance of the shaft seal.

#### 3.19.8.8 Electrical heating

When a bare shaft pump or a pump unit is delivered with only the cartridge heaters for electrical heating (so without our control panel for electrical heating), the user is responsible for connecting the cartridge heaters to the electric supply (110V or 230V).

We advise to connect the cartridge heaters to an electronic or electrical power control device, driven by a temperature sensor placed in close proximity to the cartridge heaters. In order to prevent the motor to start before the required temperature of the pump has been reached, we advise to connect this electronic or electrical power control device to the circuit of the motor.

If the cartridge heaters are not supplied with a separate earth lead, the installation has to provide a safe ground connection.

Do not operate the cartridge heaters at voltages in excess of that stamped on the cartridge heater. Install properly sized fuses/breakers in order to minimize hazards.

Do not twist or braid the wire leads. Where leads are subject to flexing, support the leadwires to prevent them from twisting or breaking off at the terminal end. Also avoid the use of tape on leads where they emerge from the cartridge heater. The adhesive on some tapes can contaminate the cartridge heater and shorten the cartridge heater life.

Before connecting the cartridges check the current local regulations of your electricity provider as well as the EN 60204-1 standard. Leave the connection of electrical devices to qualified personnel and take the necessary measures to prevent damage to electrical connections and wiring.

Cartridge heaters are capable of developing high temperatures. Therefore extreme care should be taken to avoid contact between the cartridge heaters and combustible materials and to keep combustible materials far enough away to be free of the effects of high temperatures.

## 3.20 Instructions for start-up

### 3.20.1 General

The pump can be put into service when all arrangements described in chapter 3.19 Installation have been made.

- **Prior to commissioning, responsible operators have to be fully informed on proper operation of the pump/pump unit and the safety instructions. This instruction manual must at all times be available to the personnel.**
- **Prior to commissioning, the pump/pump unit must be checked for visible damage. Damage or unexpected changes must be reported immediately to the plant operator.**

### 3.20.2 Cleaning the pump

There may be residual mineral oil inside the pump deriving from the pump testing and the initially lubricating of the bearing bushes. If these products are not acceptable for the pumped liquid, the pump should be cleaned thoroughly. Proceed as described in section 3.22.2.8 Draining of fluid.

**Remark:** pumps made for food applications are preserved with a food grade oil. The oil used is a NSF H3 approved oil (soluble). Nevertheless the oil is NSF H3 approved, the pump should be cleaned thoroughly before the initial start-up.



#### 3.20.2.1 Cleaning suction line

When the TG pump is put into service for the first time, suction line must be cleaned thoroughly. Do not use the pump. The TG pump is not meant to pump low viscosity liquids with impurities.

### 3.20.3 Venting and filling

To operate properly the pump should be vented and filled with the liquid to be pumped before the initial start-up:

- Unscrew the filling plug Bb, Be and Bc. Fill up the pump with the liquid to be pumped. *At the same time the pump will be vented.*
- Tighten the filling plugs.
- When the TG pump is brought into service for the first time or in case new gaskets are mounted, bolts that compress gaskets must after 3 - 4 days be tightened again (for tightening torques see section 3.22.3.1).

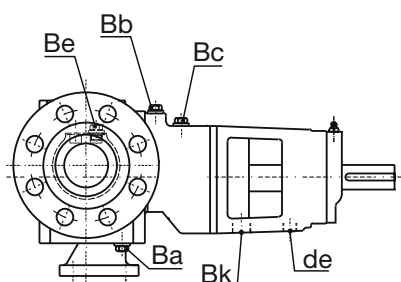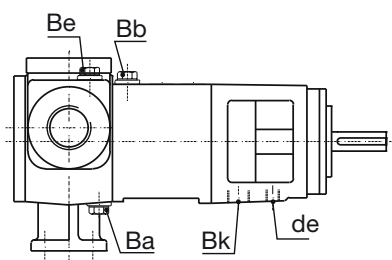

Filling up the pump



### 3.20.4 Checklist – Initial start-up

After thorough servicing or when the pump is to be put into service for the first time (initial start-up) the following checklist must be observed:

#### Supply and discharge line

- Suction and discharge pipes are cleaned.
- Suction and discharge pipes are checked for leaks.
- Suction pipe is protected properly to prevent the ingress of foreign bodies.

#### Characteristics

- The characteristics of the pump unit and safety relief valve to be checked (pumptype – see name plate, RPM, working pressure, effective power, working temperature, direction of rotation, NPSHr etc.).

#### Electrical installation

- Electrical installation complies with local regulations
- Motor voltage corresponds with mains voltage. Check terminal board.
- Make sure that the starting torque is sufficiently high (no star/delta starting will be used).
- Motor protection is adjusted properly.
- Direction of motor rotation corresponds with direction of pump rotation.
- Motor rotation (detached from unit) is checked.

#### Safety relief valve

- Safety relief valve (on pump or in piping) is installed
- Safety relief valve is positioned correctly. Flow direction of safety relief valve corresponds with suction and discharge lines.
- Make sure a double safety relief valve is installed when the pump has to operate in two directions.
- The set pressure of the safety relief valve is checked (see nameplate).

#### Jackets

- Jackets are installed.
- Maximum pressure and temperature of the heating/cooling media have been checked.
- The appropriate heating media or coolant is installed and connected.
- The installation complies with the safety standards.

#### Drive

- Alignment of pump, motor, gearbox etc. is checked.

#### Protection



- All guards and safety devices (coupling, rotating parts, excessive temperature) are in place and operative.



- In case of pumps that may reach working temperatures of 60°C or more, ensure sufficient safety guards against occasional touching are in place.

### 3.20.5 Start-up

When the pump is to be put into service the following checklist and procedure must be observed:

- Pump is filled with liquid.
- Pump is sufficiently preheated.
- Suction and discharge valves are fully open.
- Start the pump for a short while and check the direction of rotation of the motor.
- Start the pump and check suction of liquid (suction pressure).
- RPM of the pump is checked.
- Discharge pipe and seal are checked for leaks.
- Proper operation of the pump is verified.
- If leakage of the gland packing is too heavy, adjust (tighten) the gland pressure

### 3.20.6 Shut-down

When the pump is to be put out of service the following procedure must be observed:

- Turn the motor off.
- Close all auxiliary service lines (heating/cooling circuit, circuit for flush/quench medium).
- If solidifying of the liquid must be avoided, clean the pump while the product is still fluid.

Also see section 3.22 Maintenance instructions

**Note!** *When the liquid flows back from the discharge pipe to the pump, the pump may rotate in the opposite direction. Closing the discharge line valve during the last rotation cycles can prevent this.*

### 3.20.7 Abnormal operation

**Note!** *In case of abnormal operation or when troubles occur the pump must be taken out of service immediately. Inform all responsible personnel.*

- Prior to restarting the pump, determine the reason for the problem and solve the problem.

## 3.21 Trouble shooting

Symptom	Cause	Remedy
No flow Pump not priming	Suction lift too high	1 <ul style="list-style-type: none"> <li>Reduce difference between pump and suction tank level.</li> <li>Increase suction pipe diameter.</li> <li>Reduce length and simplify suction pipe (use as few elbows and other fittings as possible). Also see section 3.19 Installation.</li> </ul>
	Air leak in suction line	2 <ul style="list-style-type: none"> <li>Repair leak.</li> </ul>
	Very low viscosity	3 <ul style="list-style-type: none"> <li>Increase pump speed and reduce axial clearance (see section 3.22 Maintenance instructions).</li> </ul>
	Suction strainer or filter clogged	4 <ul style="list-style-type: none"> <li>Clear suction strainer or filter.</li> </ul>
	Pump casing incorrectly installed after repair	5 <ul style="list-style-type: none"> <li>Install pump casing correctly. See section 3.19 Installation.</li> </ul>
	Wrong direction of rotation of motor	6 <ul style="list-style-type: none"> <li>For 3-phase drivers change 2 connections.</li> <li>Change suction and discharge opening. <b>(Attention!)</b> Check the location of the safety relief valve).</li> </ul>
Pump stalls or irregular flow	Liquid level in suction tank falls too low	7 <ul style="list-style-type: none"> <li>Correct liquid supply</li> <li>Provide a level switch</li> </ul>
	Output too high	8 <ul style="list-style-type: none"> <li>Reduce pump speed/or install a smaller pump.</li> <li>Install by-pass line with check-valve.</li> </ul>
	Air sucking	9 <ul style="list-style-type: none"> <li>Repair leak in suction line.</li> <li>Check or replace shaft seal.</li> <li>Check/provide quench on shaft seal.</li> <li>Connect plug Bb to the pump discharge in order to increase the pressure in the sealing box.</li> </ul>
	Cavitation	10 <ul style="list-style-type: none"> <li>Reduce difference between pump and suction tank level.</li> <li>Increase suction pipe diameter.</li> <li>Reduce length and simplify suction pipe (use as few elbows and other fittings as possible). Also see chapter 3.19 Installation.</li> </ul>
	Liquid vaporises in pump (e.g. by heating up)	11 <ul style="list-style-type: none"> <li>Check temperature.</li> <li>Check vapour pressure of liquid.</li> <li>Reduce pump speed. If necessary install a larger pump.</li> </ul>
Not enough capacity	Pump speed too low	12 <ul style="list-style-type: none"> <li>Increase pump speed. <b>Attention!</b> Do not exceed maximum speed and check NPSHr.</li> </ul>
	Air sucking	13 <ul style="list-style-type: none"> <li>Repair leak in suction line.</li> <li>Check or replace shaft seal.</li> <li>Check/provide a quench in the shaft seal.</li> <li>Connect plug Bb to the pump discharge in order to increase the pressure in the sealing box.</li> </ul>
	Cavitation	14 <ul style="list-style-type: none"> <li>Reduce difference between pump and suction tank level.</li> <li>Increase suction pipe diameter.</li> <li>Reduce length and simplify suction pipe (use as few elbows and other fittings as possible). Also see section 3.19 Installation.</li> </ul>
	Back pressure too high	15 <ul style="list-style-type: none"> <li>Check discharge pipe.</li> <li>Increase pipe diameter.</li> <li>Reduce working pressure.</li> <li>Check accessories (filter, heat exchanger, etc.).</li> </ul>
	Safety relief valve set too low	16 <ul style="list-style-type: none"> <li>Correct pressure setting.</li> </ul>

Symptom	Cause	Remedy		
Not enough capacity	Viscosity too low	17	<ul style="list-style-type: none"> <li>▪ Increase pump speed. <b>Attention!</b> Do not exceed maximum speed and check NPSHr.</li> <li>▪ If necessary, install a larger pump.</li> <li>▪ If pump is heated by means of heating jackets or electrical heating, reduce the heating input.</li> </ul>	
		18	<ul style="list-style-type: none"> <li>▪ Check axial clearance and correct. See section 3.22 Maintenance instructions.</li> </ul>	
	Gases come free	19	<ul style="list-style-type: none"> <li>▪ Increase pump speed. <b>Attention!</b> Do not exceed maximum speed and check NPSHr.</li> <li>▪ Install a larger pump</li> </ul>	
Pump too noisy	Pump speed too high	20	<ul style="list-style-type: none"> <li>▪ Reduce pump speed.</li> <li>▪ If necessary, install a larger pump.</li> </ul>	
	Cavitation	21	<ul style="list-style-type: none"> <li>▪ Reduce difference between pump and suction tank level.</li> <li>▪ Increase suction pipe diameter.</li> <li>▪ Reduce length and simplify suction pipe (use as few elbows and other fittings as possible). Also see section 3.19 Installation.</li> </ul>	
		22	<ul style="list-style-type: none"> <li>▪ Increase pipe diameter.</li> <li>▪ Reduce working pressure.</li> <li>▪ Check accessories (filter, heat exchanger, etc.).</li> </ul>	
		23	<ul style="list-style-type: none"> <li>▪ Check and correct alignment. Also see section 3.19 Installation.</li> </ul>	
	Vibration of base plate or pipings	24	<ul style="list-style-type: none"> <li>▪ Make base plate heavier and/or fix base plate/ pipework better.</li> </ul>	
	Ball bearings damaged or worn	25	<ul style="list-style-type: none"> <li>▪ Replace ball bearings.</li> </ul>	
Pump consumes too much power or becomes hot	Pump speed too high	26	<ul style="list-style-type: none"> <li>▪ Reduce pump speed.</li> <li>▪ If necessary, install a larger pump.</li> </ul>	
	Gland packing too tight	27	<ul style="list-style-type: none"> <li>▪ Check or replace gland packing.</li> </ul>	
	Coupling misalignment	28	<ul style="list-style-type: none"> <li>▪ Check and correct alignment. Also see section 3.19 Installation.</li> </ul>	
	Viscosity too high	29	<ul style="list-style-type: none"> <li>▪ Increase axial clearance. See section 3.22 Maintenance instructions.</li> <li>▪ Heat pump.</li> <li>▪ Reduce pump speed.</li> <li>▪ Increase discharge pipe diameter.</li> </ul>	
Rapid wear		30	<ul style="list-style-type: none"> <li>▪ Increase pipe diameter.</li> <li>▪ Reduce working pressure.</li> <li>▪ Check accessories (filter, heat exchanger, etc.)</li> </ul>	
			Solid matter in liquid	31
	Pump runs dry		32	<ul style="list-style-type: none"> <li>▪ Correct liquid supply.</li> <li>▪ Provide level switch or dry running protection.</li> <li>▪ Heat up liquid.</li> <li>▪ Stop or reduce air sucking.</li> </ul>
Corrosion		33		<ul style="list-style-type: none"> <li>▪ Change pump materials or application parameters.</li> </ul>
Motor overloading		34		<ul style="list-style-type: none"> <li>▪ Increase pipe diameter.</li> <li>▪ Reduce working pressure.</li> <li>▪ Check accessories (filter, heat exchanger, etc.).</li> </ul>
	Gland packing too tight		35	<ul style="list-style-type: none"> <li>▪ Check and replace gland packing.</li> </ul>
	Viscosity too high		36	<ul style="list-style-type: none"> <li>▪ Increase axial clearance. See section 3.22 Maintenance instructions.</li> <li>▪ Heat pump.</li> <li>▪ Reduce pump speed.</li> <li>▪ Increase discharge pipe diameter.</li> </ul>
Pump leak		37		<ul style="list-style-type: none"> <li>▪ Check or replace gland packing.</li> </ul>

**Note!** If symptoms persist, the pump must be taken out of service immediately. Contact your local supplier.

### 3.21.1 Instructions for re-using and disposal

#### 3.21.1.1 Re-use

Re-use or putting the pump out of service should only be undertaken after complete draining and cleaning of the internal parts.



**Note!** *When doing so, observe adequate safety regulations and take environmental protection measures.*

*Liquids should be drained and following local safety regulations the correct personal equipment should be used.*

#### 3.21.1.2 Disposal

Disposal of the pump should only be done after it has been completely drained. Proceed according to local regulations.

Where applicable please disassemble the product and recycle the part's material.

## 3.22 Maintenance instructions

### 3.22.1 General

This chapter only describes operations that can be performed on-site for normal maintenance. For maintenance and repair requiring a workshop contact your local supplier.

- Insufficient, wrong and/or irregular maintenance can lead to malfunctions in the pump, high repair costs and long-term inoperability. Therefore, you should carefully follow the guidelines given in this chapter.

During maintenance operations on the pump due to inspections, preventive maintenance or removal from the installation, always follow the prescribed procedures.



Non-compliance with these instructions or warnings may be dangerous for the user and/or seriously damage the pump/pump group.



- Maintenance operations should be performed by qualified personnel only. Always wear the required safety clothing, providing protection against high temperatures and harmful and/or corrosive fluids. Make sure that the personnel read the entire instruction manual and, in particular, indicate those sections concerning the work at hand.



- SPX is not responsible for accidents and damage caused by non-compliance with the guidelines.

### 3.22.2 Preparation

#### 3.22.2.1 Surroundings (on site)

Because certain parts have very small tolerances and/or are vulnerable, a clean work environment must be created during on-site maintenance.

#### 3.22.2.2 Tools

For maintenance and repairs use only technically appropriate tools that are in good condition. Handle them correctly.

#### 3.22.2.3 Shut-down

Before commencing the maintenance and inspection activities the pump must be taken out of service. The pump/pump unit must be fully depressurized. If the pumped fluid permits, let the pump cool down to the surrounding temperature.

#### 3.22.2.4 Motor safety

Take appropriate steps to prevent the motor from starting while you are still working on the pump. This is particularly important for electric motors that are started from a distance.

Follow the below described procedure:

- Set the circuit breaker at the pump to "off".
- Turn the pump off at the control box.
- Secure the control box or place a warning sign on the control box.
- Remove the fuses and take them with you to the place of work.
- Do not remove the protective guard around the coupling until the pump has come to a complete standstill.

#### 3.22.2.5 Conservation

If the pump is not to be used for longer periods:

- First drain the pump.
- Then treat the internal parts with VG46 mineral oil or other preserving liquid (e.g. food grade oil for food applications).
- The pump must be operated briefly once a week or alternatively the shaft must be turned a full turn once a week. This ensures proper circulation of the protective oil.

### 3.22.2.6 External cleaning

- Keep the surface of the pump as clean as possible. This simplifies inspection, the attached markings remain visible and grease nipples are not forgotten.
- Make sure cleaning products do not enter the ball bearing space. Cover all parts that must not come into contact with fluids. In case of sealed bearings, cleaning products must not attack rubber gaskets. Never spray the hot parts of a pump with water, as certain components may crack due to the sudden cooling and the fluid being pumped may spray into the environment.

### 3.22.2.7 Electrical installation

- Maintenance operations on the electric installation may be performed only by trained and qualified personnel and after disconnecting the electric power supply. Carefully follow the national safety regulations.

Respect the above-mentioned regulations if performing work while the power supply is still connected.



- Check if electrical devices to be cleaned have a sufficient degree of protection (e.g. IP54 means protection against dust and splashing water but not against water jets). See EN 60529. Choose an appropriate method for cleaning the electrical devices.
- Replace defective fuses only with original fuses of the prescribed capacity.
- After each maintenance session check the components of the electrical installation for visible damage and repair them if necessary.

### 3.22.2.8 Draining of fluid

- Close off the pressure and suction lines as close as possible to the pump.
- If the fluid being pumped does not solidify, let the pump cool down to the ambient temperature before drainage.
- For fluids that solidify or become very viscous at ambient temperature, it is best to empty the pump immediately after shutting down by separating it from the piping. Always wear safety goggles and gloves.



- Protect yourself with a protective cap. The fluid may spray out of the pump.
- Open the venting plugs Be, Bb and Bc.
- If no drain line is provided, take precautions so that the liquid is not contaminating the environment.
- Open the drain plug Ba at the bottom of the pump housing.
- Let drain the liquid by gravity.
- Purge pump spaces with flush media or cleaning liquid by connecting a purge system to the following inlet openings:
  - Ba, Be – the displacement part
  - Ba, Bb – space behind rotor
- Re-assemble the plugs and close the valves, if any.

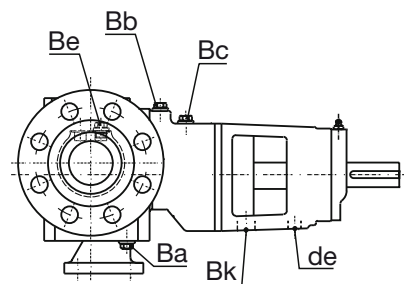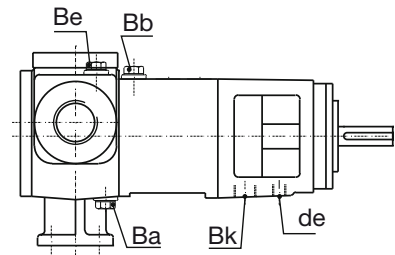

### 3.22.2.9 Fluid circuits

- Depressurize the jackets and the retaining fluid circuits.
- Uncouple the connections to the jackets and to the circulating or flush/quench media circuits.
- If necessary, clean the jackets and the circuits with compressed air.
- Avoid any leakage of fluid or thermal oil into the environment.

### 3.22.2.10 Electrical heating

In case that electrical heating (electrical cartridge heaters) is applied, make sure that the electrical heating is switched-off and that the cartridge heaters are cooled down.


### 3.22.3 Specific components

#### 3.22.3.1 Nuts and bolts

Nuts and bolts showing damage or parts with defective threading must be removed and replaced with parts belonging to the same fixation class as soon as possible.

- Preferably use a torque wrench for tightening.
- For the tightening torques, see table below.

Bolt	Ma (Nm) 8.8 / A4	Plug with edge and flat seal	Ma (Nm)
M6	10	G 1/4	20
M8	25	G 1/2	50
M10	51	G 3/4	80
M12	87	G 1	140
M16	215	G 1 1/4	250
M20	430		
M24	740		
M30	1500		



Plug with edge and elastic washer

#### 3.22.3.2 Plastic or rubber components

- Do not expose components made of rubber or plastic (cables, hoses, seals) to the effects of oils, solvents, cleaning agents or other chemicals unless they are suitable.
- These components must be replaced if they show signs of expansion, shrinkage, hardening or other damage.

#### 3.22.3.3 Flat gaskets

- Never re-use flat gaskets.
- Always replace the flat gaskets and elastic rings under the plugs with genuine spares from SPX.

#### 3.22.3.4 Filter or suction strainer

Any filters or suction strainers at the bottom of the suction line must be cleaned regularly.

**Note!** A clogged filter in the suction piping may result in insufficient suction pressure at the inlet. Clogged filter in the discharge line may result in higher discharge pressure.

#### 3.22.3.5 Anti-friction bearings

TG GP2-25, TG GP3-32 and TG GP6-40 pumps are equipped with 2RS ball bearings which are grease packed for life. They do not require periodically greasing.

Starting with pump size TG GP15-50, the pumps are equipped with ball bearings which could be greased periodically through a grease nipple at the bearing cover. The standard "multi-purpose" grease (consistent class NLGI-2) is suitable for temperatures up to 120°C.

#### Recommended greases (Also consult supplier !)

Supplier	NLGI-2	NLGI-3	Supplier	NLGI-2	NLGI-3
BP	LS2	LS3	Mobil	Mobilux EP2	
Chevron	Polyurea EP grease-2		SKF	LGMT2	LGMT3
Esso	BEACON 2 (*)	BEACON 3			
	BEACON EP2 (*)	UNIREX N3 (*)	Shell	ALVANIA R2	ALVANIA R3
Fina	LICAL EP2	CERAN HV			DARINA GREASE R2
		MARSON L2			
Gulf	Crown Grease No.2	Crown Grease No.3	Texaco	Multifak EP-2	
			Total	MULTIS EP 2 (*)	

(\*) Lubricants recommended by SPX.



For higher temperatures the standard grease should be replaced by a high temperature grease (consistent class NLGI-3). This grease is, depending on the make, suitable for temperatures up to 150°C or 180°C.

When a pump will be applied in a system or under conditions facing extremely high or low temperatures, the selection of the proper lubricant and correct lubrication interval should be made in consideration with your grease supplier.

Do not mix different grades, different makes of grease together. Such a mix can cause severe damage. Consult your local grease supplier.

### Relubrication

- Starting with pump size TG GP15-50, the ball bearings require lubrication through the grease nipple every 5000 running hours or every 12 months (which occurs first).
- Add a correct grade of grease (see 3.22.3.5). Do not overfill (see table below).

TG GP pump type	Bearing type	Grease quantity (gram)
2-25	6303-2RS1	No relubrication
3-32	6303-2RS1	No relubrication
6-40	6304-2RS1	No relubrication
15-50	3206 or 5206A	10
23-65	3206 or 5206A	10
58-80	3307 or 5307A	15
86-100	3308 or 5308A	20
120-100	3308 or 5308A	20
185-125	3310 or 5310A	25
360-150	7312 BECBJ paired	40

The ball bearing type 2RS1 are grease filled for life and need not to be relubricated. Both ranges ISO 3000 range and American AFBMA 5000 range are possible and have the same built in dimensions.

- When the anti-friction bearing has been relubricated 4 times it needs to be cleaned. Replace the old grease with new one or renew the anti-friction bearings.
- In the case of high temperatures, anti-friction bearings must be relubricated every 500 to 1000 running hours:
  - when using grease of NLGI-2 class: for service temperatures > 90°C
  - when using grease of NLGI-3 class: for service temperatures > 120°C
- When the load is extremely high, in case the grease loses much oil, anti-friction bearings need relubrication after each peak service. We recommend relubricating while the pump is still operating but after the peak load has occurred.

### 3.22.3.6 Sleeve bearings

We recommend checking the pump regularly for wear on the gear wheels and sleeve bearings to avoid excessive wear of other parts.

- A quick check can be done by using the front pull-out and back pull-out system. See table for maximum allowable radial clearance of the sleeve bearings.
- For replacement of the sleeve bearings contact your local supplier.

TG GP pump size	Maximum allowed radial clearances
2-25 to 6-40	0.10 mm
15-50 to 23-65	0.15 mm
58-80 to 120-100	0.25 mm
185-125	0.30 mm
360-150	0.35 mm


### 3.22.3.7 Shaft seal

#### Gland packing PO


- For pumps with gland packing, regularly check the packing for leaks. A slight leakage is normal.
- Regularly check connections on the lantern ring (if applicable).
- If the gland packing leaks excessively or when the pump needs serve, the old packing rings must be replaced. This can be done without disassembling bearing and bearing bracket.

#### 1. Gland packing disassembly


1. Loosen the gland nuts (2070).
2. Push back the gland (2040) and/or the follower (2000) as far as possible.
3. Remove the old packing (3000) rings using a packing extractor.
4. Thoroughly clean intermediate casing and shaft.

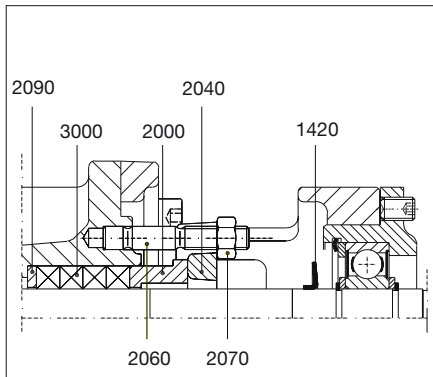

TG GP2-25 to TG GP6-40

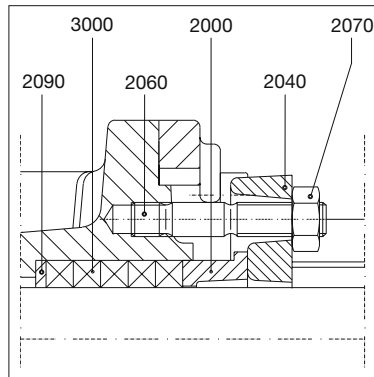

TG GP15-50 to TG GP23-65

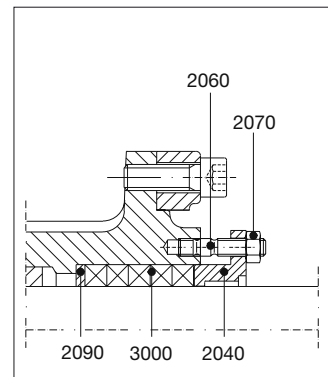

TG GP58-80 to TG GP360-150


#### 2. Gland packing assembly

1. First bend and twist the packing ring as shown in the figure.
  - Use packing seals with the right dimensions
  - Do not use a sharp object to push the ring into place as this may cut the ring (e.g. a screwdriver). Use a halved section of piping of the correct size instead.
2. Wrap it around the pump shaft and press the ring firmly against the bottom.
3. Place the following rings in the same way. Push them down one by one. Take care that the cuts in subsequent rings are rotated at 90 intervals.
4. After all packing rings have been mounted, push the gland (2040) and/or the follower (2000) for GP2-25 to GP23-65 against the last mounted packing ring and tighten the nuts cross-wise by hand.


Wrong



Correct



Bending and twisting packing rings



(GP6-40 : 4 pcs)  
(GP2-25/3-32 and  
15-50/360-150: 5 pcs)

**Do not overtighten the nuts!**


To avoid running dry, shaft gland packing must always leak a little.

#### 3. Running-in of the pump

1. Fill the pump and start it up.
2. Allow the new packing rings to run in for a few hours.  
**Note!** During this time the gland packing will leak more than usual!
3. While running-in the pump check that it is not overheating. Pay attention to the rotating shaft!
4. After the running-in period slightly tighten the gland nuts cross-wise, until the gland packing does not leak more than a few drops per minut


### 3.22.4 Front pull-out

The TG-pumps also have a front pull-out system. To remove liquid residues or to check the idler bearing for wear, the pump cover can be pulled out from the pump housing without disconnecting suction and discharge pipes. See chapters 4.0 Disassembly/Assembly and section 6.6 Weights.

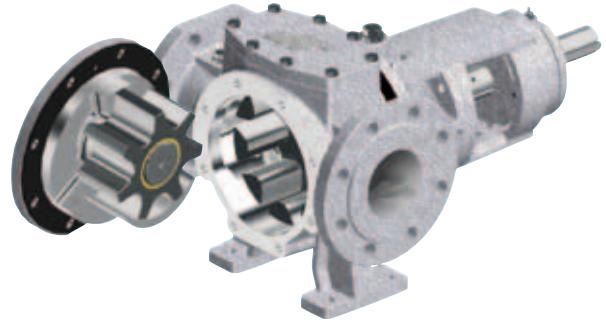

### 3.22.5 Back pull-out

To flush the pump or to check the sleeve bearing for wear the bearing bracket with intermediate casing, shaft and rotor can be easily pulled out backwards without disconnecting the suction and discharge pipes. When a spacer coupling is used, the driving mechanism need not be moved. See chapters 4.0 Disassembly/Assembly and section 6.6 Weights.

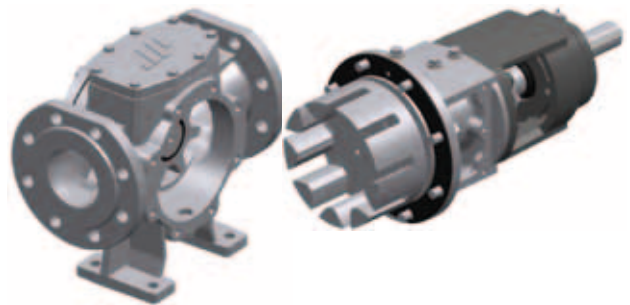

### 3.22.6 Clearance adjustment


The TG-pumps are delivered with the correct axial clearance setting. In some cases, however, the axial clearance needs to be adjusted:

- When uniform rotor and idler wear need to be compensated.
- When the flow is too low pumping low viscous liquids and the slip has to be reduced.
- When the liquid is more viscous than expected, the friction inside the pump can be reduced by increasing the axial clearance.


Nominal axial clearance	
TG GP pump size	(s <sub>ax</sub> ) [mm]
2-25 to 6-40	0.10 – 0.15
15-50 to 23-65	0.10 – 0.20
58-80 to 120-100	0.15 – 0.25
185-125 to 360-150	0.20 – 0.40

Proceed as follows to set the axial clearance:

1. Loosen the set screws (1480).
2. Tighten the bolts (1540).
3. The pump shaft with roller bearing and rotor will be pushed against the pump cover. The axial clearance is then zero.
4. Install a gauge on the bearing bracket.
5. Position the feeler gauge against the shaft end and initialise the gauge.
6. Loosen the bolts (1540) and tighten the set screws (1480) thus pushing rotor and roller bearing backwards.
7. Tighten the set screws until the distance between shaft end and bearing bracket has been increased by the required clearance.
8. Lock the shaft again by tightening the bolts (1540). The set clearance may be changed again. Therefore, when pushing the shaft end backwards, the clearance should be enlarged by 0.02 mm.

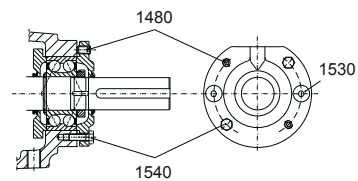

TGGP2-25 to TGGP185-125

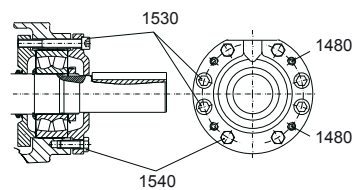

TGGP360-150


### 3.22.7 Designation of threaded connections.

To make clear what sealing type of threaded connection is provided we denominate them according to standards ISO 7/1 and ISO 228/1 as follows.


#### 3.22.7.1 Threaded connection Rp (example Rp 1/2)

If no flattened sealing face is provided we call the connection Rp accordingly ISO 7/1. This connection has to be sealed in the thread. The plugs or pipe connections must be provided with conical thread according to ISO 7/1 external thread (example ISO 7/1 – R1/2).

Conical plug  
ISO 7/1 - R 1/2



Conical pipe end  
ISO 7/1 - R 1/2




ISO 7/1	Type	Symbol	Example
Internal thread	Cylindrical (parallel)	Rp	ISO 7/1 – Rp 1/2
External thread	Always conical (tapered)	R	ISO 7/1 – R 1/2

#### 3.22.7.2 Threaded connection G (example G 1/2)


If the threaded connection is provided of a flattened sealing face we call it G according ISO 228/1. This connection can be sealed by a gasket. The plugs or pipe connections must be provided with a sealing collar and cylindrical external thread according to ISO 228/1 (Example ISO 228/1 - G1/2).

Plugs or pipe connections provided with conical thread according to ISO 7/1 external thread (example ISO 7/1 – R1/2) can also be used.

Plug with collar  
ISO 228/1 - G 1/2



Conical pipe end  
ISO 7/1 - R 1/2



ISO 228/1	Clearance class	Symbol	Example
Internal thread	Only one class	G	ISO 228/1 – G 1/2
External thread	Class A (standard)	G	ISO 228/1 – G 1/2
	Class B (extra clearance)	G...B	ISO 228/1 – G 1/2 B
ISO 7/1	Type	Symbol	Example
External thread	Always conical (tapered)	R	ISO 7/1 – R 1/2

## 4.0 Instructions for assembly and disassembly

### 4.1 General

Insufficient or wrong assembly and disassembly can lead to the pump malfunctioning, high repair costs and long-term inoperability. Contact your local supplier for information.

Disassembly and assembly may only be carried out by trained personnel. Such personnel should be familiar with the pump and follow the instructions below.



Non-compliance with the instructions or neglecting warnings can damage the user or lead to severe damage to pump and/or pump unit. SPX is not liable for accidents and damage resulting from such neglect.

### 4.2 Tools

- Set of nut spanners Width 8 - width 30
- Set of hexagonal spanners Width 2 - width 14
- Shaft nut spanner HN 2-4-6-7-8-10-12
- Screw driver
- Anti-recoil hammer Rubber, plastic, lead...
- Carton, paper, shammy
- Coupling extractor
- Ball bearing extractor
- Assembly oil For example Shell ONDINA 15  
Esso BAYOL 35  
or lubricant For example OKS 477
- Loctite 241 Max. temperature = 150°C
- Loctite 648 Heat resistant type
- Ball bearing grease For type see section 3.22.3.5
- Measuring tool for adjustment of the axial clearance Also see section 3.22.6
- Measuring tool to measure the height of the adjusting screw of the safety valve Also see section 3.18.3

### 4.3 Preparation

All activities described in this chapter need to be executed in a workshop suitable for repairs or a mobile workshop, arranged in the working environment.

Always work in a clean surrounding. Keep all sensitive parts, such as seals, bearings, mechanical shaft seals, etc. in their packaging as long as possible.

Always follow the instructions in section 3.22 with regard to:

- taking the pump out of service
- assembly of packing rings
- disassembly of the pump from the system
- lubrication of the bearings
- back pull-out and front pull-out
- adjusting axial clearance
- adjusting safety relief valve


### 4.4 After disassembly

- After each disassembly carefully clean the parts and check them for damage, if any. Replace all damaged parts.
- Replace damaged parts with original components.
- When assembling, use new graphite gaskets. Never use flat gaskets that have been used previously.

## 4.5 Anti-friction bearings

### 4.5.1 General


- Never re-use a disassembled bearing or a disassembled lock plate!
- For disassembly and assembly of the bearing (and coupling), use correct tools in order to inspect the pump without any shock loads. Shocks can damage the crisp material of bush bearings and mechanical seal.
- The anti-friction bearing has an interference fit on the pump shaft and a clearance fit in the bearing bracket.
- The anti-friction bearing can easily be mounted when heated to 80°C so that it slides on the pump shaft.
- Always push on the inner ring of the bearing. Pushing on the outer ring may damage the rolling parts between rotor and shaft.
- Support pump shaft at rotor side, not the rotor!  
Axial force on rotor - pump shaft may damage the shrunk connection.
- Anti-friction bearings type 2RS of TG GP2-25, TG GP3-32 and TG GP6-40 are sealed and greased for life. Bearings of the other pump sizes are to be greased at the cage.

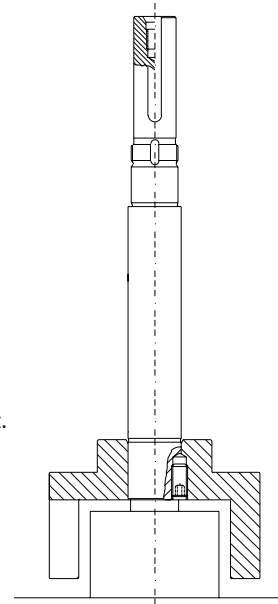

**Note!** Add a correct grade and the appropriate type of grease. Do not overfill.

### 4.5.2 TG GP2-25, TG GP3-32 and TG GP6-40 disassembly

1. First disassemble the flexible coupling half using a coupling extractor.
2. Remove key (1570), set screws (1480) and tap bolts (1540).
3. Remove inner circlips (1500) and the support rings (1510).
4. The bearing housing (1430) can now be removed.
5. Detach bearing bracket (1400) by loosening the screws (1410).
6. Remove outer circlips (1450) from the shaft.
7. Remove the ball bearing (1440) from the shaft.  
Use an appropriate extractor.

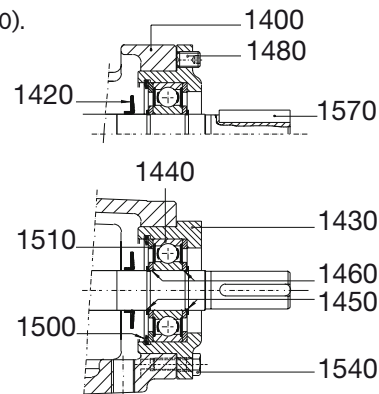


*Disassembly and assembly of rolling bearing TG GP2-25/3-32/6-40*

### 4.5.3 TG GP2-25, TG GP3-32 and TG GP6-40 assembly

1. Assemble bearing bracket (1400) with the screws (1410).
2. Assemble deflector (1420) on the shaft.
3. Fit a new ball bearing (1440) in the bearing housing (1430) together with support rings (1510) and inner circlips (1500).
4. Place one outer circlip (1450) and one support ring (1460) on the shaft.
5. Fit the assembled ball bearing together with the bearing housing on the shaft against the support ring (1460). Push with an appropriate tool on the inner bearing ring. Fit the second support ring (1460) and the second outer circlip (1450) on the shaft.
6. Fit set screws (1480) and tap bolts (1540).
7. Adjust axial clearance (see section 3.22.6).
8. Check position of the deflector (1420) close to the bearing housing. Connect if possible.
9. Fit the key (1570) and the flexible coupling half.

#### 4.5.4 TG GP15-50 to TG GP360-150 disassembly

1. First disassemble the flexible coupling half with the aid of a coupling extractor.
2. Remove key (1570), set screws (1480), tap bolts (1540) and long screws (1530).
3. Remove the outer bearing cover (1470) and the V-seal (1490).
4. Detach bearing bracket (1400) by loosening the screws (1410).
5. Softly tap the lip of the locking washer (1510) out of the groove of the locking nut (1500).
6. Loosen the locking nut (1500) and remove it from the pump shaft.
7. Remove locking washer (1510).
8. Push the inner bearing cover (1430) and the V-seal (1420) away from the bearing.
9. Remove the bearing(s) (1440) from the pump shaft using the appropriate extractor.
10. Disassemble support ring (1460), outer circlips (1450) (only TG GP15-50 to TG GP23-65), inner bearing cover (1430) and V-seal (1420).

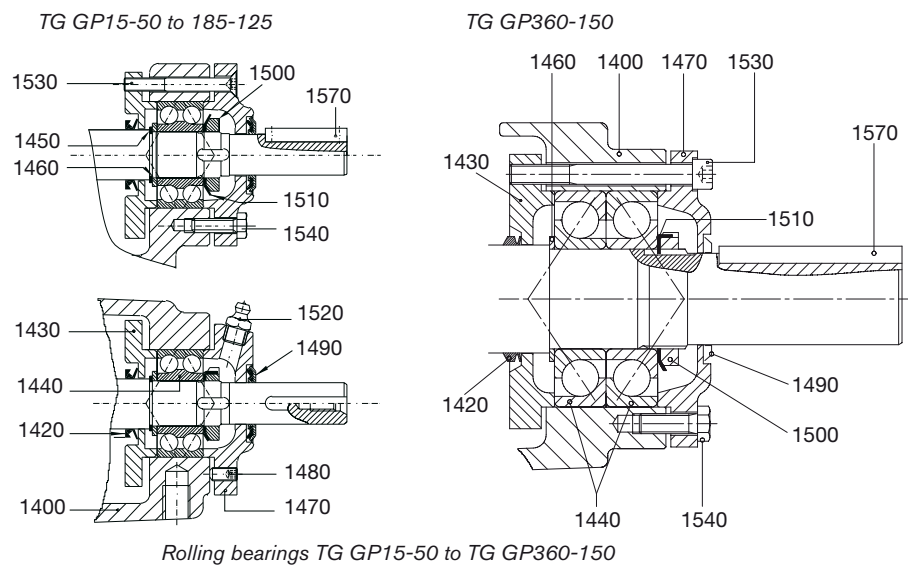

#### 4.5.5 TG GP15-50 to TG GP360-150 assembly


1. Place the V-seal (1420) and the inner bearing cover (1430) on the pump shaft.
2. Fit the outer circlips (1450) (only TG GP15-50 to TG GP23-65) and the support ring (1460) on the pump shaft.
3. Fit a new bearing (1440) on the shaft. Push it against the support ring (1460).
4. In case of TG GP360-150 two ball bearings (1440) are fit paired in O-configuration.
5. Fit a new locking washer (1510).
6. Fit the locking nut (1500) and fix it by folding a lip of the locking washer into one of the grooves of the locking nut (1500).
7. Grease the bearing.
8. Clean the bearing bracket (1400). Fit it on the intermediate casing with the aid of screws (1410).
9. Place both the outer and the inner bearing cover against the bearing. Hold both covers together with the aid of long screws (1530).
10. Fit set screws (1480) and tap bolts (1540).
11. Adjust axial clearance (see section 3.22.6).
12. Fit the V-seal (1490), key (1570) and the flexible coupling half.

## 4.6 Relief valve

- The relief valve may not be disassembled before the spring has been released completely
- **Before releasing the spring, measure the position of the adjusting bolt, so that the spring afterwards can be adjusted to its original opening pressure**

### 4.6.1 Disassembly

- Undo the screws (7310) and the cover (7050).
- Measure and record the exact position of the adjusting bolt (7320). (See dimension H).
- Loosen nut (7330) and adjusting screw (7320) until the spring (7150) has been completely released.
- Remove spring casing (7040) by loosening the screws (7300).
- Spring (7150), valve (7010) and valve seat (7110) are now accessible.

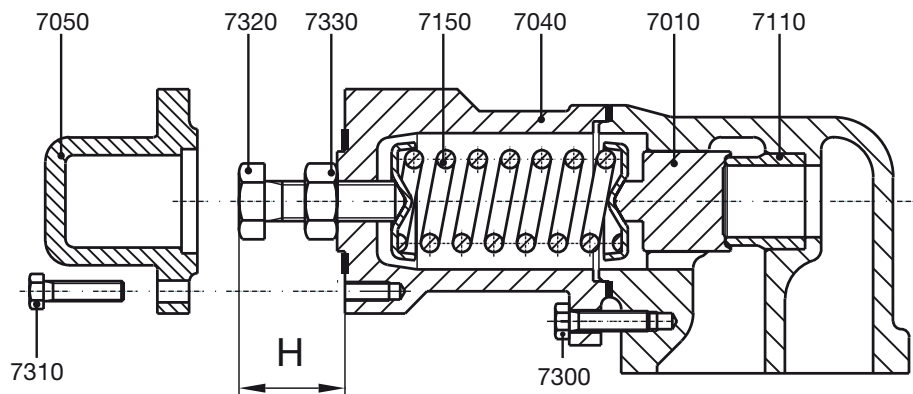

Assembly and disassembly of the safety relief valve

### 4.6.2 Assembly

- Check the sealing face of both valve seat (7110) and valve (7010).
- In case of a slightly damaged surface, this can be rubbed with an appropriate emery paste. In case of severe damage however, valve seat (pay attention to shrink fit) and valve must be replaced.
- Always mount a correct type of spring with the original dimensions and an appropriate adjusting screw (see section 3.18.3).
- Fit spring casing (7040) and bolts (7300).
- Fit adjusting screw (7320) and nut (7330), screwing the adjusting screw to measured distance H.
- Fix this position by tightening the nut (7330).

**Remark:** When another type of spring and/or adjusting bolt is mounted, the opening pressure of the relief valve must be adjusted hydraulically.

- Fit cover (7050) and screws (7310).



## 4.7 Electrical heating


### 4.7.1 General

When replacing a cartridge heater, make sure that the same type of cartridge heater (dimensions, voltage, power, ...) is used.

### 4.7.2 Electrical heating on the pump cover (in the idler pin)

#### 4.7.2.1 Disassembly

- Disconnect the leads of the cartridge heater (0800) from the electronic or electrical power control device.
- Disconnect the flexible conduit (0830) from the electronic or electrical power control device.
- Remove the flexible conduit (0830) from the pump cover (4000) by loosening the enlarger (0840).
- Remove the cartridge heater (0800) by (gently) pulling at the connection leads or at the head of the cartridge heater.

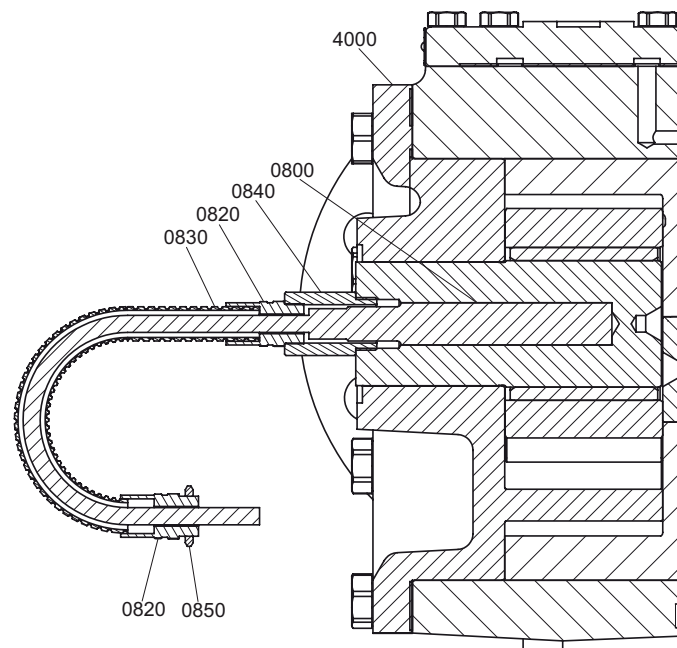


#### 4.7.2.2 Assembly

- Before mounting the cartridge heater (0800), it is absolutely necessary that a copper paste for high temperatures is put on the sheath of the cartridge heater (0800). This ensures a good and equal contact between the cartridge heater (0800) and the idler pin, so that the heat is equally distributed.  
Make sure that the sheath of the cartridge heater (0800) is completely covered with a thin layer of copper paste.  
If the cartridge heater (0800) has a ceramic head, make sure that the copper paste does not get in contact with the ceramic head.
- Mount the cartridge heater (0800) in the bore hole of the idler pin and push it into the bore hole until the end.
- Connect the assembly of the flexible conduit (0830), the fitting type B PG9 (0820) and the enlarger (0840) to the pump cover (4000).
- Connect the leads of the cartridge heater (0800) to the electronic or electrical power control device.
- Connect the flexible conduit (0830) to the electronic or electrical power control device.

### 4.7.3 Electrical heating around shaft seal (in the intermediate casing)

#### 4.7.3.1 Disassembly

- Disconnect the leads of the cartridge heater (0800) from the electronic or electrical power control device.
- Disconnect the flexible conduit (0830) from the electronic or electrical power control device.
- Remove the flexible conduit (0830) from the intermediate casing (0020) by loosening the enlarger (0840).
- Remove the set screw M10x12 (0860).
- Remove the cartridge heater (0800) by (gently) punching it out of the bore hole (from the side where the set screw was situated) by using a punch in tube form that fits into the thread hole. Take care not to damage the bore hole.

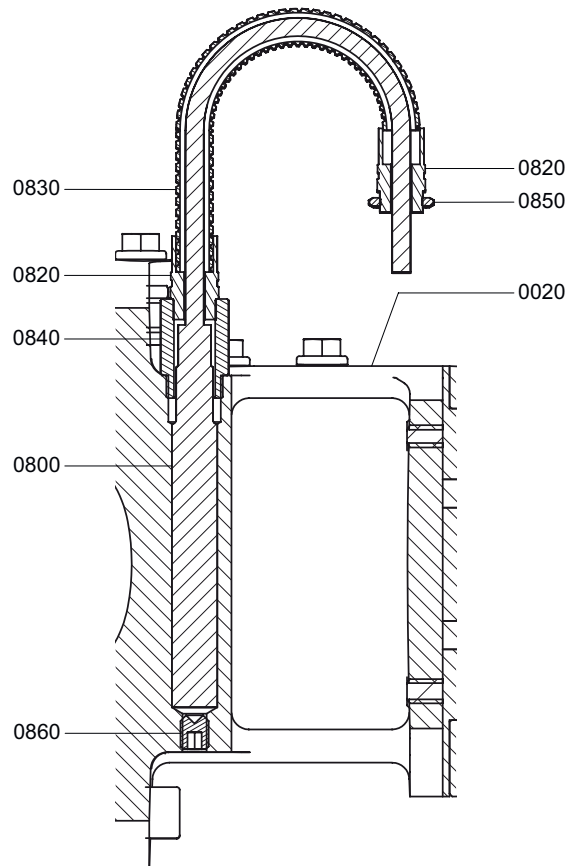

#### 4.7.3.2 Assembly

- Bolt in the set screw M10x12 (0860).
- Before mounting the cartridge heater (0800), it is absolutely necessary that a copper paste for high temperatures is put on the sheath of the cartridge heater (0800). This ensures a good and equal contact between the cartridge heater (0800) and the intermediate casing (0020), so that the heat is equally distributed.  
Make sure that the sheath of the cartridge heater (0800) is completely covered with a thin layer of copper paste.  
If the cartridge heater (0800) has a ceramic head, make sure that the copper paste does not get in contact with the ceramic head.
- Mount the cartridge heater (0800) in the bore hole of the intermediate casing (0020) and push it into the bore hole until the end.
- Connect the assembly of the flexible conduit (0830), the fitting type B PG9 (0820) and the enlarger (0840) to the intermediate casing (0020).
- Connect the leads of the cartridge heater (0800) to the electronic or electrical power control device.
- Connect the flexible conduit (0830) to the electronic or electrical power control device.

## 5.0 Sectional drawings and part lists

### How to order spares


When ordering spare parts, please state:

1. Pump type and serial number (see name plate)
2. Position number, quantity and description

Example:

1. Pump type: TG GP58-80 G2 SS SG2 BG2 TC  
Serial number: 2000-101505
2. Pos 0600, 1, Idler + Bush complete

### 5.1 TG GP2-25 to TG GP6-40

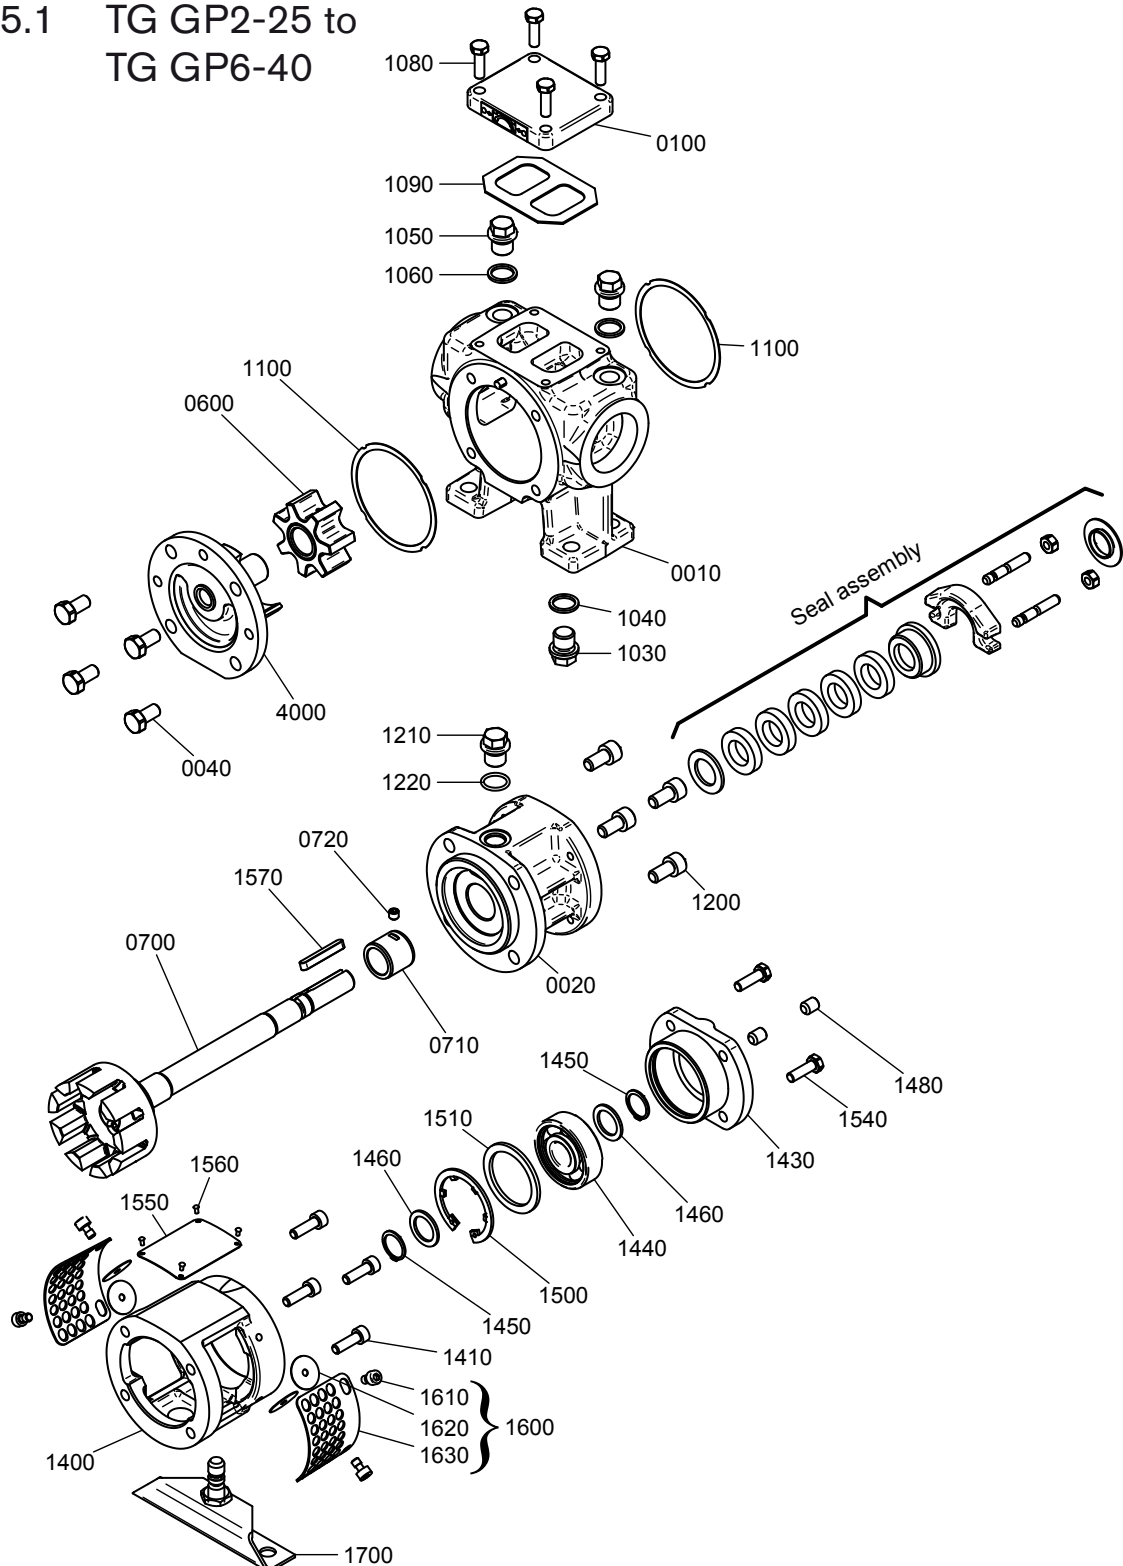

### 5.1.1 Hydraulic part


Pos.	Description	GP2-25	GP3-32	GP6-40	preventive	overhaul
0010	pump casing	1	1	1		
0020	intermediate casing	1	1	1		
0040	tap bolt	4	4	4		
0100	top cover, complete	1	1	1		
0600	idler + bush, complete	1	1	1	x	
0700	rotor + shaft, complete	1	1	1	x	
0710	bush bearing on shaft	1	1	1	x	
0720	set screw	1	1	1		
1030	plug - steel	1	1	1		
1040	sealing ring	1	1	1	x	x
1050	plug - steel	2	2	2		
1060	sealing ring	2	2	2	x	x
1080	tap bolt	4	4	4		
1090	gasket	1	1	1	x	x
1100	gasket	2	2	2	x	x
1200	tap bolt	4	4	4		
1210	plug	1	1	1		
1220	sealing ring	1	1	1	x	x
1570	key	1	1	1	x	x
4000	pump cover + idler pin, complete	1	1	1	x	

### 5.1.2 Bearing bracket

Pos.	Description	GP2-25	GP3-32	GP6-40	preventive	overhaul
1400	bearing bracket	1	1	1		
1410	cap head screw	4	4	4		
1430	bearing housing	1	1	1		
1440	ball-bearing	1	1	1	x	x
1450	circlip	2	2	2		
1460	support ring	2	2	2		
1480	set screw	2	2	2		
1500	circlip	1	1	1		
1510	support ring	1	1	1		
1540	tap bolt	2	2	2		
1550	nameplate	1	1	1		
1560	rivet	4	4	4		
1600	mesh guard, complete	2	2	2		
1610	<i>Savetix® cap head screw - st. steel</i>	4	4	4		
1620	<i>Savetix® washer - st. steel</i>	4	4	4		
1630	<i>mesh guard - st. steel</i>	2	2	2		
1700	bracket support, complete	1	1	1		


### 5.1.3 Flange connection options

Pos.	Description	GP2-25 GP3-32 GP6-40	preventive	overhaul
0010	G1: pump casing	1		
0050	pin - steel	1		
<b>Screwed on flanges (optionally)</b>				
9000	screw on flanges	1		
0060	collar piece	2		
0070	loose flange	2		

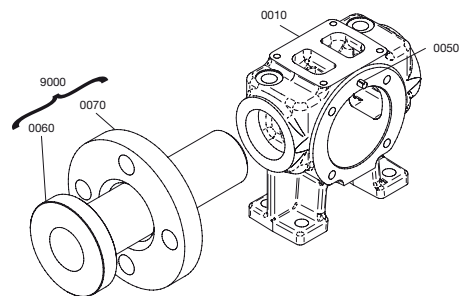


## 5.1.4 Jacket options

### 5.1.4.1 Jacket option on pump cover

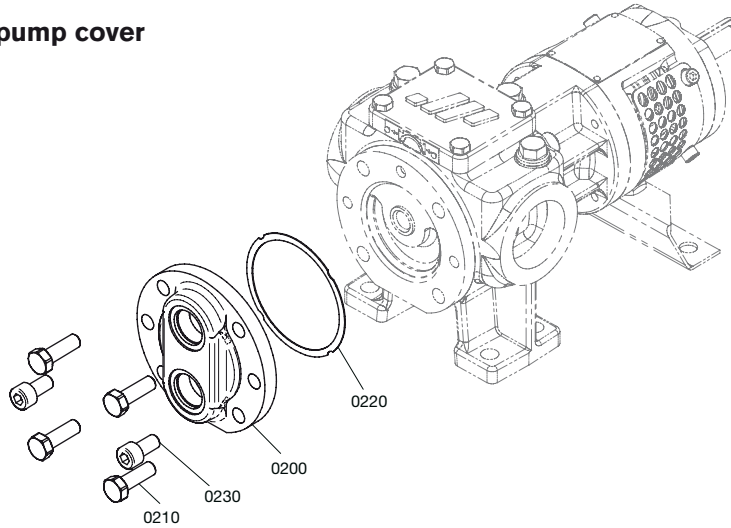


Pos.	Description	GP2-25	GP3-32	GP6-40	preventive	overhaul
0200	jacket cover	1	1	1		
0210	tap bolt	4	4	4		
0220	gasket	1	1	1	x	x
0230	cap head screw	2	2	2		

### 5.1.4.2 Jacket option around shaft seal

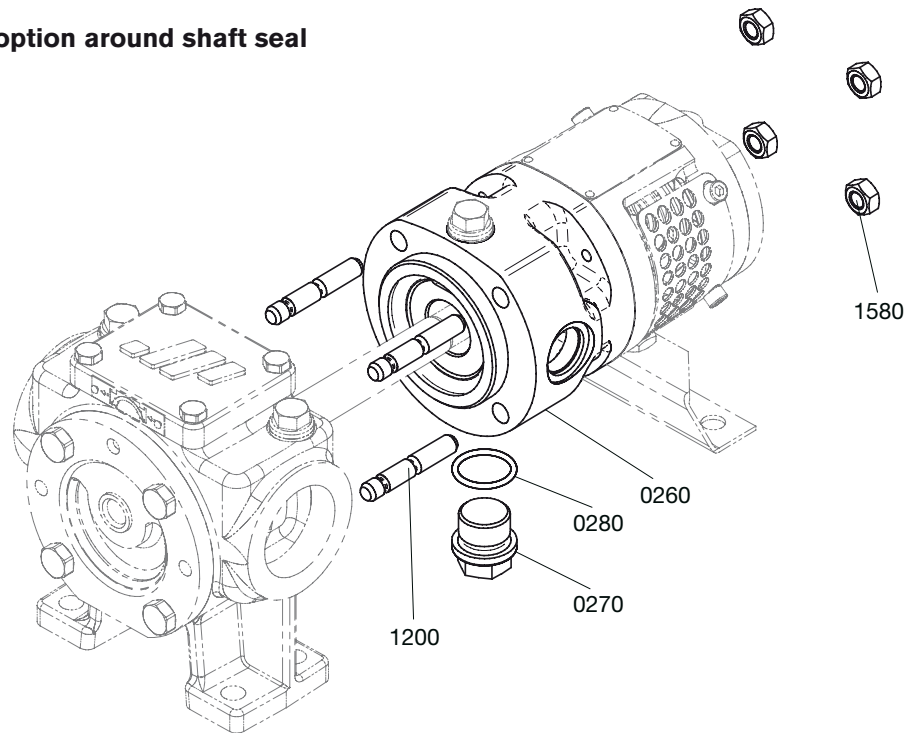


Pos.	Description	GP2-25	GP3-32	GP6-40	preventive	overhaul
0260	intern casing with jacket	1	1	1		
0270	plug	1	1	1		
0280	sealing ring	1	1	1	x	x
1200	stud bolt	4	4	4		
1580	nut	4	4	4		

### 5.1.5 Seal option: Packing rings PO

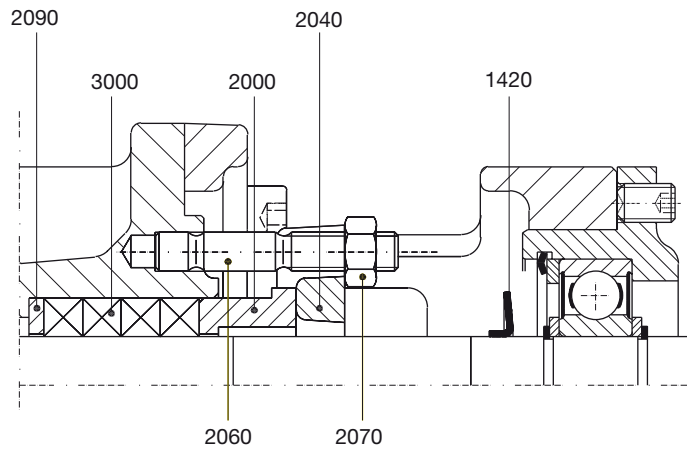

Pos.	Description	GP2-25	GP3-32	GP6-40	preventive	overhaul
1420	deflector	1	1	1		
2000	follower	1	1	1		
2040	gland	1	1	1		
2060	stud bolt	2	2	2		
2070	nut	2	2	2		
2090	bottom ring	1	1	1		
3000	packing ring	5	5	4	x	x

## 5.2 TG GP15-50 to TG GP360-150

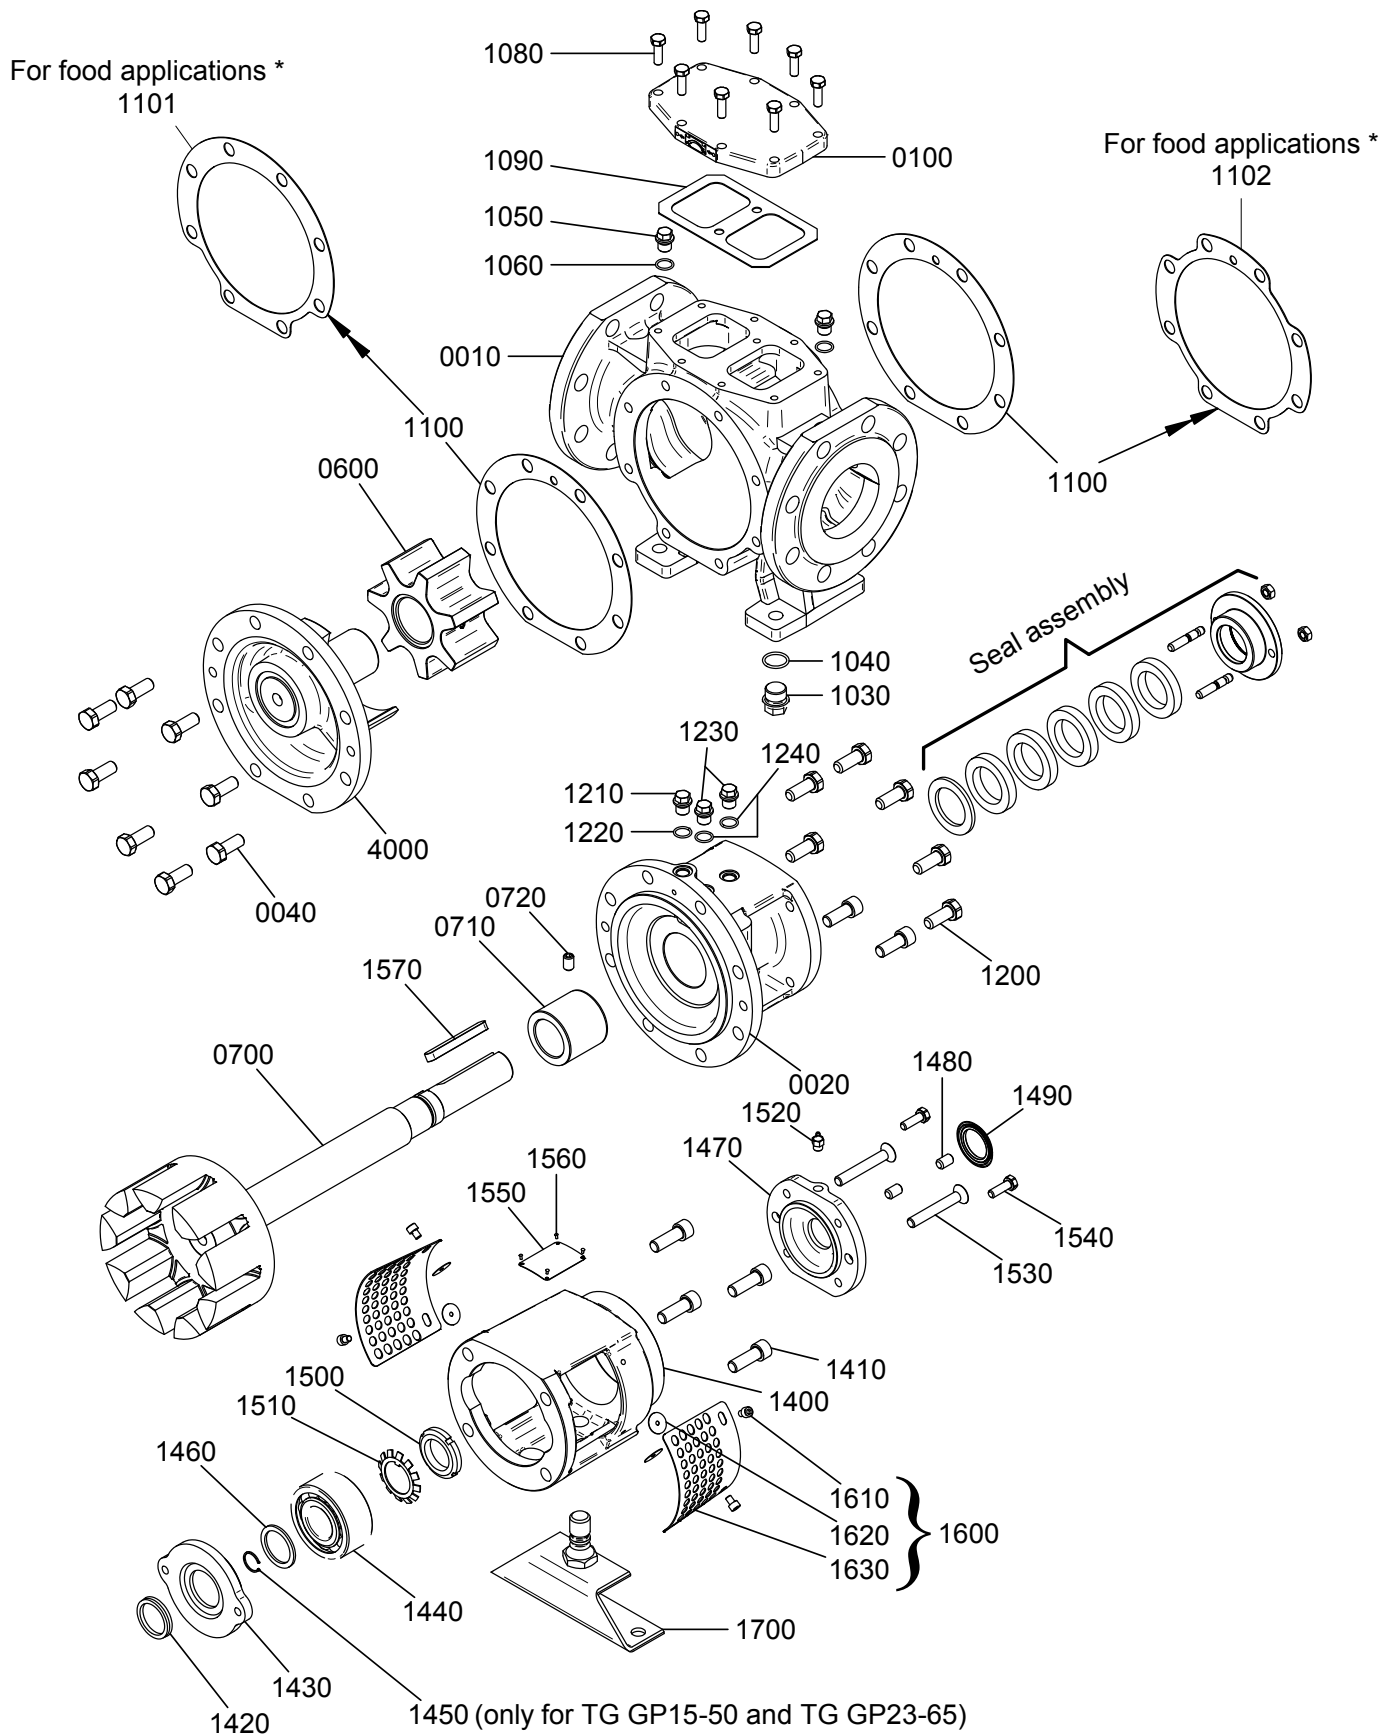

\* for food applications: shape of gaskets follows the shape of the pump casing

## 5.2.1 Hydraulic part

Pos.	Description	GP15-50	GP23-65	GP58-80	GP86-100	GP120-100	GP185-125	GP360-150	Preventive	Overhaul
0010	pump casing	1	1	1	1	1	1	1		
0020	Intermediate casing	1	1	1	1	1	1	1		
0040	tap bolt	6	6	8	8	8	8	12		
0100	top cover, complete	1	1	1	1	1	1	1		
0600	idler + bush, complete	1	1	1	1	1	1	1	x	
0700	rotor + shaft, complete	1	1	1	1	1	1	1	x	
0710	bush bearing, on shaft	1	1	1	1	1	1	1	x	
0720	set screw	1	1	1	1	1	1	1		
1030	plug	1	1	1	1	1	1	1		
1040	sealing ring	1	1	1	1	1	1	1	x	x
1050	plug	2	2	2	2	2	2	2		
1060	sealing ring	2	2	2	2	2	2	2	x	x
1080	tap bolt	8	8	8	8	8	8	8		
1090	gasket	1	1	1	1	1	1	1	x	x
1100*	gasket	2	2	2	2	2	2	2	x	x
1101*	<i>gasket</i>	1	1	1	1	1	1	1	x	x
1102*	<i>gasket</i>	1	1	1	1	1	1	1	x	x
1200	tap bolt	6	6	8	8	8	8	12		
1210	plug	1	1	1	1	1	1	1		
1220	sealing ring	1	1	1	1	1	1	1	x	x
1230	plug	1	1	2	2	2	2	2		
1240	sealing ring	1	1	2	2	2	2	2	x	x
1570	key	1	1	1	1	1	1	1	x	x
4000	pump cover + idler pin, complete	1	1	1	1	1	1	1	x	

\* pos. 1100 applies for non-food pumps (2x per pump)  
 pos. 1101 and 1102 applies for food pumps (1 of each per pump)


## 5.2.2 Bearing bracket

Pos.	Description	GP15-50	GP23-65	GP58-80	GP86-100	GP120-100	GP185-125	GP360-150	Preventive	Overhaul
1400	bearing bracket	1	1	1	1	1	1	1		
1410	cap head screw	4	4	4	4	4	4	4		
1420	V-seal	1	1	1	1	1	1	1	x	x
1430	bearing cover	1	1	1	1	1	1	1		
1440	ball-bearing - steel & metal cage	1	1	1	1	1	1	2	x	x
1450	circlip	1	1	-	-	-	-	-		x
1460	support ring	1	1	1	1	1	1	1		
1470	bearing cover	1	1	1	1	1	1	1		
1480	set screw	2	2	2	2	2	2	4		
1490	V-seal	1	1	1	1	1	1	1	x	x
1500	locking nut	1	1	1	1	1	1	1		
1510	locking washer	1	1	1	1	1	1	1	x	x
1520	grease nipple	1	1	1	1	1	1	1		
1530	countersunk screw cap head screw	2 -	2 -	2 -	2 -	2 -	2 -	- 4		
1540	tap bolt	2	2	2	2	2	2	4		
1550	nameplate	1	1	1	1	1	1	1		
1560	rivet	4	4	4	4	4	4	4		
1600	mesh guard, complete	2	2	2	2	2	2	2		
1610	<i>Savetix® cap head screw - st. steel</i>	4	4	4	4	4	4	4		
1620	<i>Savetix® washer - st. steel</i>	4	4	4	4	4	4	4		
1630	<i>mesh guard - st. steel</i>	2	2	2	2	2	2	2		
1700	bracket support, complete	1	1	1	1	1	1	1		




## 5.2.3 Jacket options and electrical heating

### 5.2.3.1 Jacket on pump cover

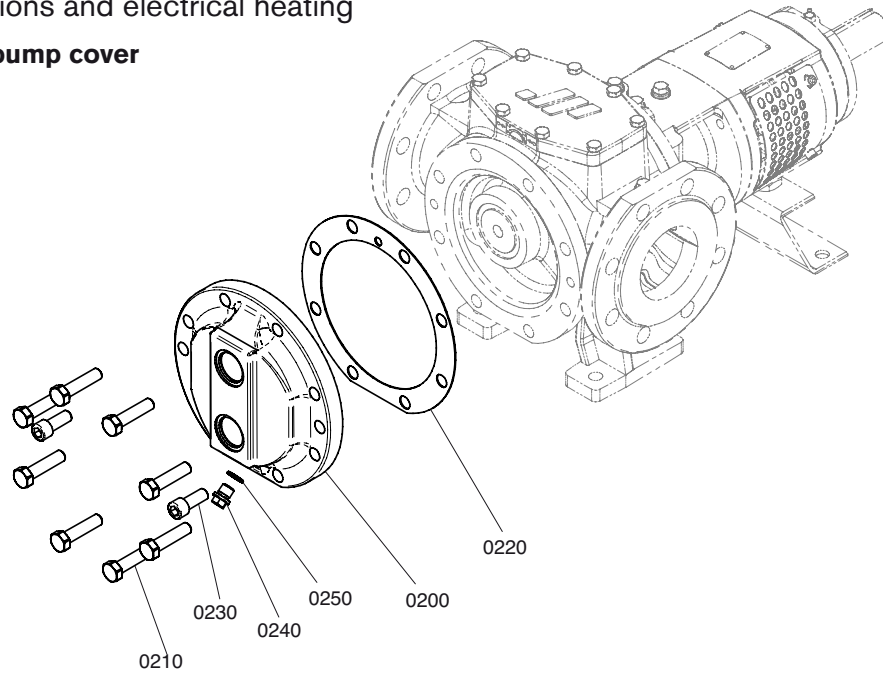

Pos.	Description	GP15-50	GP23-65	GP58-80	GP86-100	GP120-100	GP185-125	GP360-150	preventive	overhaul
0200	jacket cover	1	1	1	1	1	1	1		
0210	tap bolt	6	6	8	8	8	8	12		
0220	gasket	1	1	1	1	1	1	1	x	x
0230	cap head screw	2	2	2	2	2	4	6		
0240	plug	–	–	1	1	1	1	1		
0250	sealing ring	–	–	1	1	1	1	1	x	x

### 5.2.3.2 Jacket around the shaft seal

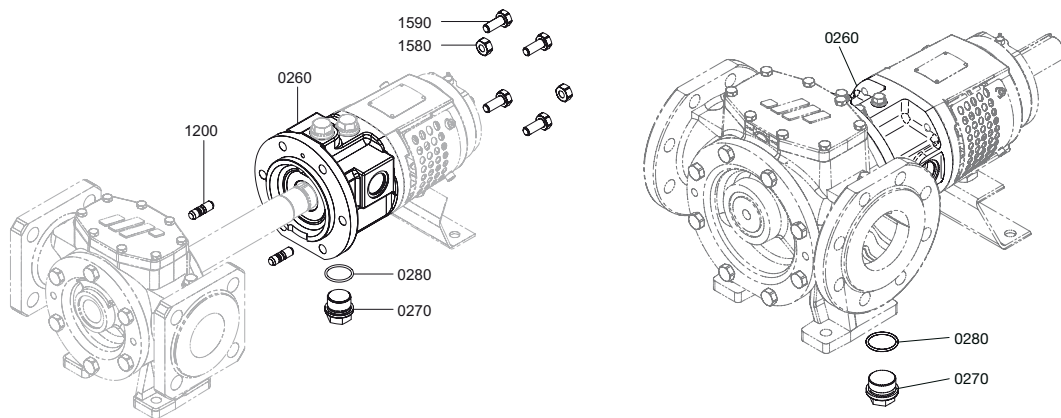


TG GP15-50 and TG GP23-65

TG GP58-80 to TG GP360-150

Pos.	Description	GP15-50	GP23-65	GP58-80	GP86-100	GP120-100	GP185-125	GP360-150	preventive	overhaul
0260	Intermediate casing	1	1	1	1	1	1	1		
0270	plug	1	1	1	1	1	1	1		
0280	sealing ring	1	1	1	1	1	1	1	x	x
1200	stud bolt	2	2	–	–	–	–	–		
1580	nut	2	2	–	–	–	–	–		
1590	screw	4	4	–	–	–	–	–		


### 5.2.3.3 Electrical heating on the pump cover (in the idler pin)

Version E1 / E2 / E3 / E4 / E5 / E6

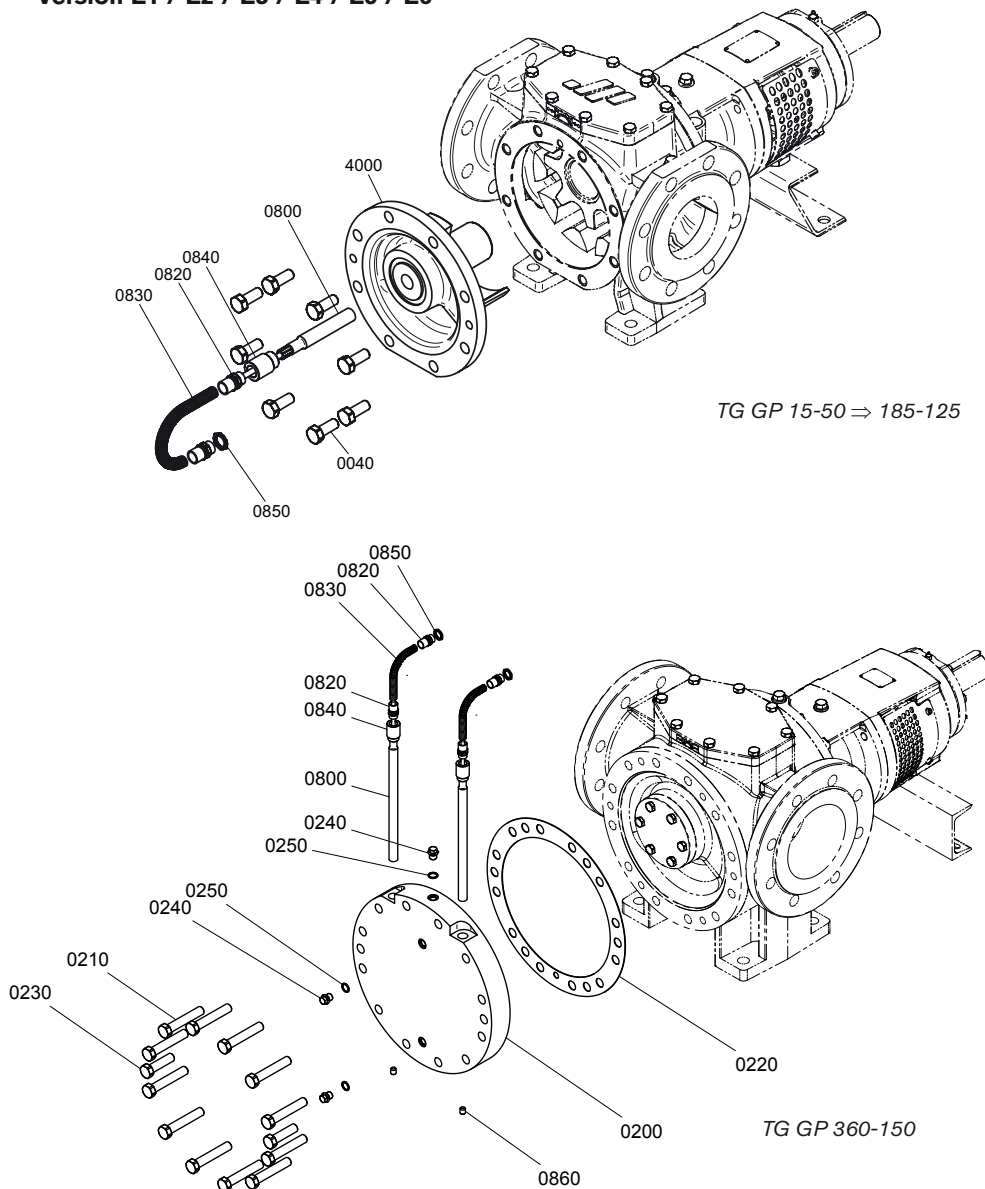



Pos.	Description	Version	GP15-50	GP23-65	GP58-80	GP86-100	GP120-100	GP185-125	GP360-150	Preventive	Overhaul
0040	Tap bolt	E1 - E6	6			8			-		
0200	Heating plate pump cover	E1 - E6			-				1		
0210	Tap bolt	E1 - E6			-				12		
0220	Gasket	E1 - E6			-				1	x	x
0230	Tap bolt	E1 - E6			-				2		
0240	Plug	E1 - E6			-				3		
0250	Sealing ring	E1 - E6			-				3	x	x
0800	Electrical heating cartridge	E1			1				2		
		E2			1				2		
		E3	-			1			2		
		E4	-			1			2		
		E5	-			1			2		
		E6	-			1			2		
0820	Fitting type B PG9	E1 - E6			2				4		
0830	Flexible conduit	E1 - E6			1 x 1m				2 x 1m		
0840	Enlarger	E1 - E6			1				2		
0850	Metallic lock nut	E1 - E6			1				2		
0860	Set screw	E1 - E6			-				2		
4000	Pump cover + idler pin, complete	E1 - E6				1				x	

**5.2.3.4 Electrical heating around shaft seal (in the intermediate casing)**  
**Version E1 / E2 / E3 / E4 / E5 / E6**

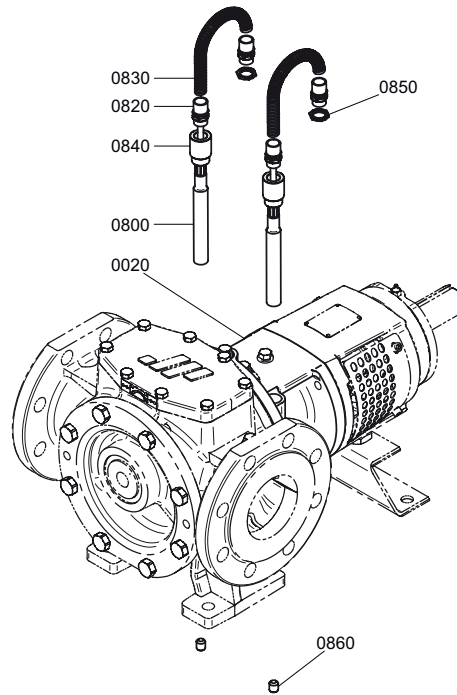

Pos.	Description	Version	GP58-80	GP86-100	GP120-100	GP185-125	GP360-150	Preventive	Overhaul
0020	Intermediate casing - cast iron	E1 - E6			1				
0800	Electrical heating cartridge	E1 - E6			2				
0820	Fitting type B PG9	E1 - E6			4				
0830	Flexible conduit	E1 - E6			2 x 1 m				
0840	Enlarger	E1 - E6			2				
0850	Metallic lock nut	E1 - E6			2				
0860	Set screw M10x12 DIN916 A4	E1 - E6			2				

## 5.2.4 Seal options: Packing rings PO

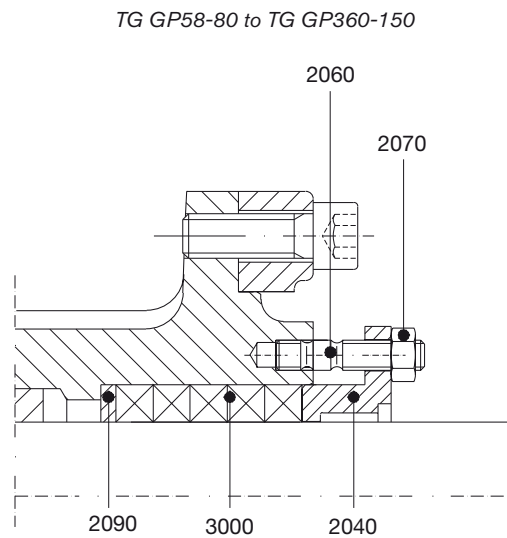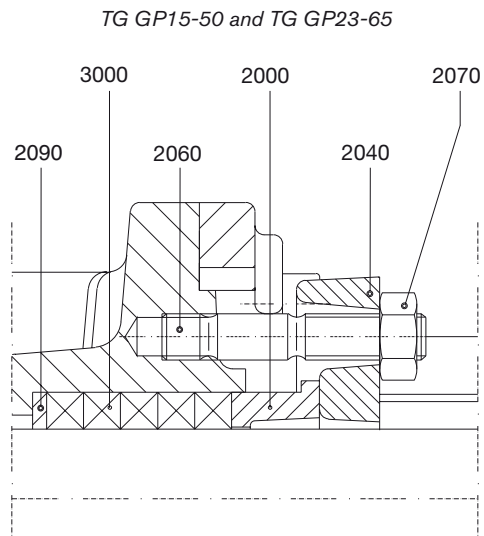


Pos.	Description	GP15-50	GP23-65	GP58-80	GP86-100	GP120-100	GP185-125	GP360-150	preventive	overhaul
2000	follower	1	1	–	–	–	–	–		
2040	gland	1	1	1	1	1	1	1		
2060	stud bolt	2	2	2	2	2	2	2		
2070	nut	2	2	2	2	2	2	2		
2090	bottom ring	1	1	1	1	1	1	1		
3000	packing ring	5	5	5	5	5	5	5	x	x

## 6.0 Dimensional drawings


### 6.1 Standard pump

#### 6.1.1 TG GP2-25 to TG GP6-40

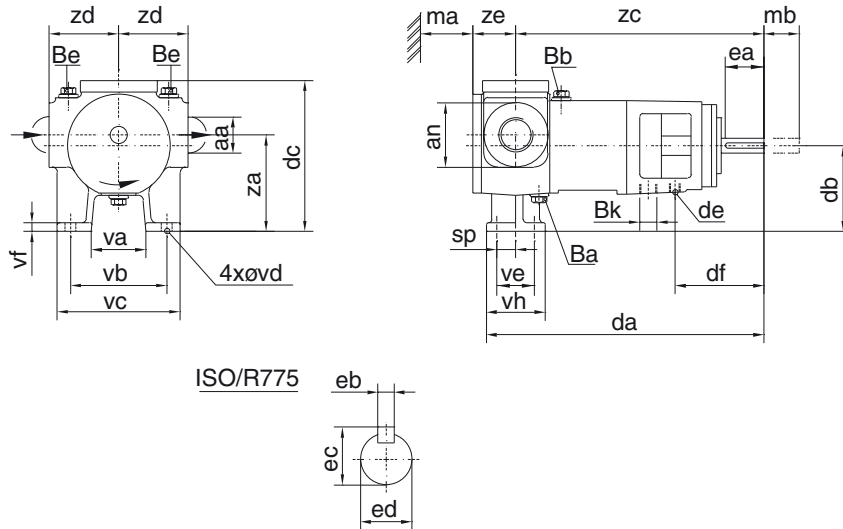

	<b>TG GP2-25</b>	<b>TG GP3-32</b>	<b>TG GP6-40</b>
aa	G 1	G 1 1/4	G 1 1/2
an	60	70	
Ba	G 1/4	G 1/4	
Be	G 1/4	G 1/4	
Bk	Rp 3/8	Rp 3/8	
da	246	293	
db	80	100	
dc	147	179	
de	M10	M12	
df	81	88	
ea	39	40	
eb	5 h9	6 h9	
ec	18	21.5	
ed	16 j6	19 j6	
ma	50	60	
mb	50	60	
sp	17.5	22	
va	51	53	
vb	90	100	
vc	115	127	
vd	10	12	
ve	35	45	
vh	55	70	
za	90	110	
zc	218	258	
zd	65	80	
ze	46	54	


## 6.1.2 TG GP15-50 to TG GP360-150

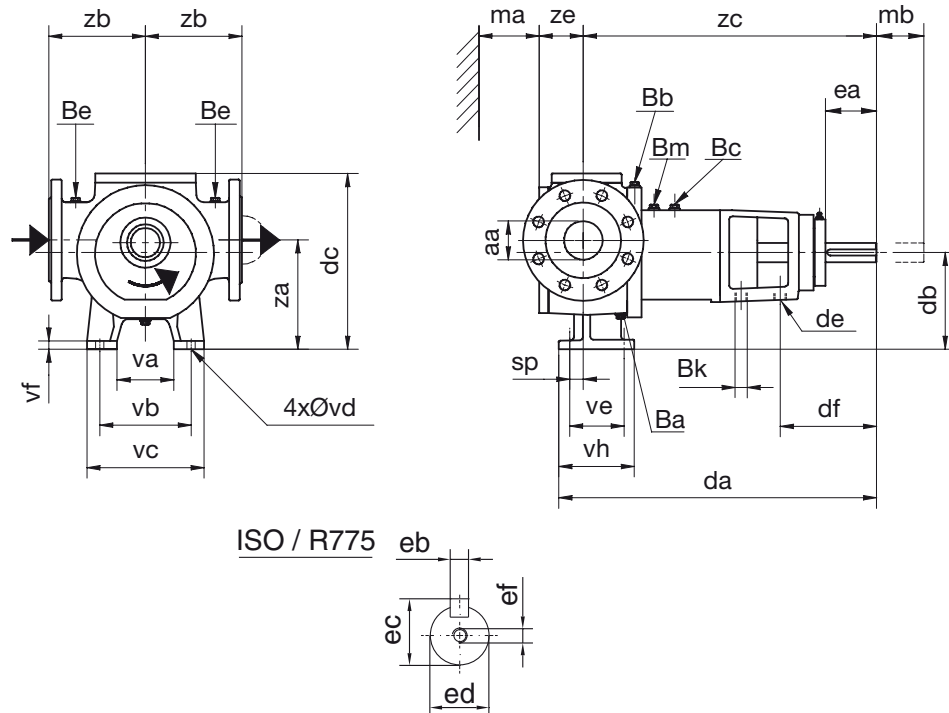

	TG GP15-50	TG GP23-65	TG GP58-80	TG GP86-100	TG GP120-100	TG GP185-125	TG GP 360-150
aa	50	65	80	100	100	125	150
Ba	G 1/4	G 1/4	G 1/2	G 1/2	G 1/2	G 1/2	G 3/4
Bb	G 1/2	G 1/2	G 1/4	G 1/4	G 1/4	G 1/4	G 1/2
Bc	G 1/2	G 1/2	G 1/4	G 1/4	G 1/4	G 1/4	G 1/4
Be	G 1/4	G 1/4	G 1/4	G 1/4	G 1/4	G 1/4	G 1/4
Bk	Rp 1/2	Rp 1/2	Rp 3/4	Rp 3/4	Rp 3/4	Rp 3/4	Rp 3/4
Bm	-	-	G 1/4	G 1/4	G 1/4	G 1/4	G 1/4
da	389	400	493	526	526	633	774
db	112	112	160	160	160	200	250
dc	209	219	297	315	315	380	468
de	M16	M16	M20	M20	M20	M20	M20
df	126	126	159	162	162	204	199
ea	60	60	80	80	80	110	110
eb	8 h9	8 h9	10 h9	10 h9	10 h9	14 h9	16 h9
ec	31	31	35	40	40	51.5	59
ed	28 j6	28 j6	32 k6	37 k6	37 k6	48 k6	55 m6
ef	M10	M10	M12	M12	M12	M16	M20
ma	75	80	105	125	140	155	200
mb	75	80	100	115	115	155	185
sp	15	26	22.5	32	32	30.5	85
va	70	80	100	100	100	120	160
vb	120	130	160	160	160	200	270
vc	150	160	200	200	200	260	330
vd	12	12	14	14	14	18	22
ve	60	60	90	90	90	125	180
vf	14	14	17	17	17	22	24
vh	90	90	125	125	125	170	230
za	125	125	180	185	185	230	300
zb	125	125	160	180	180	200	240
zc	359	359	453	476	476	580	664
ze	61	70	81	91	106	116	146


## 6.2 Flange connections

### 6.2.1 TG GP2-25 to TG GP6-40

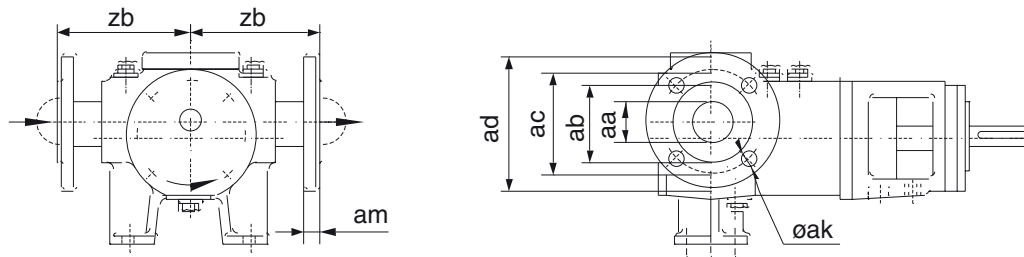

	TG GP2-25	TG GP3-32	TG GP6-40
aa	25	32	40
ab	65	76	84
ac PN16	85	100	110
ac PN20	79.5	89	98.5
ad PN16	115	140	150
ad PN20	110	120	130
ak PN16	4xd14	4xd18	4xd18
ak PN20	4xd16	4xd16	4xd16
am PN16	30	32	32
am PN20	30	32	33
zb	190	220	200

### 6.2.2 TG GP15-50 to TG GP360-150

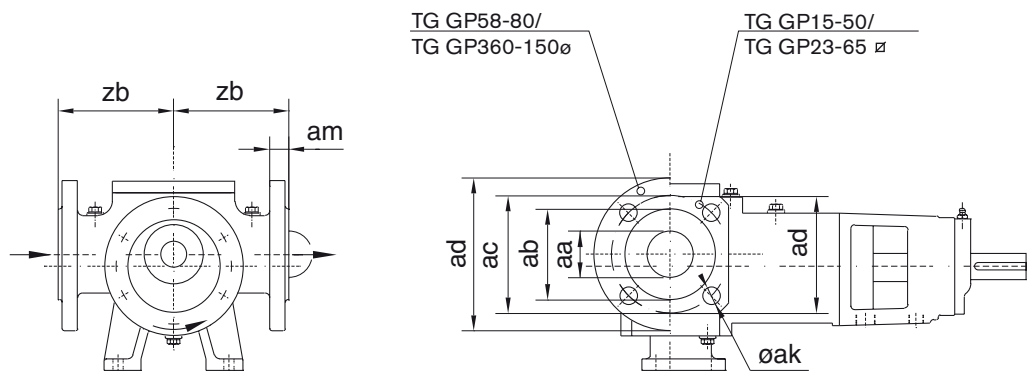


	TG GP15-50	TG GP23-65	TG GP58-80	TG GP86-100	TG GP120-100	TG GP185-125	TG GP360-150
aa	50	65	80	100	100	125	150
ab	100	118	135	153	153	180	212
ac PN16	125	145	160	180	180	210	241
ac PN20	120.6	139.7	152.5	190.5	190.5	216	241
ad	125 *)	145 *)	200	220	220	250	310
ak PN16	4xd18	4xd18	8xd18	8xd18	8xd18	8xd18	8xd23
ak PN20	4xd18	4xd18	4xd18	8xd19	8xd19	8xd22	8xd23
am	21	21	24	25	25	28	30
zb	125	125	160	180	180	200	240

\*) Square flanges instead of rounded flanges

## 6.3 Jackets – Electrical heating


### 6.3.1 Jackets TG GP2-25 to TG GP6-40

Jackets (SS) with thread connections on pump cover and around shaft seal

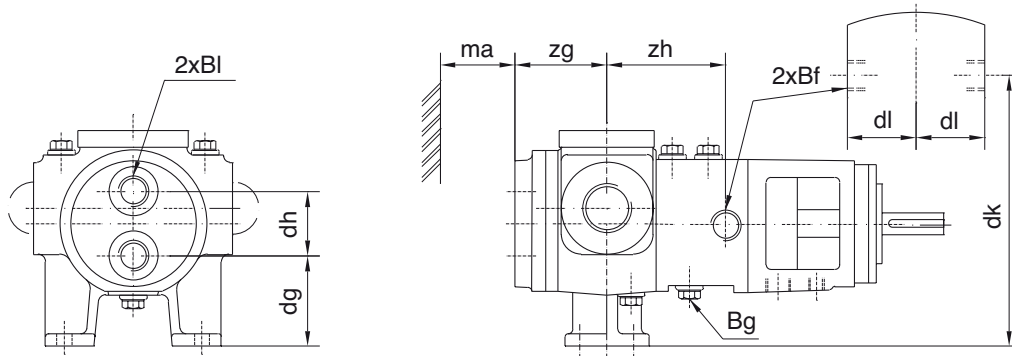


Single jacket (SO) with thread connection on pump cover

**SO**



Single jacket (OS) with thread connection around shaft seal

**OS**

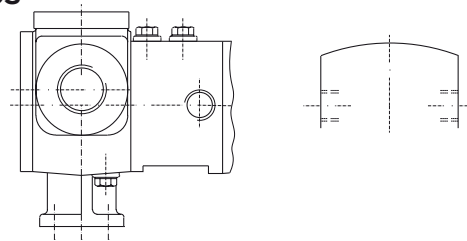


	TG GP2-25	TG GP3-32	TG GP6-40
Bf	G 1/2		G 3/4
Bg	G 1/2		G 3/4
Bl	G 1/2		G 3/4
dg	59		75
dh	42		50
dk	80		100
dl	45		56
ma	50		60
zg	61		76
zh	52		70




### 6.3.2 Jackets TG GP15-50 to TG GP360-150

Jackets (SS) with thread connections on pump cover and around shaft seal

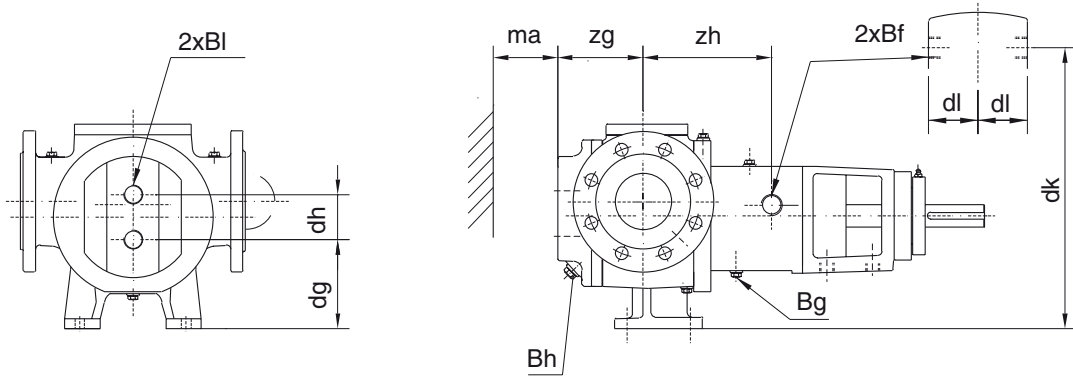


Single jacket (SO) with thread connection on pump cover

**SO**



Single jacket (OS) with thread connection around shaft seal


**OS**

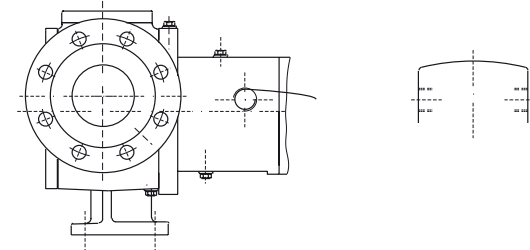

	TG GP15-50	TG GP23-65	TG GP58-80	TG GP86-100	TG GP120-100	TG GP185-125	TG GP360-150
Bf	G3/4	G 3/4	G 1	G 1	G 1	G 1	G 1
Bg	G3/4	G 3/4	G 1	G 1	G 1	G 1	G 1
Bh	-	-	G 1/4	G 1/4	G 1/4	G 1/4	G 1/4
Bl	G 3/4	G 3/4	G 1	G 1	G 1	G 1	G 1
dg	87	87	121	115	115	135	175
dh	50	50	78	90	90	130	150
dk	132	132	160	160	160	200	250
dl	61	61	79	82	82	117	120
ma	75	80	105	125	140	155	200
zg	85	96	123	140	155	163	200
zh	111	111	154	174	174	211	222



### 6.3.3 Electrical heating

Electrical heating on the pump cover (in the idler pin) and around the shaft seal (in the intermediate casing) = E..E..

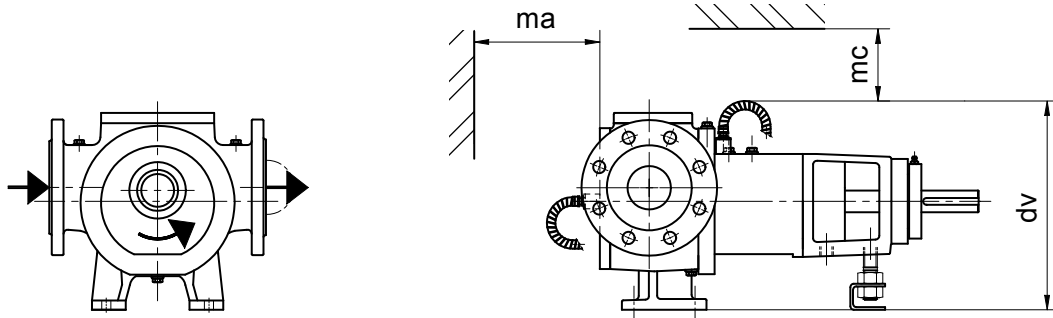

Electrical heating on the pump cover (in the idler pin) = E..O





Electrical heating around the shaft seal (in the intermediate casing) = OE..

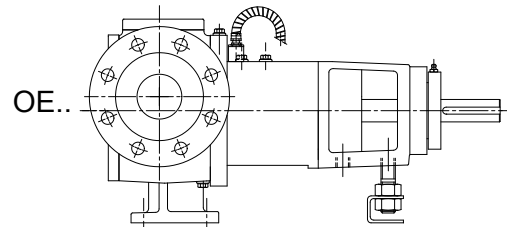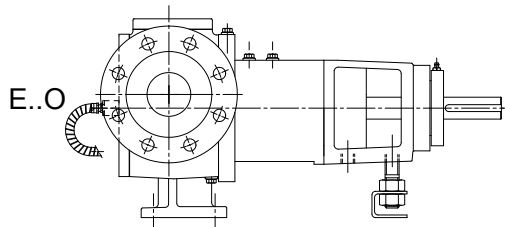



	GP15-50	GP23-65	GP58-80	GP86-100	GP120-100	GP185-125
ma	178	183	208	228	243	258
dv	-	-	333	338	338	403
mc	-	-	152	152	152	152

## 6.4 Safety relief valves



### 6.4.1 Single safety relief valve

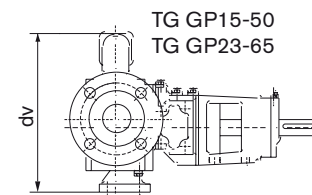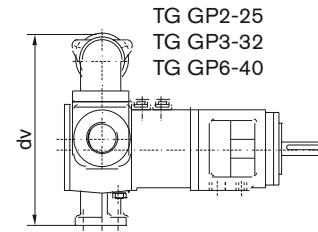



TG GP pump size	dv	mc	tg
2-25			
3-32	202	40	145
6-40	234	40	145
15-50	290	50	200
23-65	300	50	200
58-80	550	70	-
86-100	576	70	-
120-100	576	70	-
185-125	641	70	-
360-150	849	80	-




### 6.4.2 Double safety relief valve

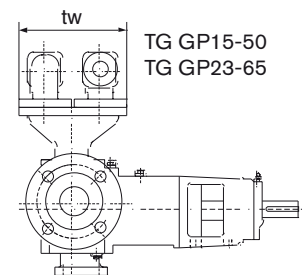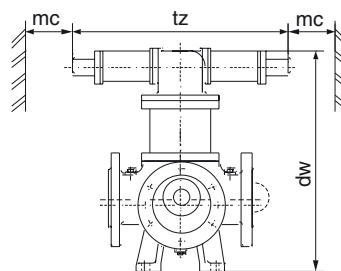

TG GP pump size	dw	mc	tv	tw	tz
15-50	390	50	-	184	400
23-65	400	50	-	184	400
58-80	661	70	178	238	-
86-100	697	70	219	300	-
120-100	697	70	219	300	-
185-125	762	70	219	300	-

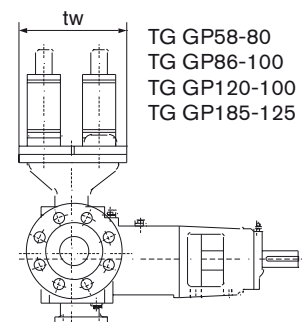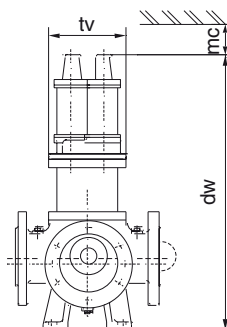


### 6.4.3 Heated safety relief valve

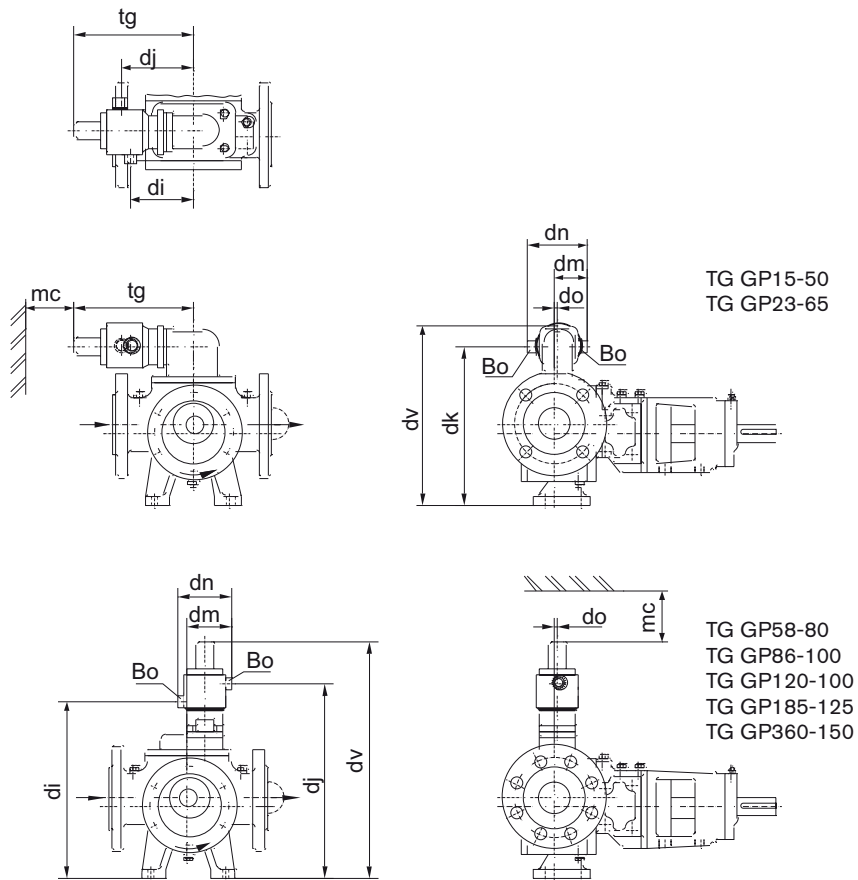

	TG GP15-50	TG GP23-65	TG GP58-80	TG GP86-100	TG GP120-100	TG GP185-125	TG GP360-150
Bo	G 1/2	G 1/2	G 1/2	G 1/2	G 1/2	G 1/2	G 1/2
di	101	101	418	444	444	509	618
dj	119	119	458	484	484	549	738
dk	253	263	-	-	-	-	-
dm	62	59.5	98.5	103.5	103.5	103.5	135
dn	115	115	127	127	127	127	170
do	6.5	4	6	8	8	24	-
dv	290	300	550	576	576	641	849
mc	50	50	70	70	70	70	80
tg	200	200	-	-	-	-	-

## 6.5 Bracket support

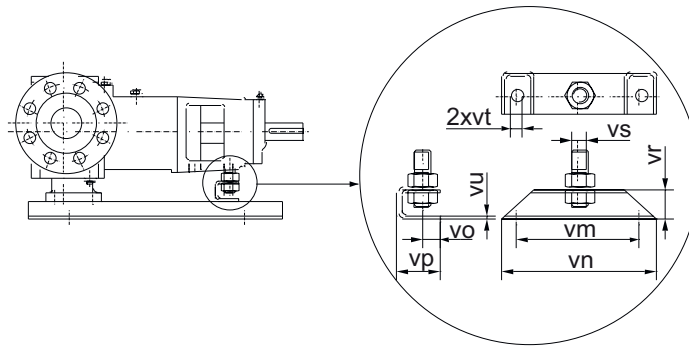

	TG GP2-25 TG GP3-32	TG GP6-40	TG GP15-50	TG GP23-65	TG GP58-80	TG GP86-100	TG GP120-100	TG GP185-125	TG GP360-150
vm	90	100	120	120	160	160	160	200	270
vn	118	130	150	150	195	195	195	250	310
vo	10	17	17	17	20	20	20	20	20
vp	25	40	40	40	50	50	50	50	50
vr	20	30	30	30	50	50	50	50	100
vs	M10	M12	M16	M16	M20	M20	M20	M20	M20
vt	10	12	12	12	14	14	14	14	18
vu	2	3	3	3	4	4	4	4	9

## 6.6 Weights – Mass

	Version	Mass	Weight	TG GP2-25	TG GP3-32	TG GP6-40	TG GP15-50
Pump (without jackets)		kg	daN	8	8	14	30
Front-Pull out (pump cover+idler)		kg	daN	1	1	1.6	3
Back-Pull out (shaft+interm.casing+bracket)		kg	daN	6	6	10	20
Screw on flanges (supplement)		kg	daN	5	5	8	–
Jackets (supplement)	SO	kg	daN	1	1	1	3
	SS	kg	daN	2	2	2	4.5
	OS	kg	daN	1	1	1	1.5
Relief valve (supplement)		kg	daN	2	2	2	5
Double relief valve (supplement)		kg	daN	–	–	–	13

	Version	Mass	Weight	TG GP23-65	TG GP58-80	TG GP86-100	TG GP120-100	TG GP185-125	TG GP360-150
Pump (without jackets)		kg	daN	34	63	82	93	146	263
Front-Pull out (pump cover+idler)		kg	daN	4	10	13	17	26	60
Back-Pull out (shaft+interm.casing+bracket)		kg	daN	22	45	50	42	90	116
Screw on flanges (supplement)		kg	daN	–	–	–	–	–	–
Jackets (supplement)	SO	kg	daN	3	9	9	7	10	16
	SS	kg	daN	4.5	13	13	7	15	20
	OS	kg	daN	1.5	4	4	0	5	7
Relief valve (supplement)		kg	daN	5	7	10	10	10	23
Double relief valve (supplement)		kg	daN	13	24	36	36	36	–

**Manufacturer**

SPX Flow Technology Belgium NV  
Evenbroekveld 2-6  
BE-9420 Erpe-Mere  
Belgium

We hereby certify the compliance of the materials coming into contact with food during the intended use with the general requirements as of the date of this Declaration of

**Regulation (EC) No 1935/2004 of 27 October 2004 on materials and articles intended to come into contact with food and repealing Directives 80/590/EEC and 89/109/EEC.**

This Declaration applies to the following product(s):

Product: **TopGear internal gear pump**  
Configurations:

**TG GP xx-xx FD G# OS UG6 UG6 AW**  
**TG GP xx-xx FD G# OS UR6 UR6 AW**  
**TG GP xx-xx FD G# SS UG6 UG6 AW**  
**TG GP xx-xx FD G# SS UR6 UR6 AW**  
**TG GP xx-xx FD G# OS SG2 SG2 AW**  
**TG GP xx-xx FD G# OS UG6 SG2 AW**  
**TG GP xx-xx FD G# SS SG2 SG2 AW**  
**TG GP xx-xx FD G# SS UG6 SG2 AW**

**TG GM yy-yy FD G# OO SG2 BG2 PRAW**  
**TG GM yy-yy FD G# OO UG6 BG2 PRAW**  
**TG GM yy-yy FD G# OO UR6 BR6 PRAW**  
**TG GM yy-yy FD G# OO SG2 SG2 GS WV**  
**TG GM yy-yy FD G# OO UR6 UR8 GS WV**  
**TG GM yy-yy FD G# OO UG6 SG2 GS WV**

**TG GM xx-xx FD G# OS SG2 BG2 PRAW**  
**TG GM xx-xx FD G# OS UG6 BG2 PRAW**  
**TG GM xx-xx FD G# OS UR6 BR6 PRAW**  
**TG GM xx-xx FD G# OS SG2 SG2 GS WV**  
**TG GM xx-xx FD G# OS UR6 UR8 GS WV**  
**TG GM xx-xx FD G# OS UG6 SG2 GS WV**

**TG GM xx-xx FD G# SS SG2 BG2 PRAW**  
**TG GM xx-xx FD G# SS UG6 BG2 PRAW**  
**TG GM xx-xx FD G# SS UR6 BR6 PRAW**  
**TG GM xx-xx FD G# SS SG2 SG2 GS WV**  
**TG GM xx-xx FD G# SS UR6 UR8 GS WV**  
**TG GM xx-xx FD G# SS UG6 SG2 GS WV**

**TG H xx-xx FD R# OO UR6 BR6 PRAW**  
**TG H xx-xx FD R# OO UR6 UR8 GS WV**  
**TG H xx-xx FD R# SS UR6 BR6 PRAW**  
**TG H xx-xx FD R# SS UR6 UR8 GS WV**

with: xx-xx: from 6-40 to 360-150  
yy-yy: from 6-40 to 23-65  
#: 1, 2, 3, 4 or 5

For materials made from plastic the following additional declarations apply:

- “Certificate of compliance with EC1935/2004 food contact” for gaskets in Gylon® by supplier Eriks+Baudoin (see page 79)
- “Certificate of compliance with EC1935/2004 food contact” for gaskets in RX Flowtite® by supplier Eriks+Baudoin (see page 80)
- “Zertifikat – Bewertung der lebensmittelrechtlichen Konformität von Stopfbuchspackungen” for packing rings in Buramex®-SF 6335 by supplier EagleBurgmann (see page 81-82)
- “Declaration acc. FDA-requirement” for mechanical seal M7N by supplier EagleBurgmann (see page 83-84)

This Declaration shall be valid for a period of three years from the date that the pump has been shipped from our production unit.  
This Declaration does not modify any contractual arrangements, in particular regarding warranty and liability.

Erpe-Mere, 01 April 2014



Gerard Santema  
General manager

27/09/2010

## ERIKS + BAUDOIN

Antwerpen - Anvers - Antwerp  
Boombekelaan 3  
B-2660 Hoboken  
België - Belgique - Belgium  
tel. +32-3 829 26 11  
fax. +32-3 828 39 59

Conformiteitsattest EU1935/2004 voedingscontact  
*Attestation de conformité CE 1935/2004 contact avec des denrées alimentaires*  
*Certificate of compliance with EC1935/2004 food contact*

EN 10204 2.1

Omschrijving  
Dénomination  
Description

**Gylon® BLUE 3504**


- AQUEOUS FOOD
- FATTY FOOD
- DRY FOOD

Wij bevestigen U, dat de door ons geleverde en hierboven beschreven goederen voldoen aan de EU1935/2004 voorschriften voor gebruik in de voedingsindustrie.

*Par la présente nous vous confirmons que la matériel livré en annexe, selon votre commande en référence, répond aux normes en vigueur suivant les spécifications de la CE1935/2004 ( Pour produits alimentaires )*

*We hereby confirm that the goods supplied with the above references are suitable for contact with food in accordance with EC1935/2004 regulation*

ERIKS nv

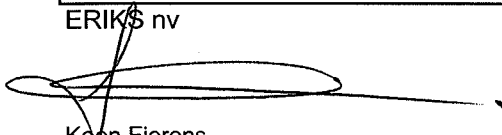  
Koen Fierens  
Kwaliteitsdienst  
Département Qualité  
Quality Department



20/10/2010

Antwerpen - Anvers - Antwerp  
Boombekelaan 3  
B-2660 Hoboken  
België - Belgique - Belgium  
tel. +32-3 829 26 11  
fax. +32-3 828 39 59

**Conformiteitsattest EU1935/2004 voedingscontact**  
**Attestation de conformité CE 1935/2004 contact avec des denrées alimentaires**  
**Certificate of compliance with EC1935/2004 food contact**

Omschrijving

Dénomination

Description

**RX FLOWTITE® flange gasket material**

**Migration**

- Simulant A 100°C
- Simulant B 100°C
- Simulant C 60°C
- Simulant D 60°C

**Fitted use**

- ACQUEOUS FOOD
- FATTY FOOD
- ALCOHOLIC FOOD
- DRY FOOD

Wij bevestigen U, dat de door ons geleverde en hierboven beschreven goederen voldoen aan de EU1935/2004 voorschriften voor gebruik in de voedingsindustrie.

*Par la présente nous vous confirmons que la matériel livré en annexe , selon votre commande en référence , répond aux normes en vigueur suivant les spécifications de la CE1935/2004 ( Pour produits alimentaires )*

*We hereby confirm that the goods supplied with the above references are suitable for contact with food in accordance with EC1935/2004 regulation*

ERIKS nv

Koen Fierens  
Kwaliteitsdienst  
Département Qualité  
Quality Department

  
Koen Fierens  
Eriks NV



ERIKS+BAUDOIN will make sure the origin of this material is coded 2014677 and will share any additional information when available





# Zertifikat

## Bewertung der lebensmittelrechtlichen Konformität von Stopfbuchspackungen

Auftraggeber: Burgmann Packings  
Dublin 24, Ireland

Auftrag: PA/4073/05

Probe: Burgmann Buramex-SF 6335

Die Stopfbuchspackung Burgmann Buramex-SF 6335 wird für Dichtpackungen in Lebensmittelverarbeitungsmaschinen, Rohren etc. verwendet, insbesondere zur Abdichtung rotierender Wellen etc. in Armaturen, Pumpen, Rührwerken u. a.. Die Stopfbuchse ist dabei in ein Gehäuse eingebaut und nur über einen schmalen Spalt in Verbindung mit dem Behälter oder Rohr, das das Lebensmittel enthält. Die Stopfbuchse kommt dabei nur zufällig mit Lebensmitteln in Berührung, die durch den Spalt in das Packungsgehäuse gedrückt werden oder spritzen. Die am Spalt anliegende Fläche beträgt dabei  $\frac{2}{10}$  einer Kantenfläche (2 mm Breite). Dabei sind die Systeme insbesondere bei Pumpen in der Regel so angelegt, dass an die Welle im Bereich der Dichtung gelangendes Lebensmittel nach außen abtransportiert wird und nicht wieder in den Behälter zurück gelangt. Stopfbuchsen werden für Pumpen mit einem Durchsatz von mehr als 1000 l/h und Rührwerke für Füllungen von mindestens 1-2 m<sup>3</sup> verwendet. Die Haltbarkeit der Dichtung beträgt ca. 1 Jahr. Dabei treten einschließlich der Reibungswärme Temperaturen bis 100 °C an der Stopfbuchse auf.

Die Stopfbuchspackung wurde auf lebensmittelrechtliche Konformität bezüglich der Anforderungen in USA und der europäischen Union untersucht (Prüfbericht PA/4532/05 Teil 6 vom 5.12.2005).

Fluorhaltige Verbindungen wurden über Halogensignale bei Gaschromatographie mit ECD-Detektion aus dem Ethylacetat-extrakt untersucht. Fluorverbindungen sind unter 35 µg/g Fluoräquivalente im Material. Da es sich bei der Stopfbuchspackung nicht um ein reines plattenförmiges PTFE handelt, ist die Anforderung an die gesamtextrahierbaren Substanzen gemäß 21 CFR §177.1550 (e) (3) (i) nicht anwendbar.

Für Dichtungen, Stopfen etc. wird die Migration auf die Gesamtmenge des möglicherweise in Kontakt kommenden Lebensmittels bezogen. Bei einer absoluten Abgabe von 59 mg bei 30 min Kontakt bei 100 °C wird der Gesamtmigrationsgrenzwert bereits bei Kontakt mit 1 kg Lebensmittel unterschritten. Bei Übergang in Chargen von 1000 l und mehr liegt die Gesamtheit der maximal übergehenden Substanzen im ppb-Bereich.

Einzelsubstanzen liegen daher erheblich darunter. In der Realität sind die Migrationen noch geringer, da Lebensmittel, das unbeabsichtigt mit der Dichtung in Kontakt kommt, üblicherweise nicht zurückgeführt sondern nach außen abgeführt wird.

Die gefundenen Substanzen können den für den direkten Lebensmittelkontakt zulässigen Paraffinen zugeordnet werden. Möglicherweise vorhandene weitere migrierfähige Komponenten liegen in jedem Fall unterhalb des Threshold of Regulation (21 CFR 170.39). Der Threshold of Regulation (TOR) wurde nach Auswertung nicht-kanzeregener und kanzeregener Effekte einer großen Anzahl repräsentativer Substanzen durch die FDA als ein spezifischer Wert der Exposition über die Ernährung festgelegt, der deutlich unter solchen Werten liegt, die typischerweise toxische Effekte induzieren. Daher sind Bedenken zur Sicherheit vernachlässigbar klein. Der TOR beträgt 0,5 µg/kg in der täglichen Nahrung. Für die Bewertung des Migrationsexperimentes wird zusätzlich der statistische Anteil der Lebensmittel im Kontakt mit den Substanzen zum Gesamtlebensmittelverzehr eingerechnet (Consumption Factor CF). Statistische Daten liegen uns nicht vor. Bei geringem Anteil und fehlender Datenlage wird mit einem Consumption Factor von 0,05 gerechnet. Dies würde einer maximalen Migration von 10 µg/kg (ppb) entsprechen. In der EU wird zur Bewertung von Stoffübergängen nicht bewerteter Substanzen durch funktionelle Barrieren die Anforderung der Nicht-Nachweisbarkeit bei einer Nachweisgrenze von 10 ppb erwartet (Entwurf Super-Regulation). Dies würde auch den niedrigsten spezifischen Migrationsgrenzwerten in der EU, wie sie für kanzerogene Monomere vorgesehen sind, entsprechen.

Schlussfolgerung: Der Einsatz der Stopfbuchspackung bei Lebensmittelverarbeitungsmaschinen ist konform mit den Anforderungen der Lebensmittelsicherheit gemäß US 21 CFR 170.3 (i) und Artikel 3 der EU-Rahmenverordnung 1935/2004.

Fraunhofer Institut  
Verfahrenstechnik  
und Verpackung

Freising, den 21.12.2005



Dr. Roland Franz  
(Prüfleiter Migration)



Dr. Angela Störmer  
(stellv. Prüfleiterin Migration)

**Bestätigung gemäß FDA-Forderung**  
**Confirmation acc. FDA-requirement**  
**Confirmation suivant la prescription FDA**

Beleg-Nr Cert.-no.	1	
Seite Page	1 von of	2

<b>Besteller:</b> Customer: Client:	EagleBurgmann Belgium BVBA	<b>Best.-Nr./ Datum:</b> Order-no./ date: No.de commande:	<b>B104898 / 30.11.2010</b>
<b>Hersteller:</b> Manufacturer: Fabricant:	<b>EagleBurgmann Germany</b>	<b>Besteller-Auftr.-Nr.:</b> Order.no.(Customer): No.de command (client):	<b>389607</b>
<b>Gegenstand:</b> Object: Désignation:	Gleitringsdichtung Mechanical seal Garniture mécanique d'étanchéité	<b>Kommission:</b> Commission.-no.: No.de commande:	<b>A70 968</b>
<b>Fabr.-Nr.:</b> Fabr.-no.: No.de fabrication:	----	<b>Zelchn.-Nr.:</b> Drawing-no.: No. de plan:	<b>M7N/40-00 (002391 047)</b>
<b>Einzelteil:</b> component Part: pièce détachée:	Gleitrings und Gegenrings Seal faces and Stationary seats Grains tournants et Contre-grains	<b>Stück:</b> Quantity: Nombre:	<b>6</b>
		<b>Werkstoffe:</b> Materials: Materiaux:	<b>Buka 22 (Q1, Q12) Buka 20 (Q2, Q22)</b>

**Bestätigung / Confirmation / Confirmation**

Hiermit bestätigen wir, daß EagleBurgmann Gleitrings und Gegenrings aus den Werkstoffen Buka 20 / Buka 22 gemäß FDA-Information vom 24.05.1989 lebensmitteltauglich sind.

Herewith we certify that EagleBurgmann seal faces and stationary seats made of material Buka 20 / Buka 22 can be used in food applications in accordance with the FDA-information of may, 24.1989.

Nous confirmons par la présente que les grains tournants et les contre-grains en Buka 20 / Buka 22 de EagleBurgmann sont convenables pour l'alimentation selon la information FDA du 24.05.1989.


**Bemerkungen / Remarks / Remarques**

Buka 22 = SiC, Siliziumkarbid, drucklos gesintert / Silicon carbide pressureless sintered, Carbure de silicium, fritté sans pression

Buka 20 = SiC-Si, Siliziumkarbid, reaktionsgebunden / Silicon carbide reaction bonded, Carbure de silicium dép. de la réaction

EagleBurgmann Germany  
 GmbH & Co. KG  
 82502 Wolfratshausen  
 Telefon 08171/23-0  
 Telefax 08171/23-1214  
 www.eagleburgmann.com

Wolfratshausen, den 22.01.2011

Träger 

**Bestätigung gemäß FDA-Forderung**  
**Confirmation acc. FDA-requirement**  
**Confirmation suivant la prescription FDA**

(CFR 21)

Beleg-Nr Cert.-no.	1	
Seite Page	2 von of	2

<b>Besteller:</b> Customer: Client:	EagleBurgmann Belgium BVBA	<b>Best.-Nr./ Datum:</b> Order-no./ date: No.de commande:	<b>B104898 / 30.11.2010</b>
<b>Hersteller:</b> Manufacturer: Fabricant:	<b>EagleBurgmann Germany</b>	<b>Besteller-Auftr.-Nr.:</b> Order.no.(Customer): No.de command (client):	<b>389607</b>
<b>Gegenstand:</b> Object: Désignation:	Gleitringdichtung Mechanical seal Garniture mécanique d'étanchéité	<b>Kommission:</b> Commission.-no.: No.de commande:	<b>A70 968</b>
<b>Fabr.-Nr.:</b> Fabr.-no.: No.de fabrication:	---	<b>Zeichn.-Nr.:</b> Drawing-no.: No. de plan:	<b>M7N/40-00 (002391 047)</b>
<b>Einzelteil:</b> component Part: pièce détachée:	Runddichtringe O-rings Joints toriques	<b>Stück:</b> Quantity: Nombre:	<b>6</b>
		<b>Werkstoffe:</b> Materials: Materiaux:	<b>V16</b>

## Bestätigung / Confirmation / Confirmation

Hiermit bestätigen wir, daß EagleBurgmann Runddichtringe aus Werkstoff V16 den Anforderungen gemäß FDA-Vorschrift "Code of Federal Regulation, Title (CFR 21), § 177.2600" entsprechen.

Herewith we certify that EagleBurgmann O-rings made of material V16 fulfill the requirements of FDA-regulation "Code of Federal Regulation, Title (CFR 21), § 177.2600".


Nous confirmons par la présente que les joints toriques EagleBurgmann en V16 sont conformes aux demandes selon la prescription FDA "Code of Federal Regulation, Title (CFR 21), § 177.2600".

## Bemerkungen / Remarks / Remarques

V16 = Fluor-Kautschuk /  
 Fluorcarbon rubber /  
 Elastomère en carbone fluoré

EagleBurgmann Germany  
 GmbH & Co. KG  
 82502 Wolfratshausen  
 Telefon 08171/23-0  
 Telefax 08171/23-1214  
 www.eagleburgmann.com

Wolfratshausen, den 22.01.2011

Träger 







# TopGear GP

INTERNAL GEAR PUMPS



## **SPX FLOW TECHNOLOGY BELGIUM NV**

Evenbroekveld 2-6

BE-9420 Erpe-Mere, Belgium

P: +32 (0)53 60 27 15

F: +32 (0)53 60 27 01

E: [johnson-pump.be.support@spx.com](mailto:johnson-pump.be.support@spx.com)

SPX reserves the right to incorporate our latest design and material changes without notice or obligation. Design features, materials of construction and dimensional data, as described in this bulletin, are provided for your information only and should not be relied upon unless confirmed in writing.

Please contact your local sales representative for product availability in your region. For more information visit [www.spx.com](http://www.spx.com).

ISSUED 10/2013 A.0500.451 EN

COPYRIGHT ©2000, 2008, 2011, 2013, 2014 SPX Corporation